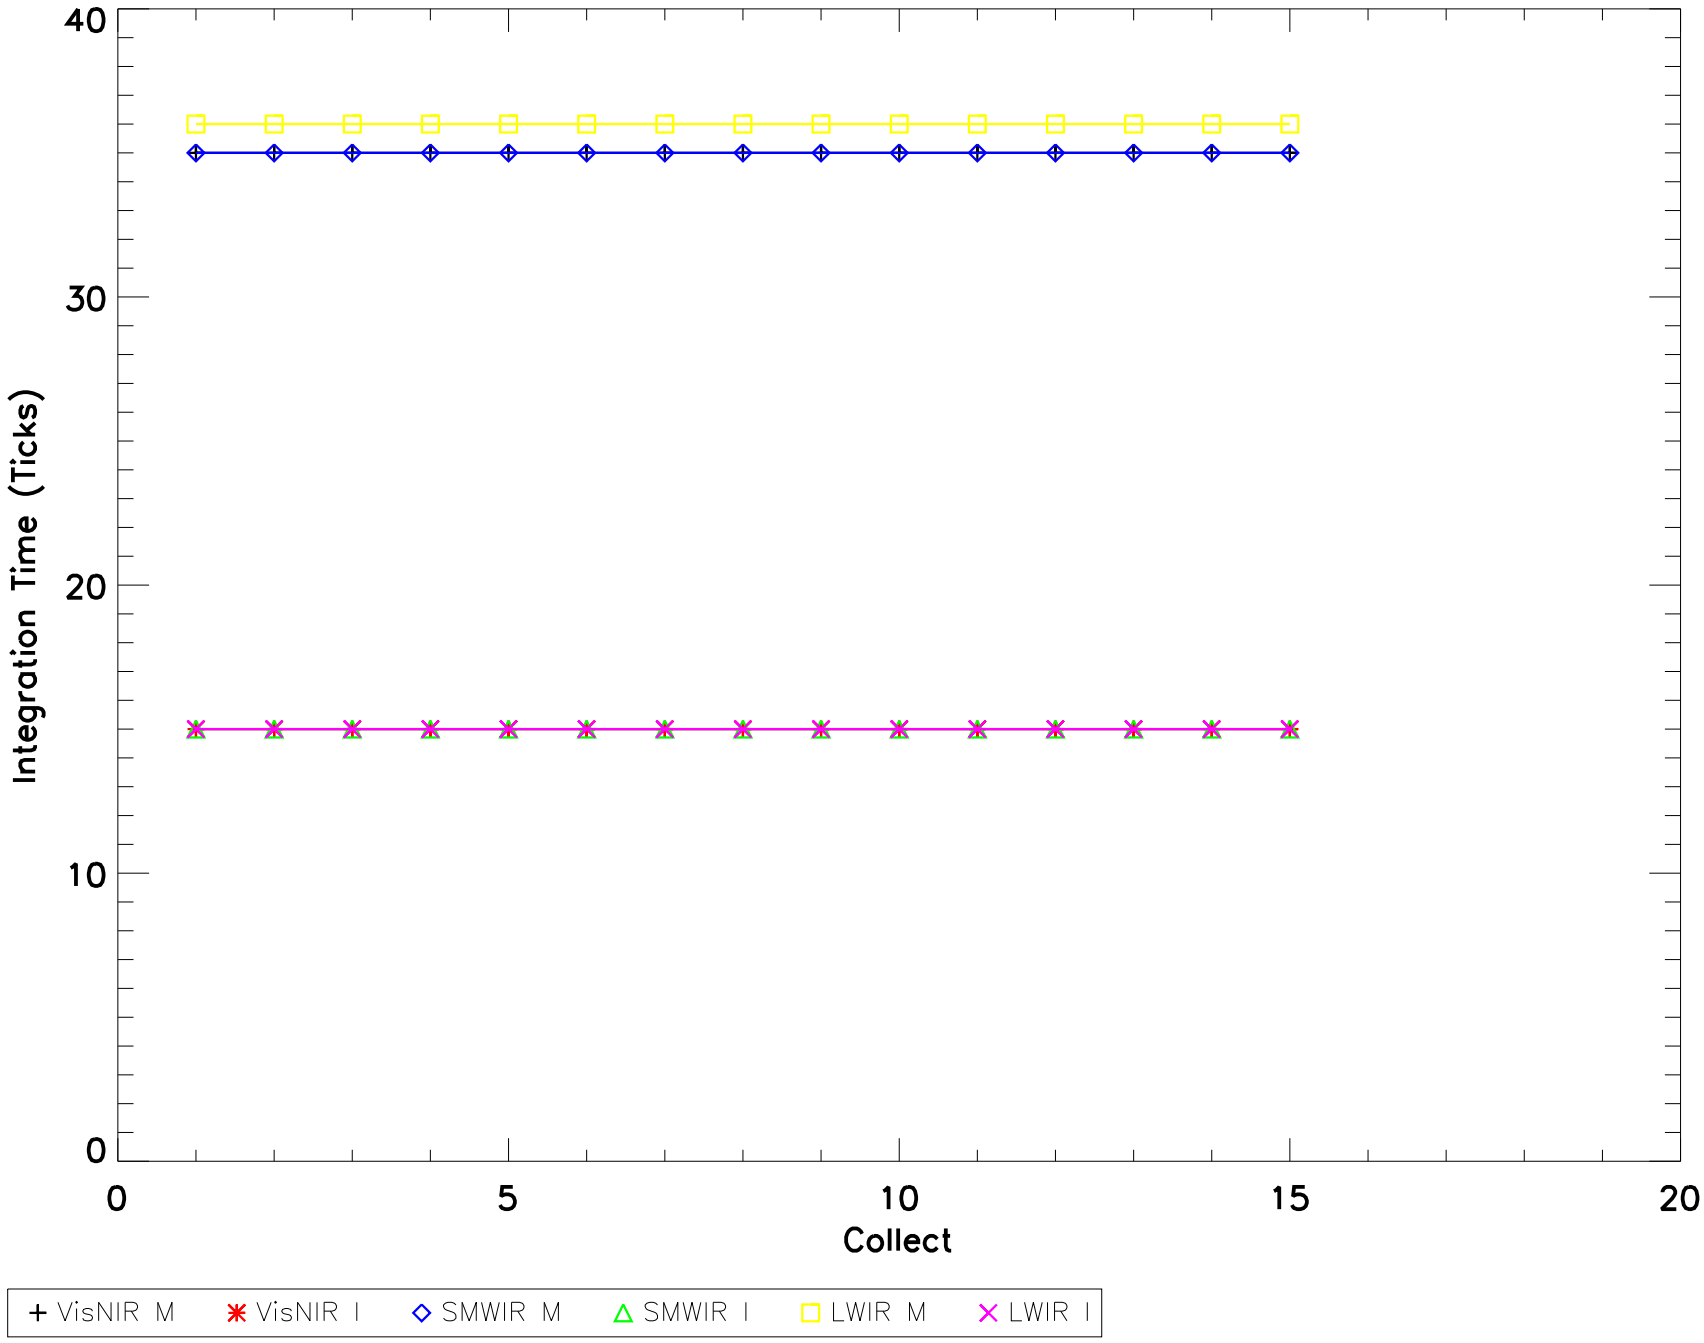
Integration Time vs Collect
Integration Time (Ticks)
40
30
20
10
0
0
5
10
15
20
Collect
VisNIR M
VisNIR I
SMWIR M
SMWIR I
LWIR M
LWIR I

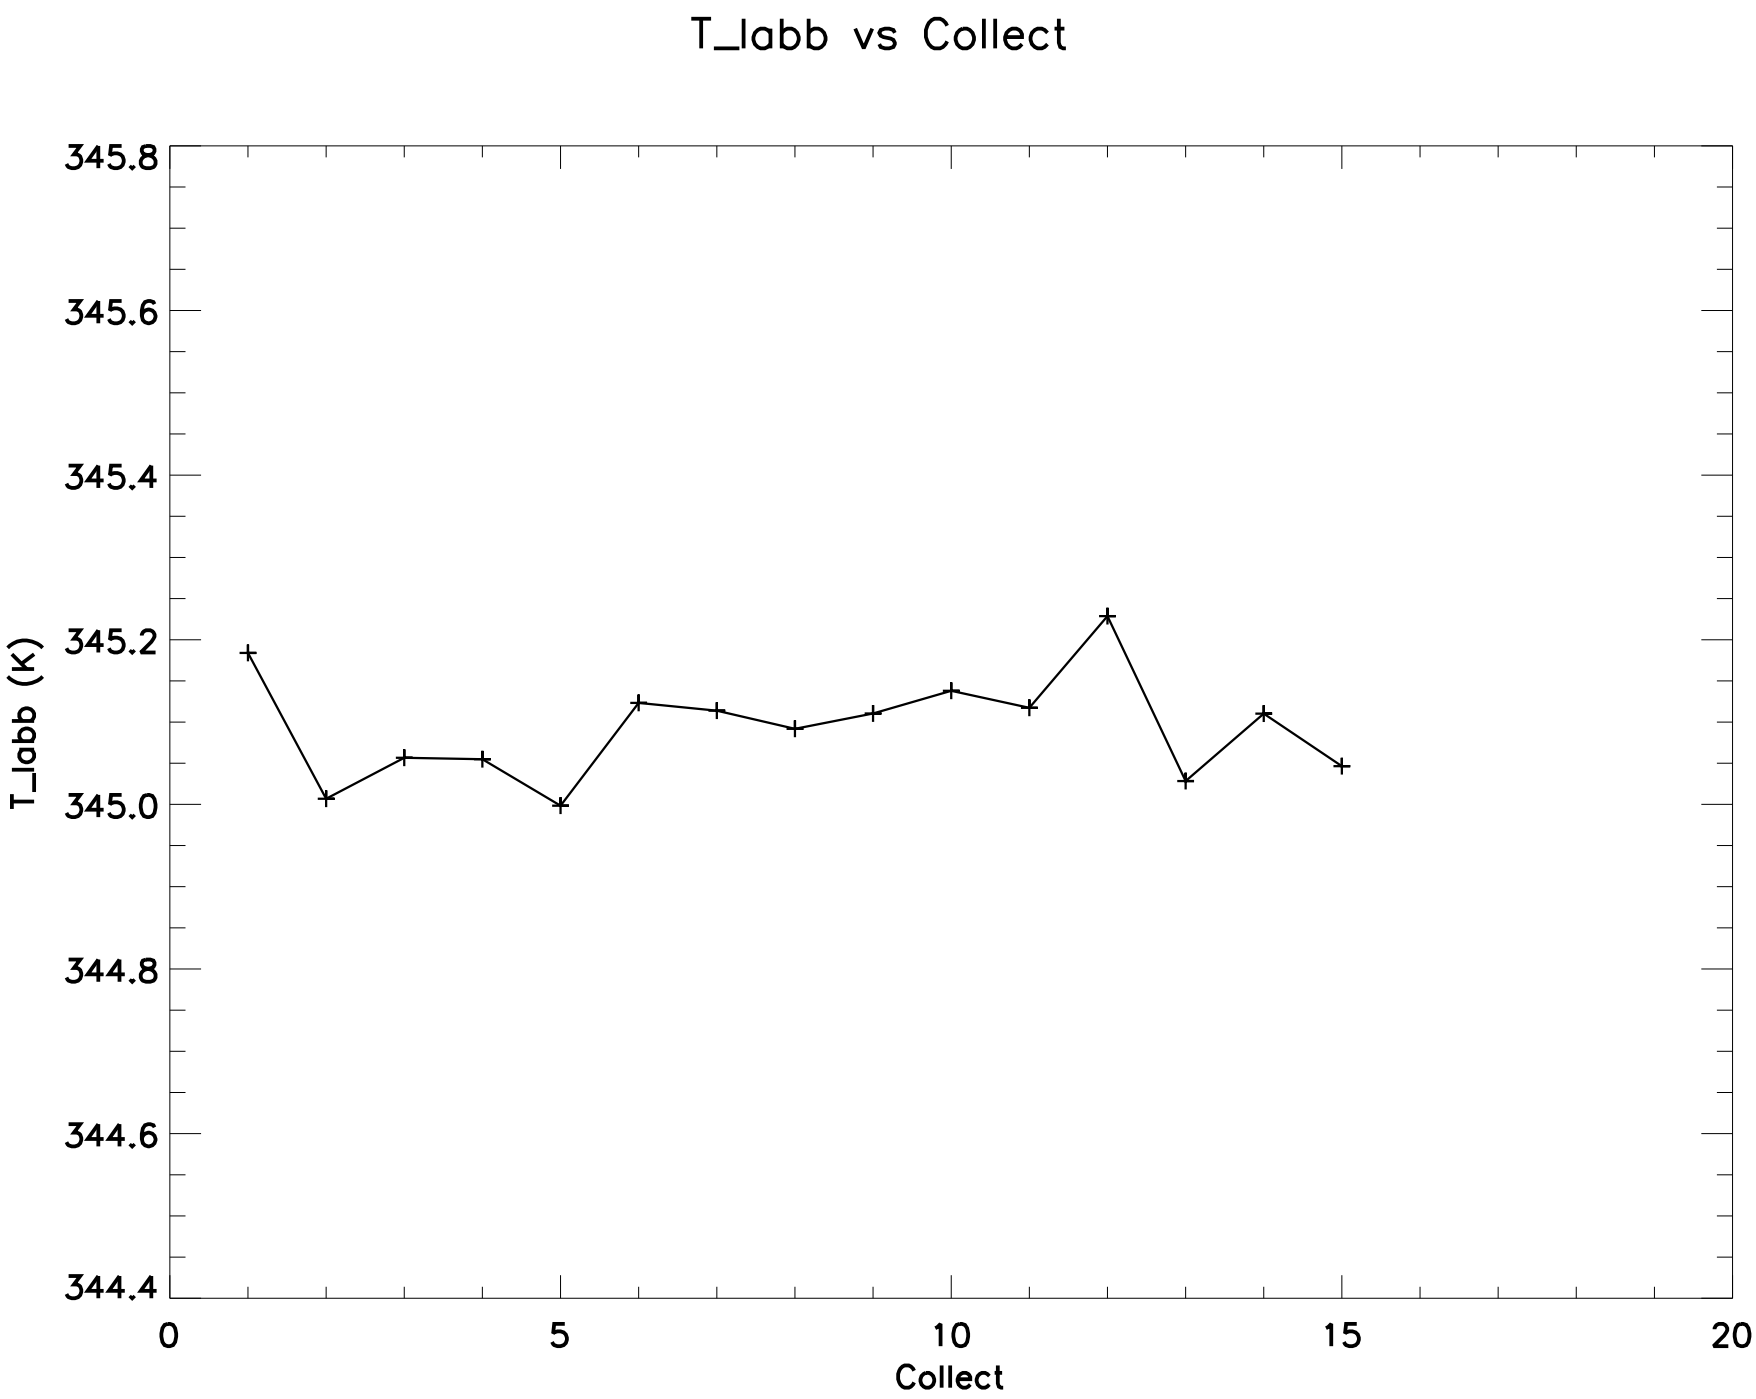
T_labb vs Collect
345.8
345.6
345.4
345.2
345.0
344.8
344.6
344.4
T_labb (K)
0
5
10
15
20
Collect

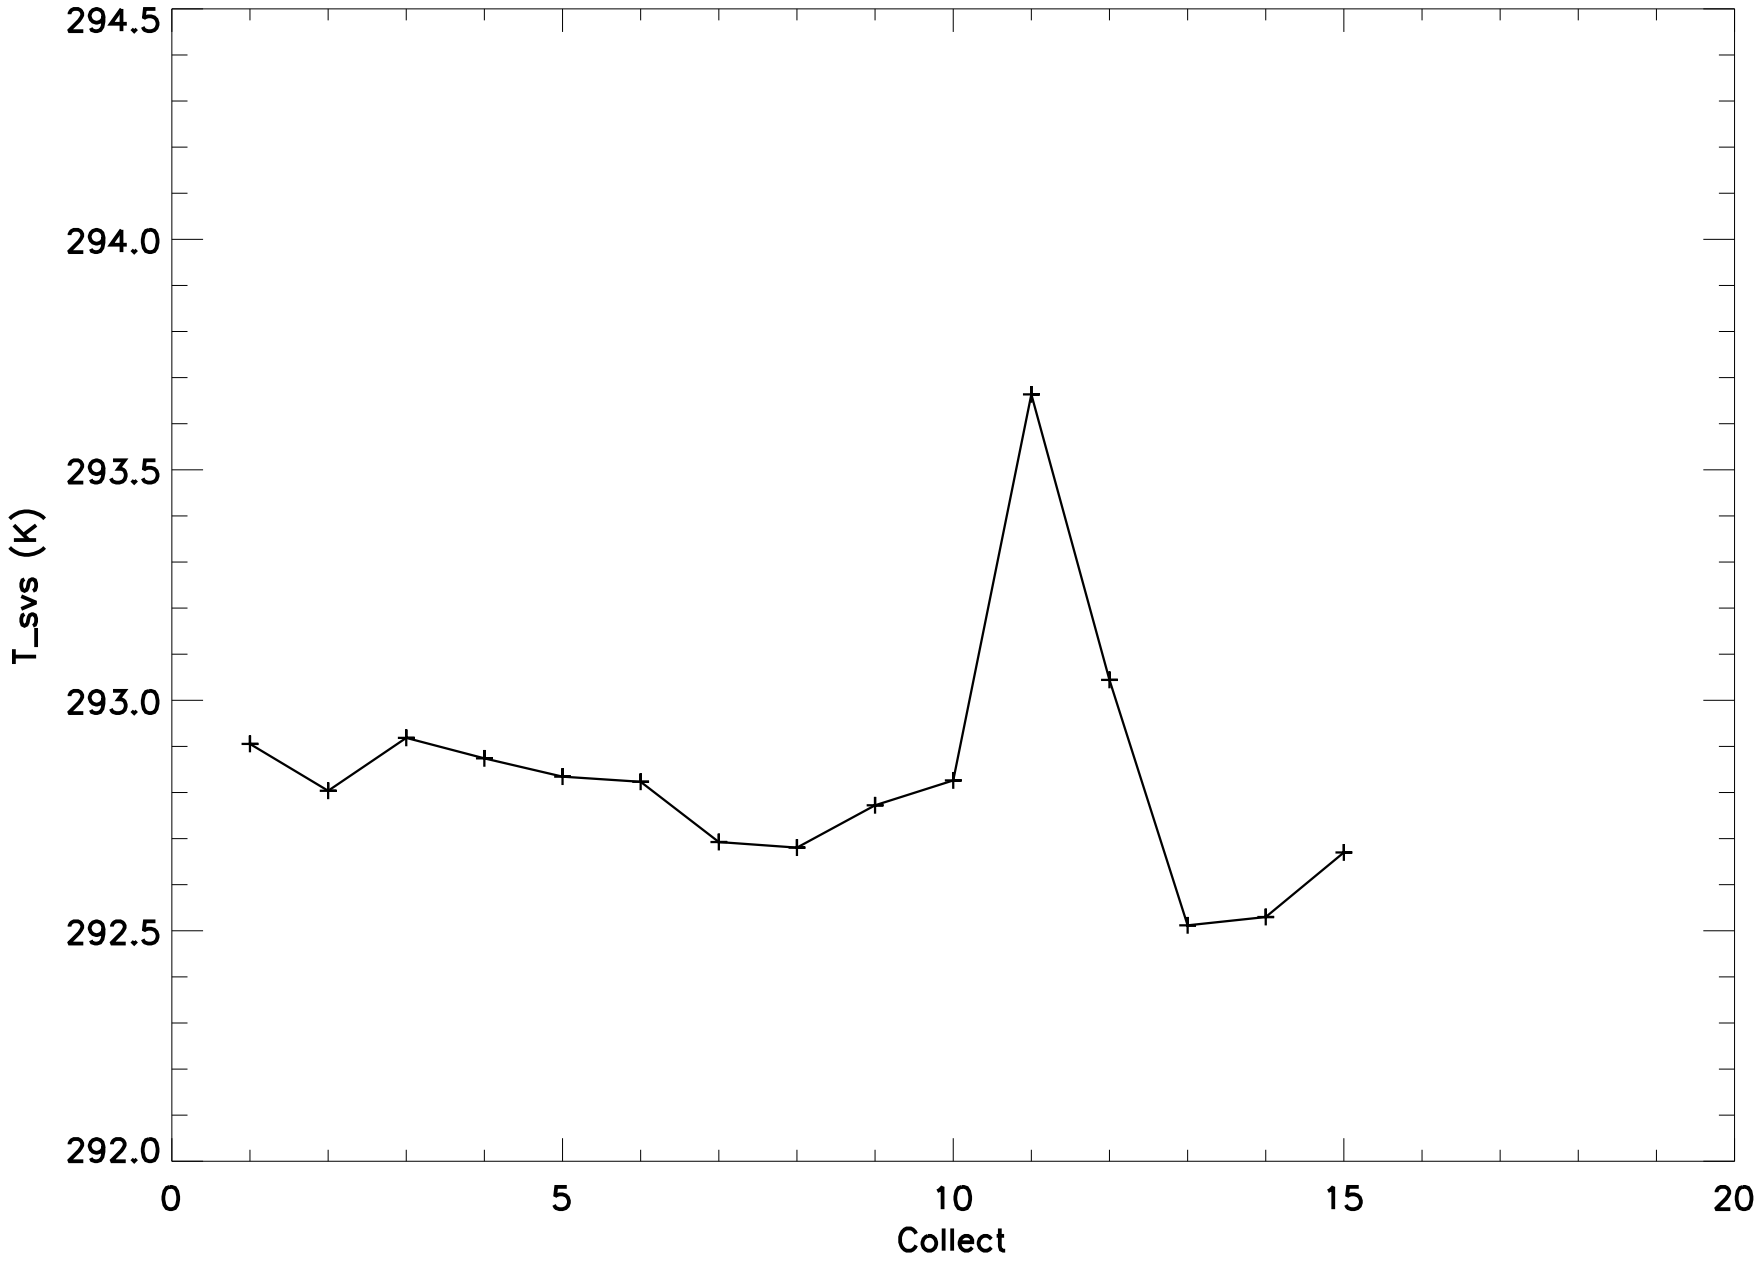
T_svs vs Collect
294.5
294.0
293.5
293.0
292.5
292.0
T_svs (K)
0
5
10
15
20
Collect

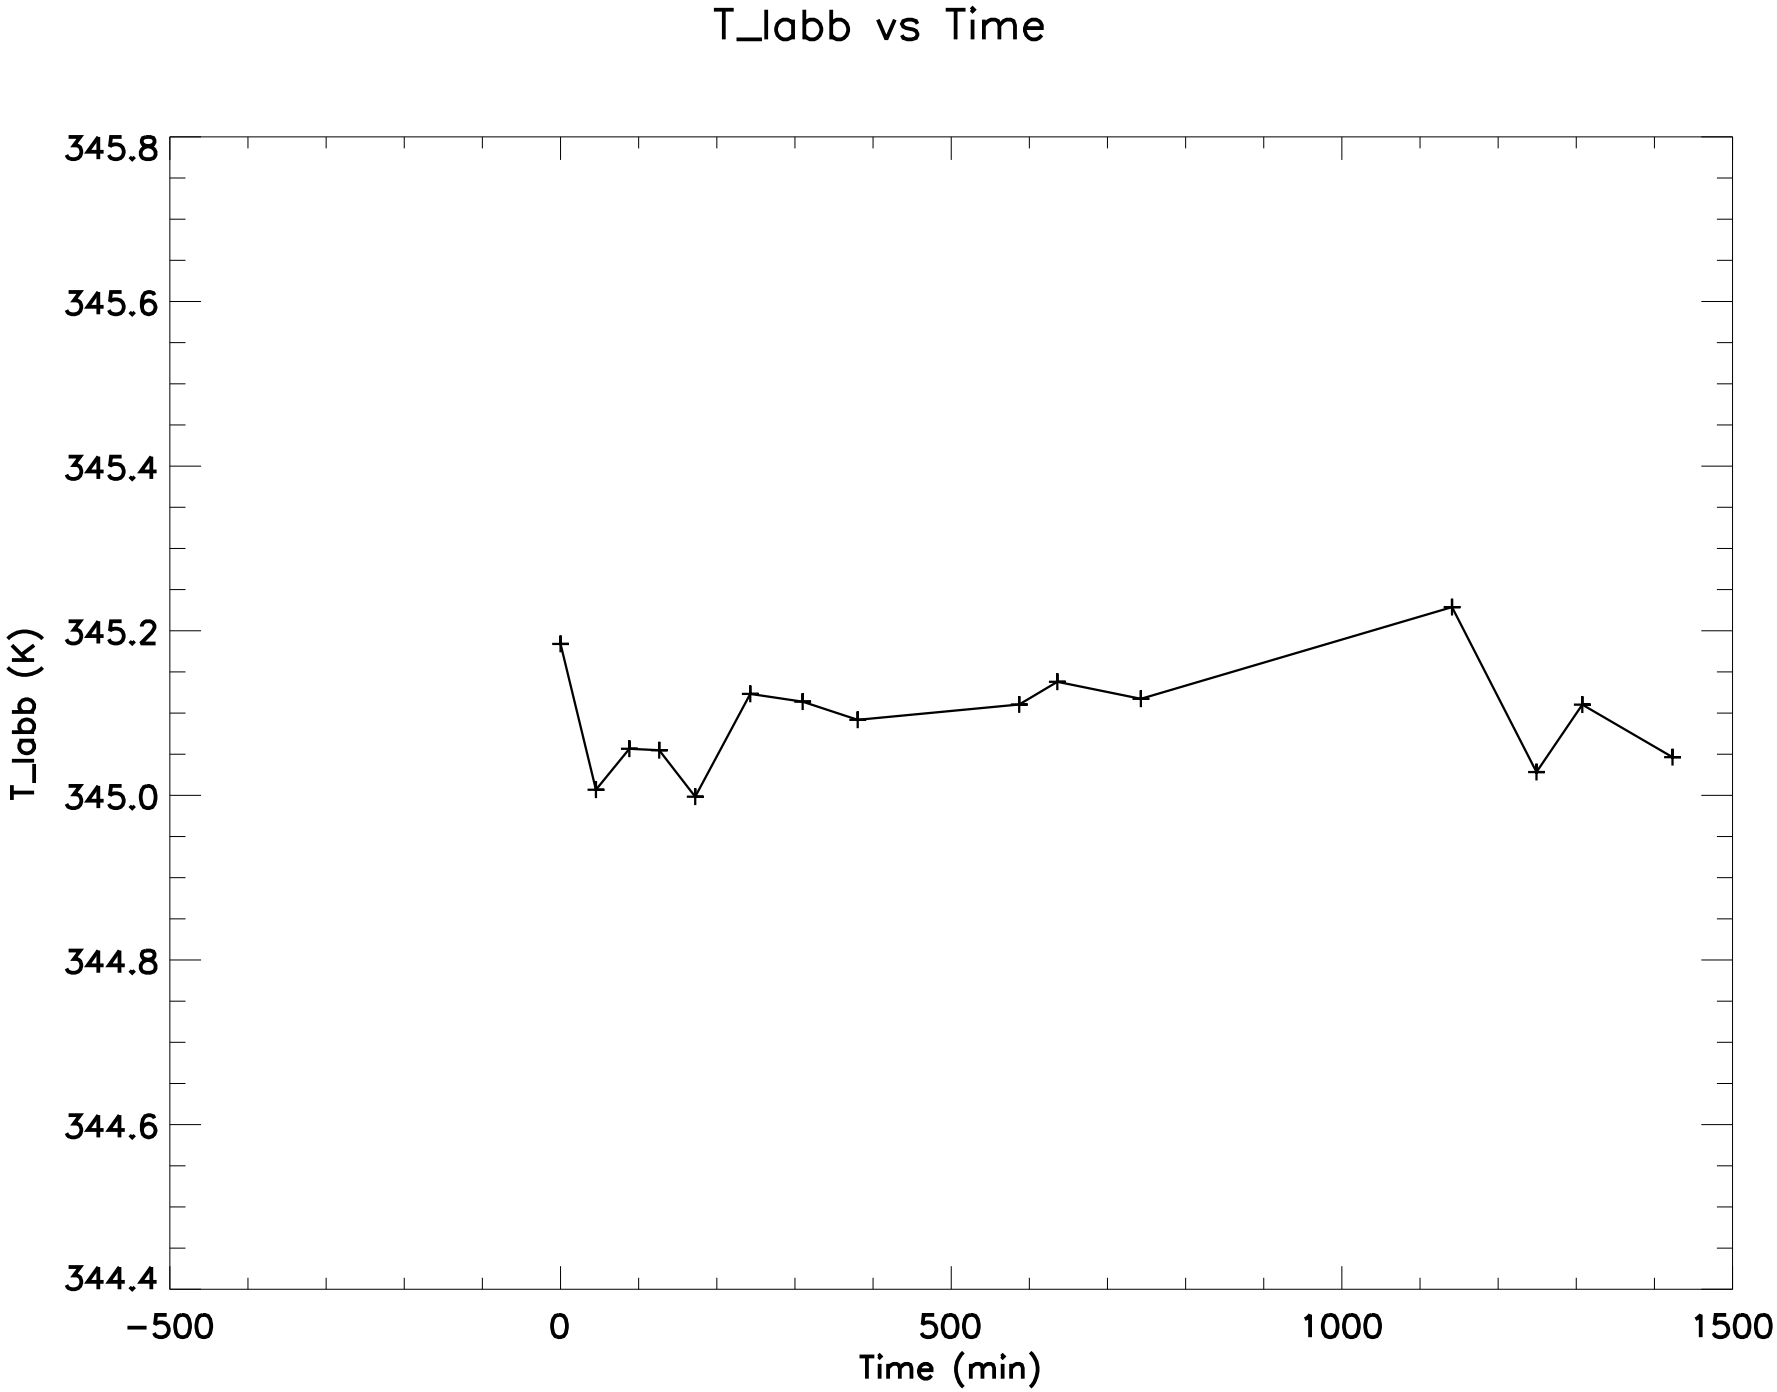
T_labb vs Time
345.8
345.6
345.4
345.2
345.0
344.8
344.6
344.4
T_labb (K)
−500
0
500
1000
1500
Time (min)

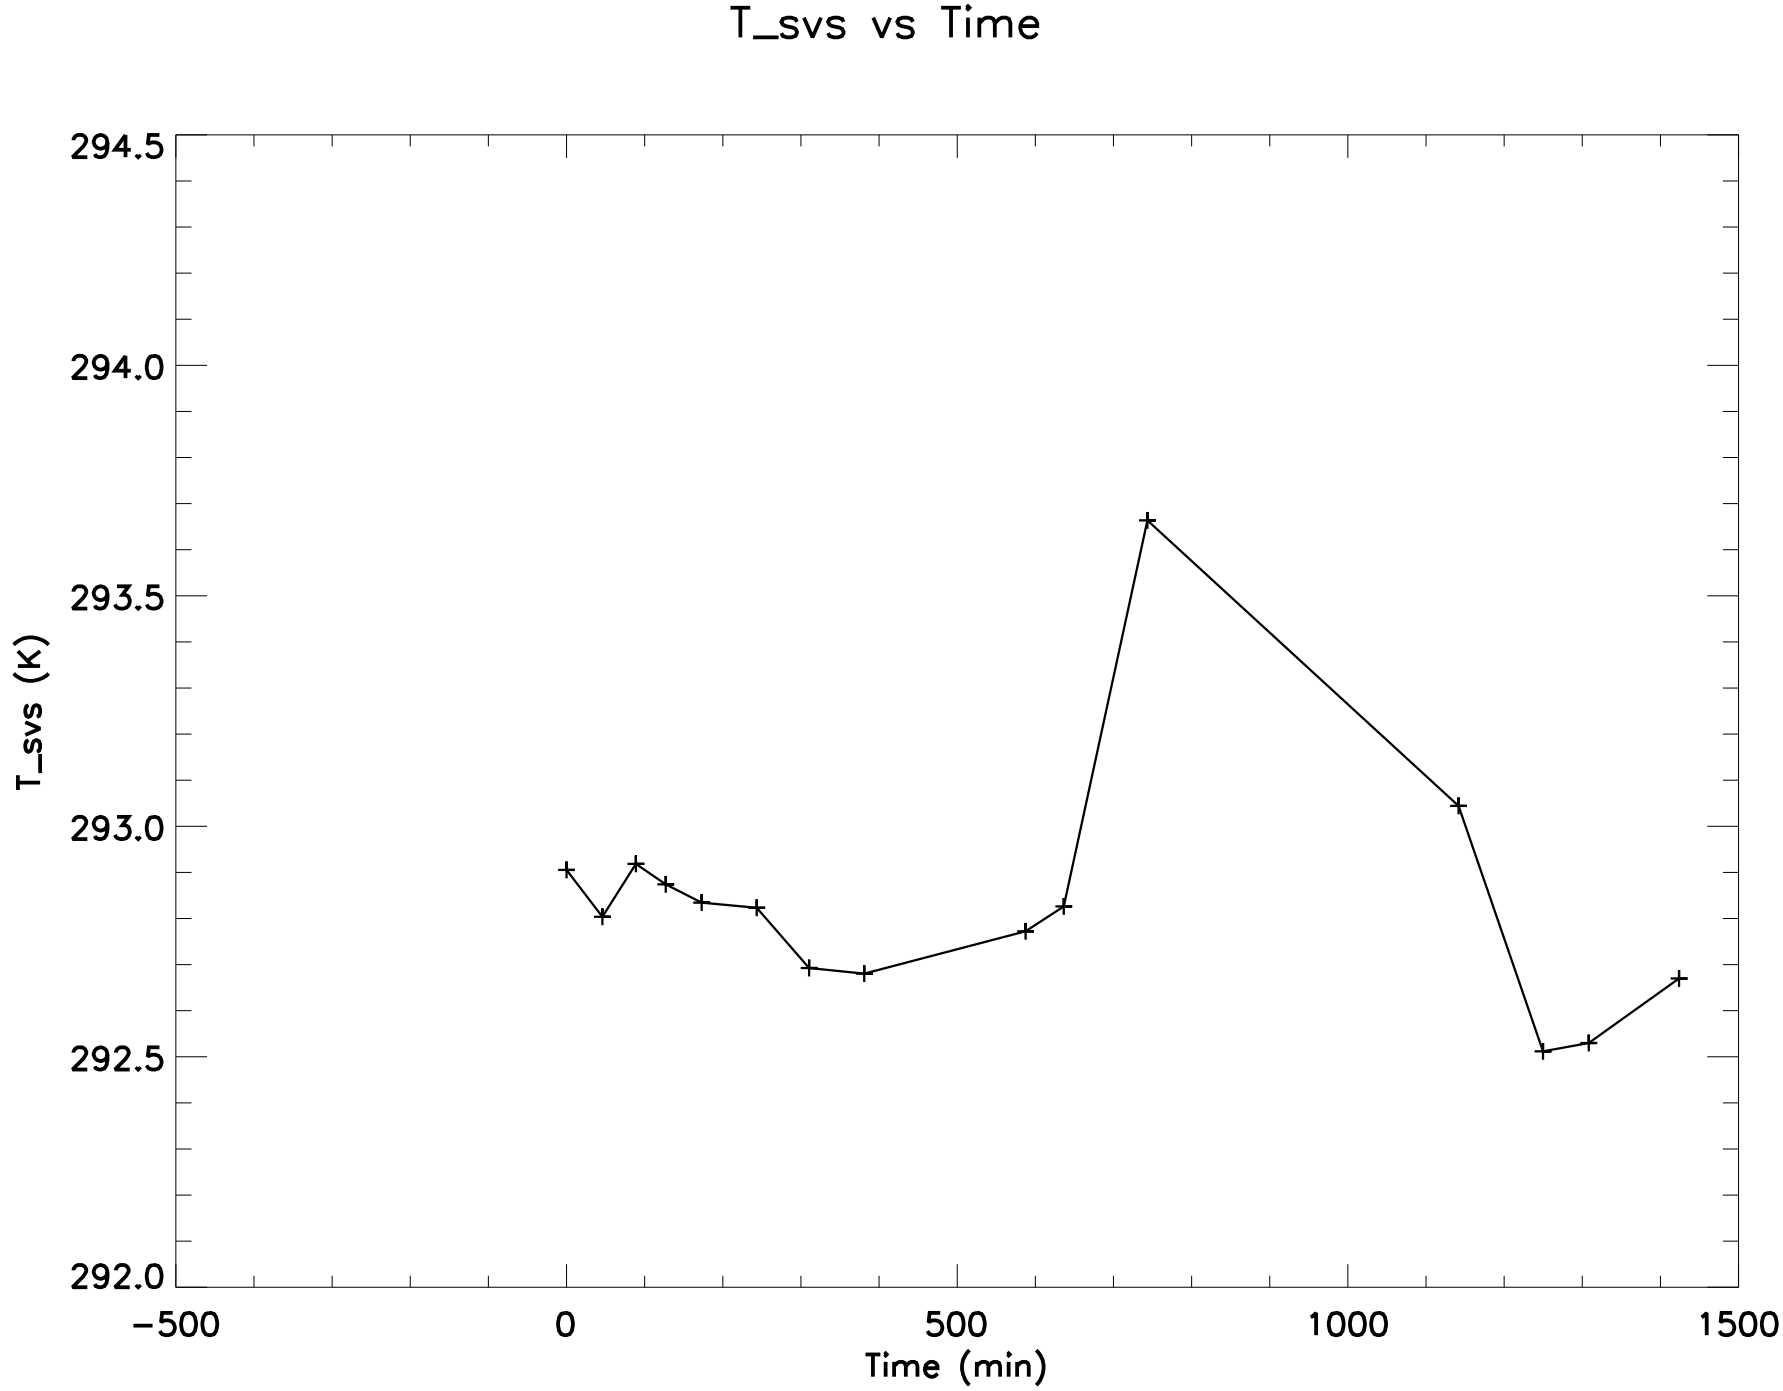
T_svs vs Time
294.5
294.0
293.5
293.0
292.5
292.0
T_svs (K)
−500
0
500
1000
1500
Time (min)

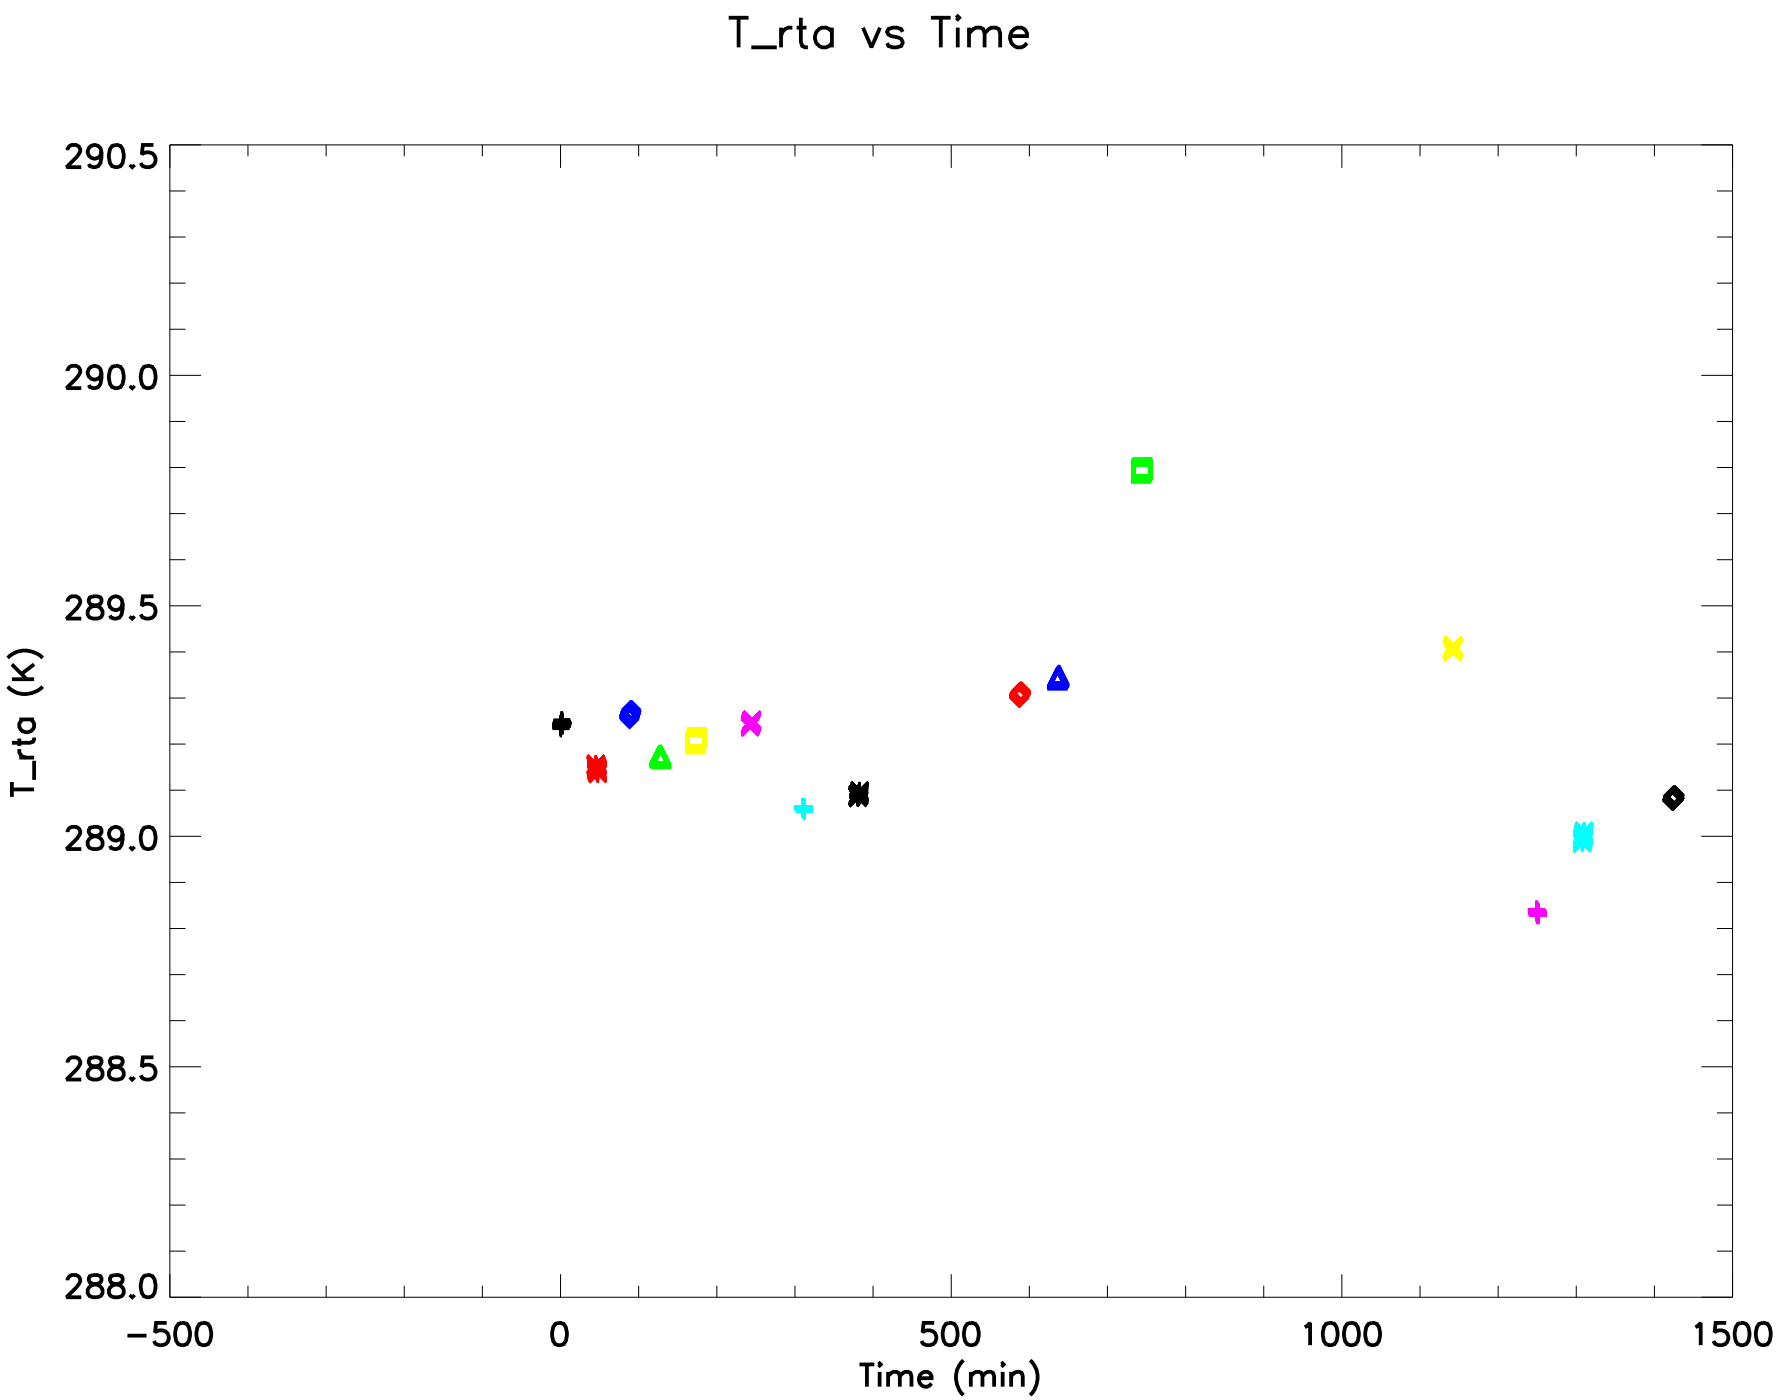
T_rta vs Time
290.5
290.0
289.5
289.0
288.5
288.0
T_rta (K)
−500
0
500
1000
1500
Time (min)

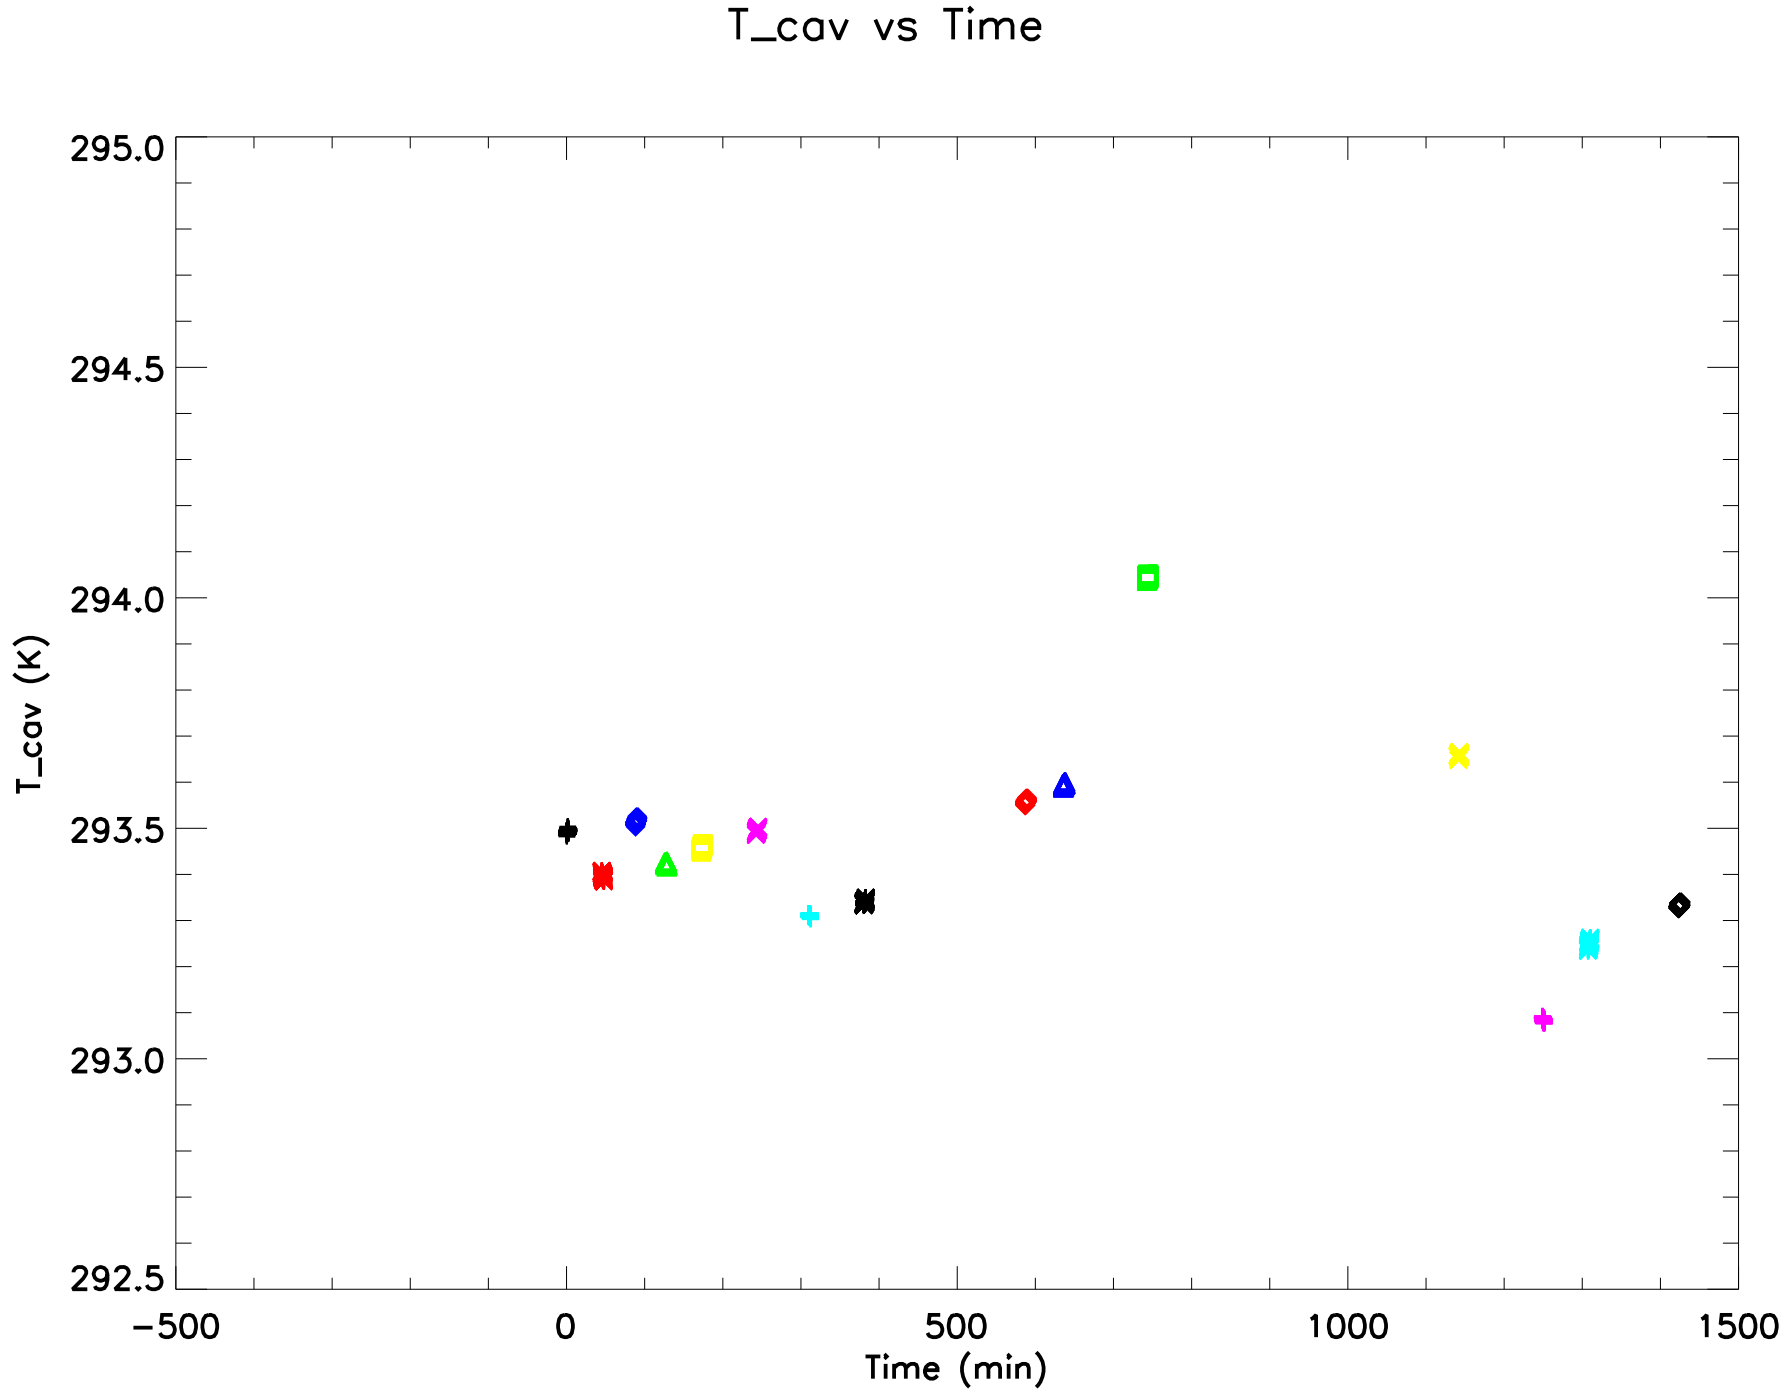
T_cav vs Time
295.0
294.5
294.0
293.5
293.0
292.5
T_cav (K)
−500
0
500
1000
1500
Time (min)

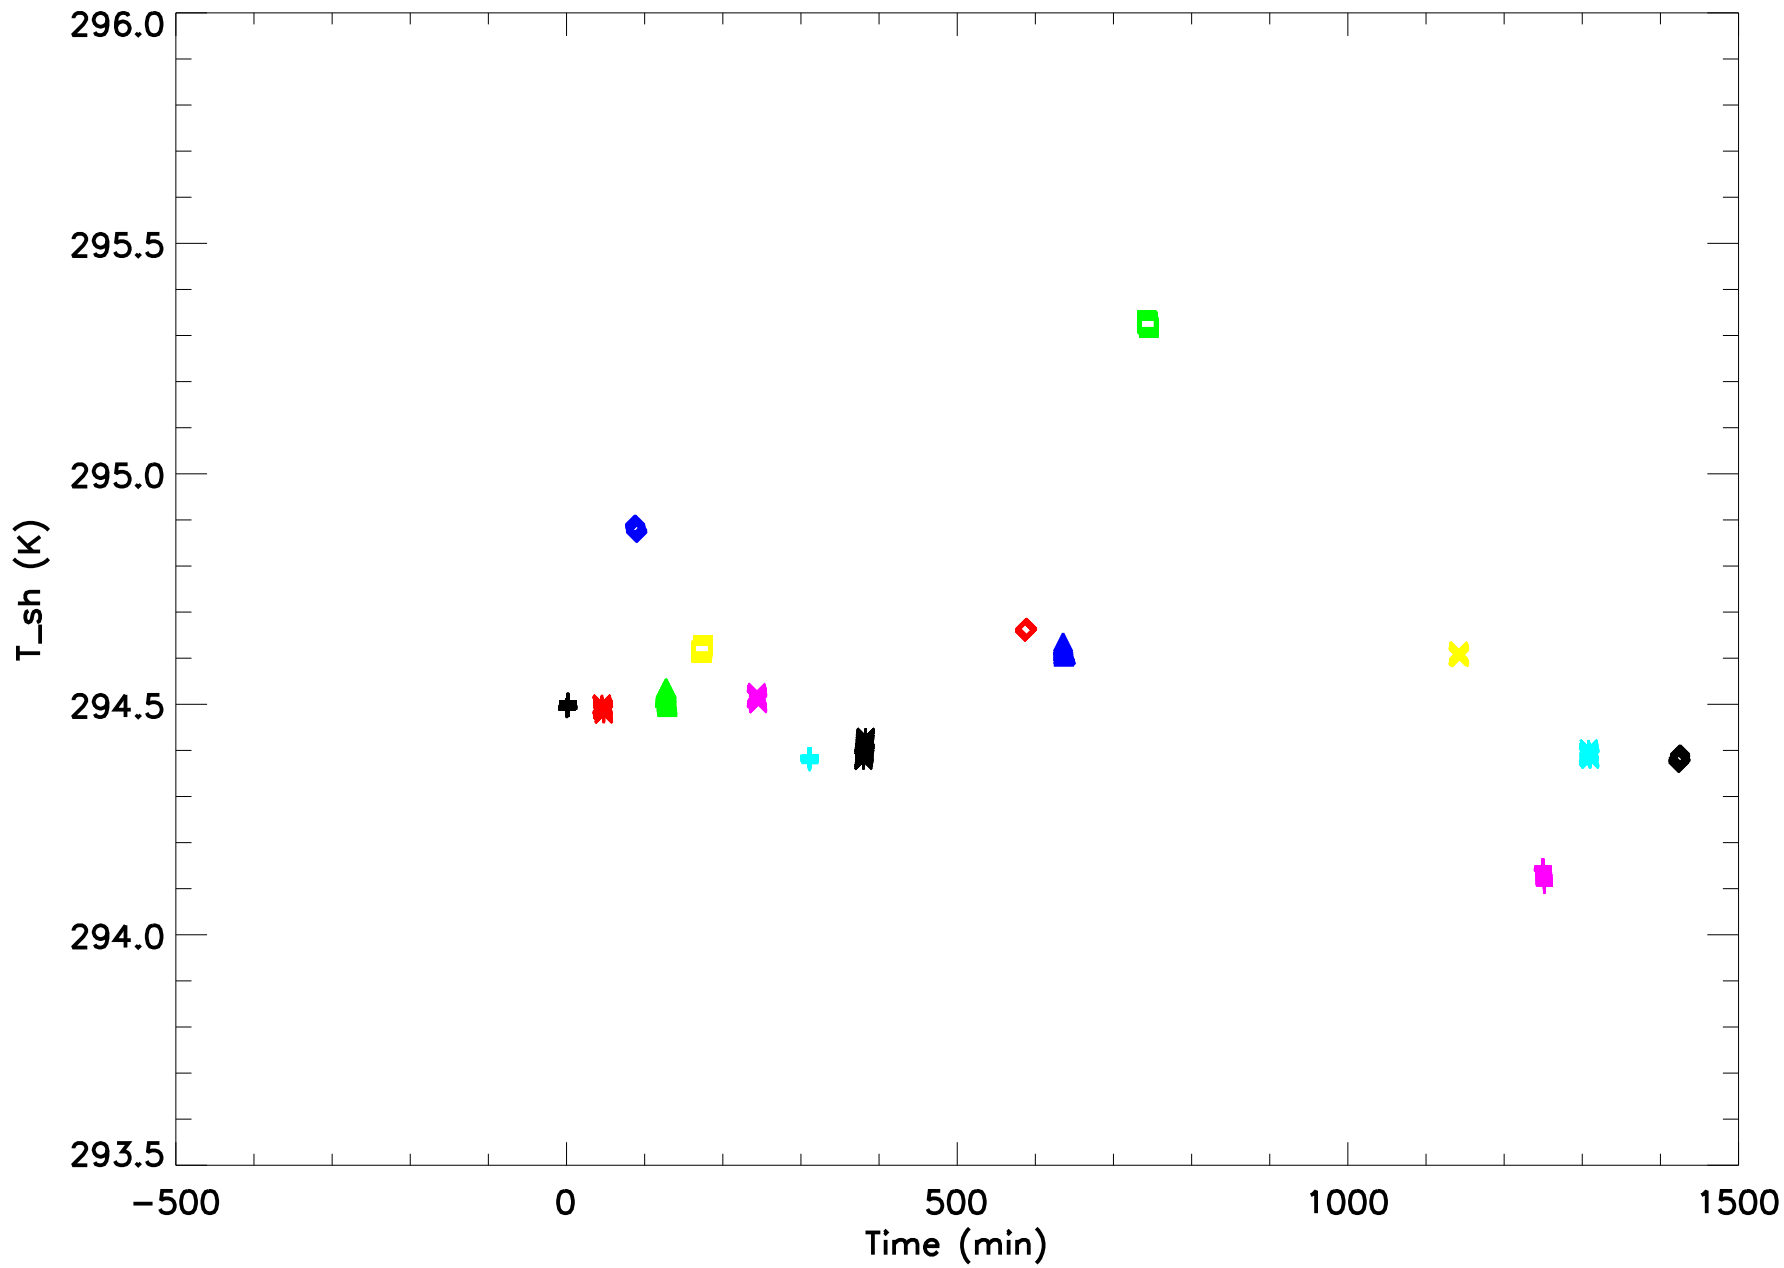
T_sh vs Time
296.0
295.5
295.0
294.5
294.0
293.5
T_sh (K)
−500
0
500
1000
1500
Time (min)

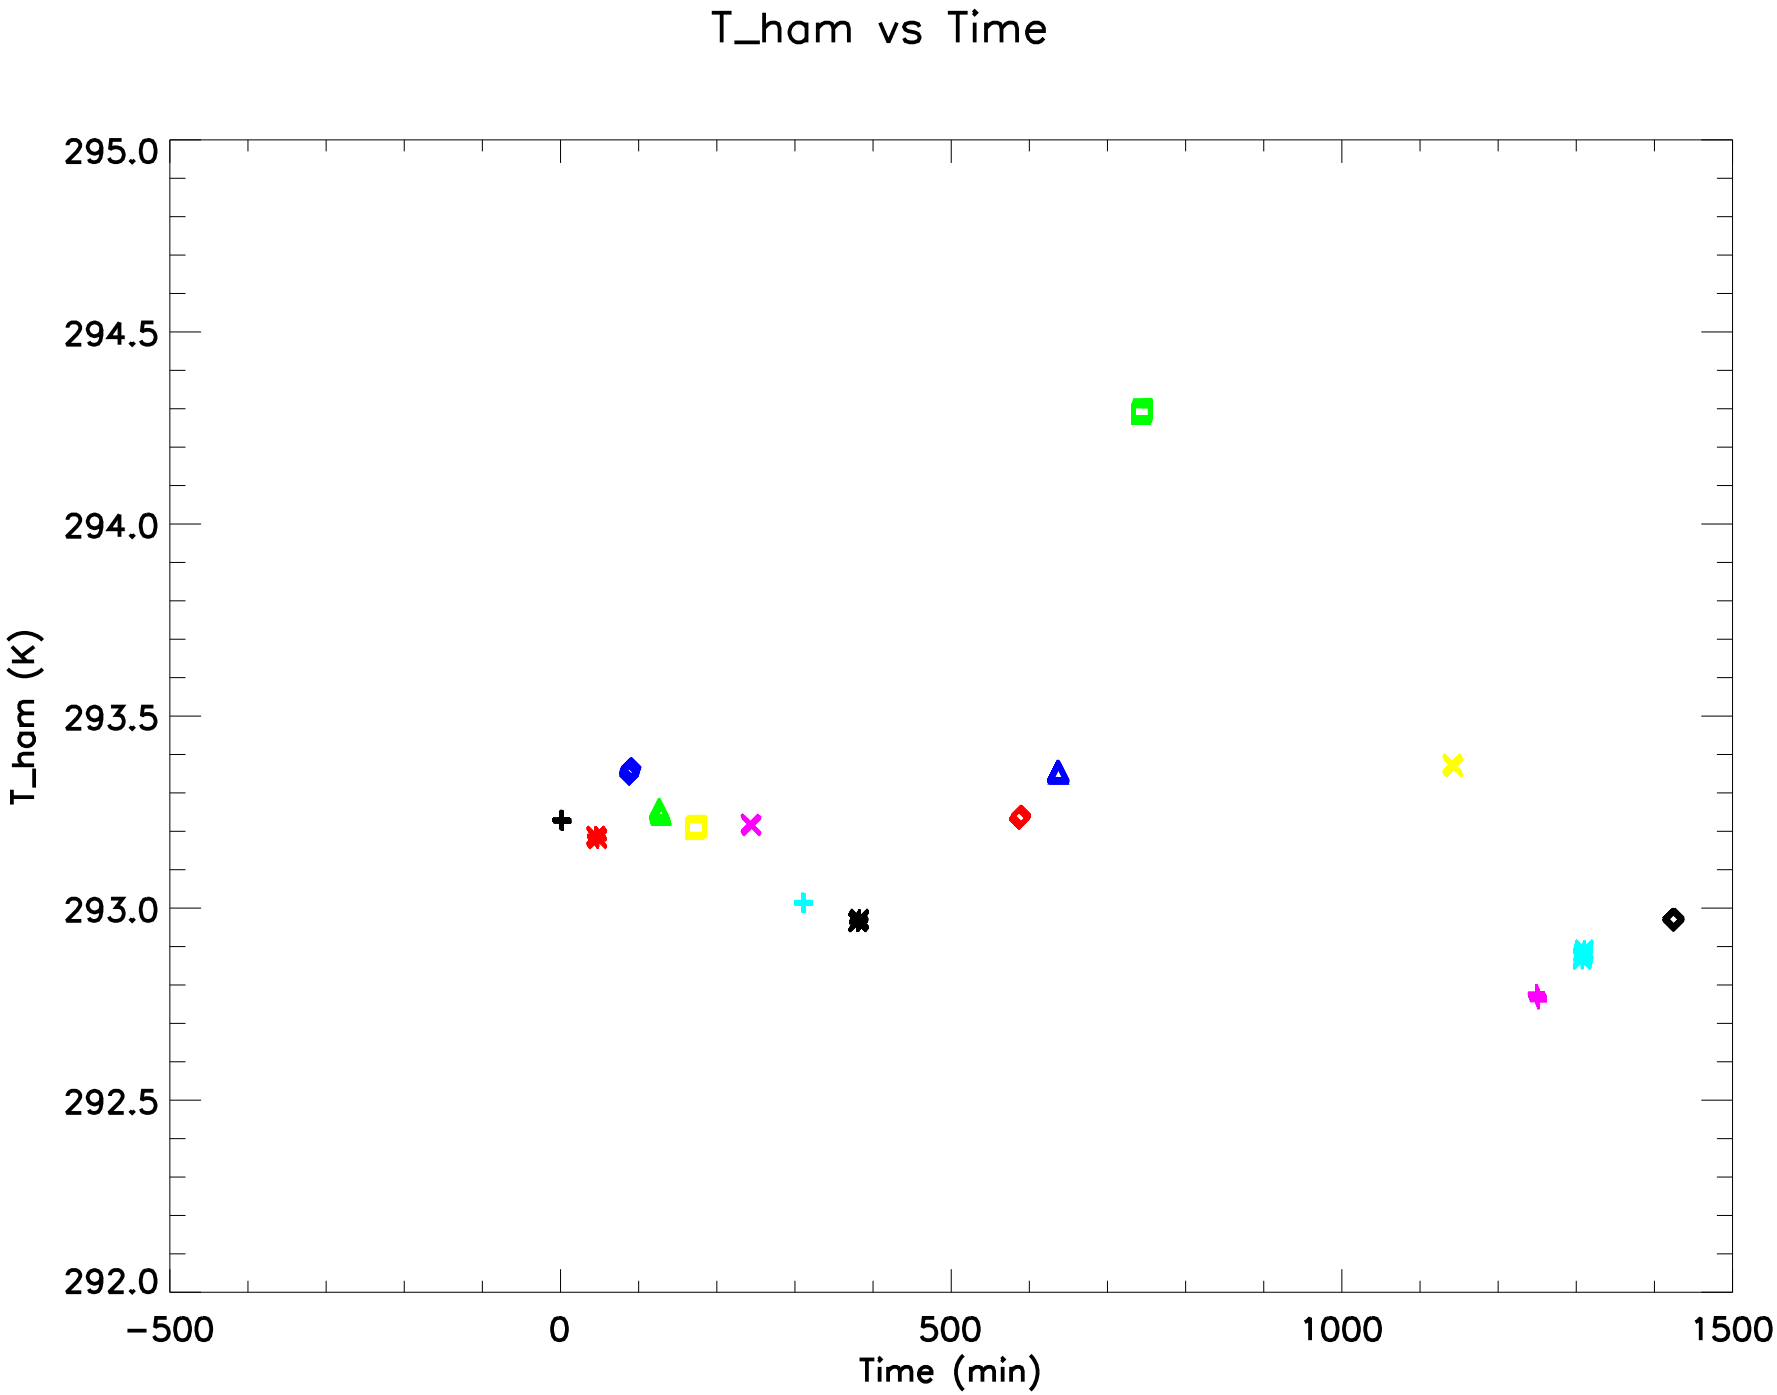
T_ham vs Time
295.0
294.5
294.0
293.5
293.0
292.5
292.0
T_ham (K)
−500
0
500
1000
1500
Time (min)

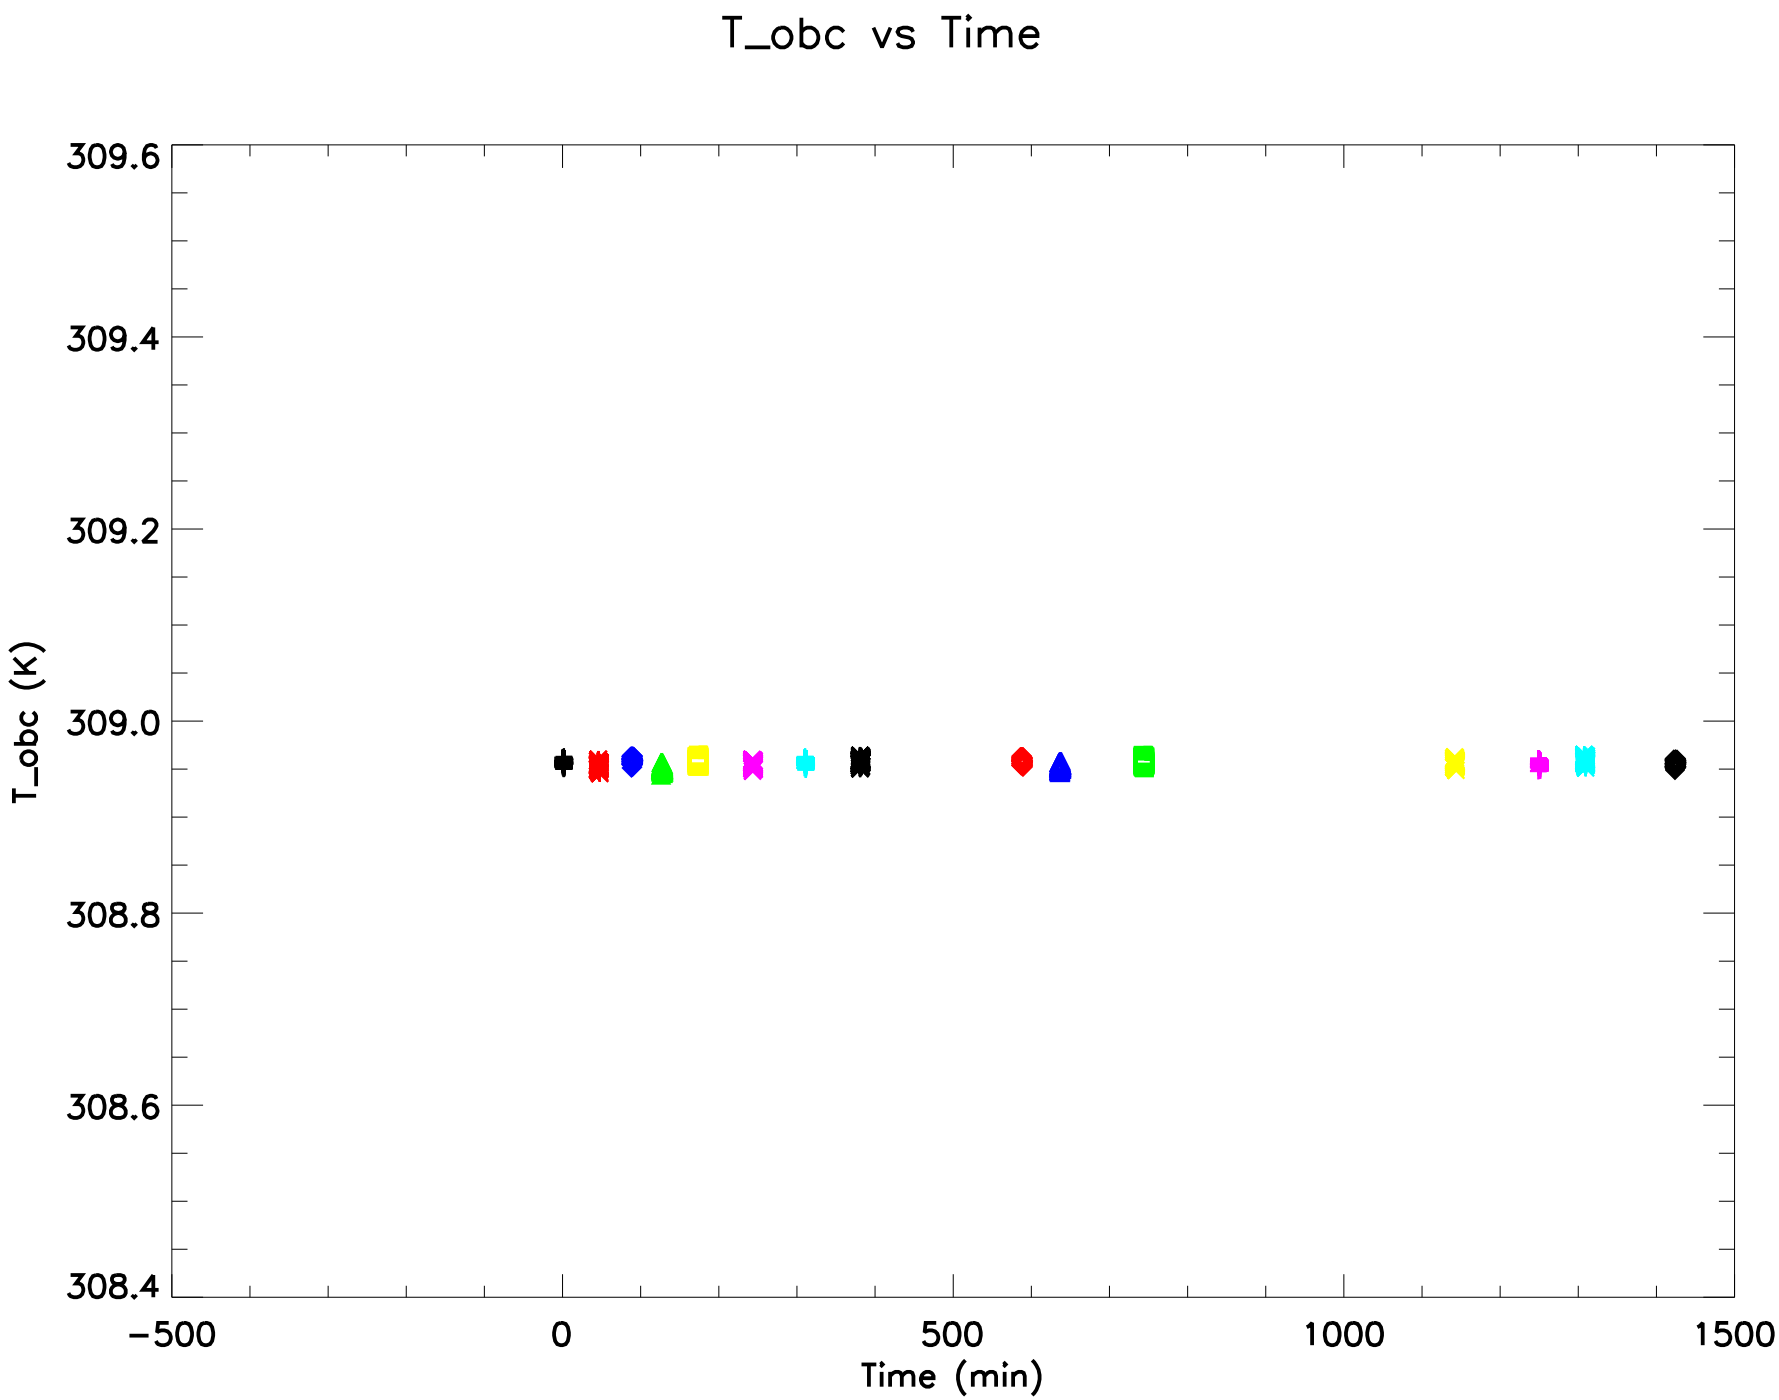
T_obc vs Time
309.6
309.4
309.2
309.0
308.8
308.6
308.4
T_obc (K)
−500
0
500
1000
1500
Time (min)

T_rta vs Scan

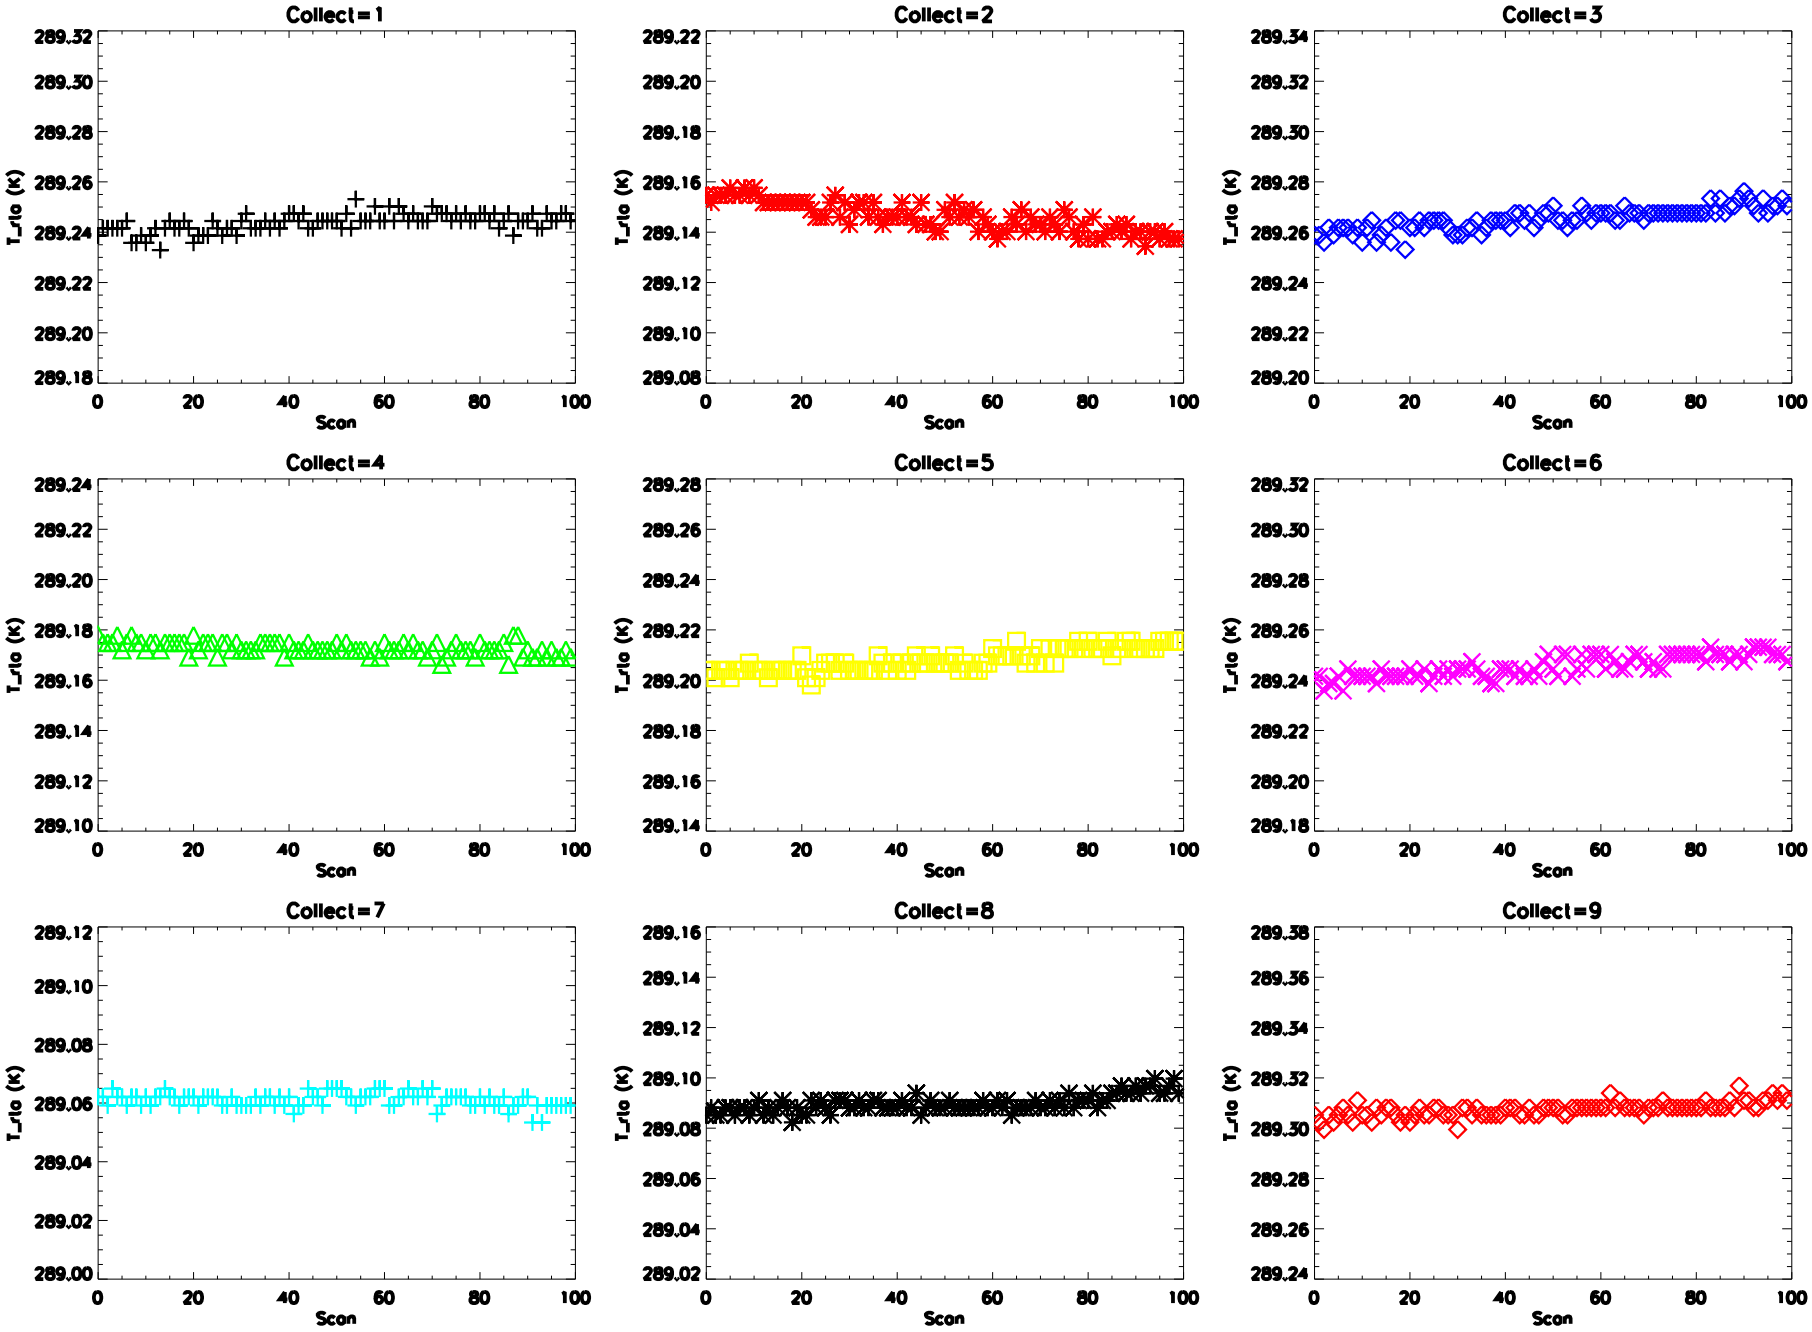
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
T_rta (K)
Scan

T_rta vs Scan

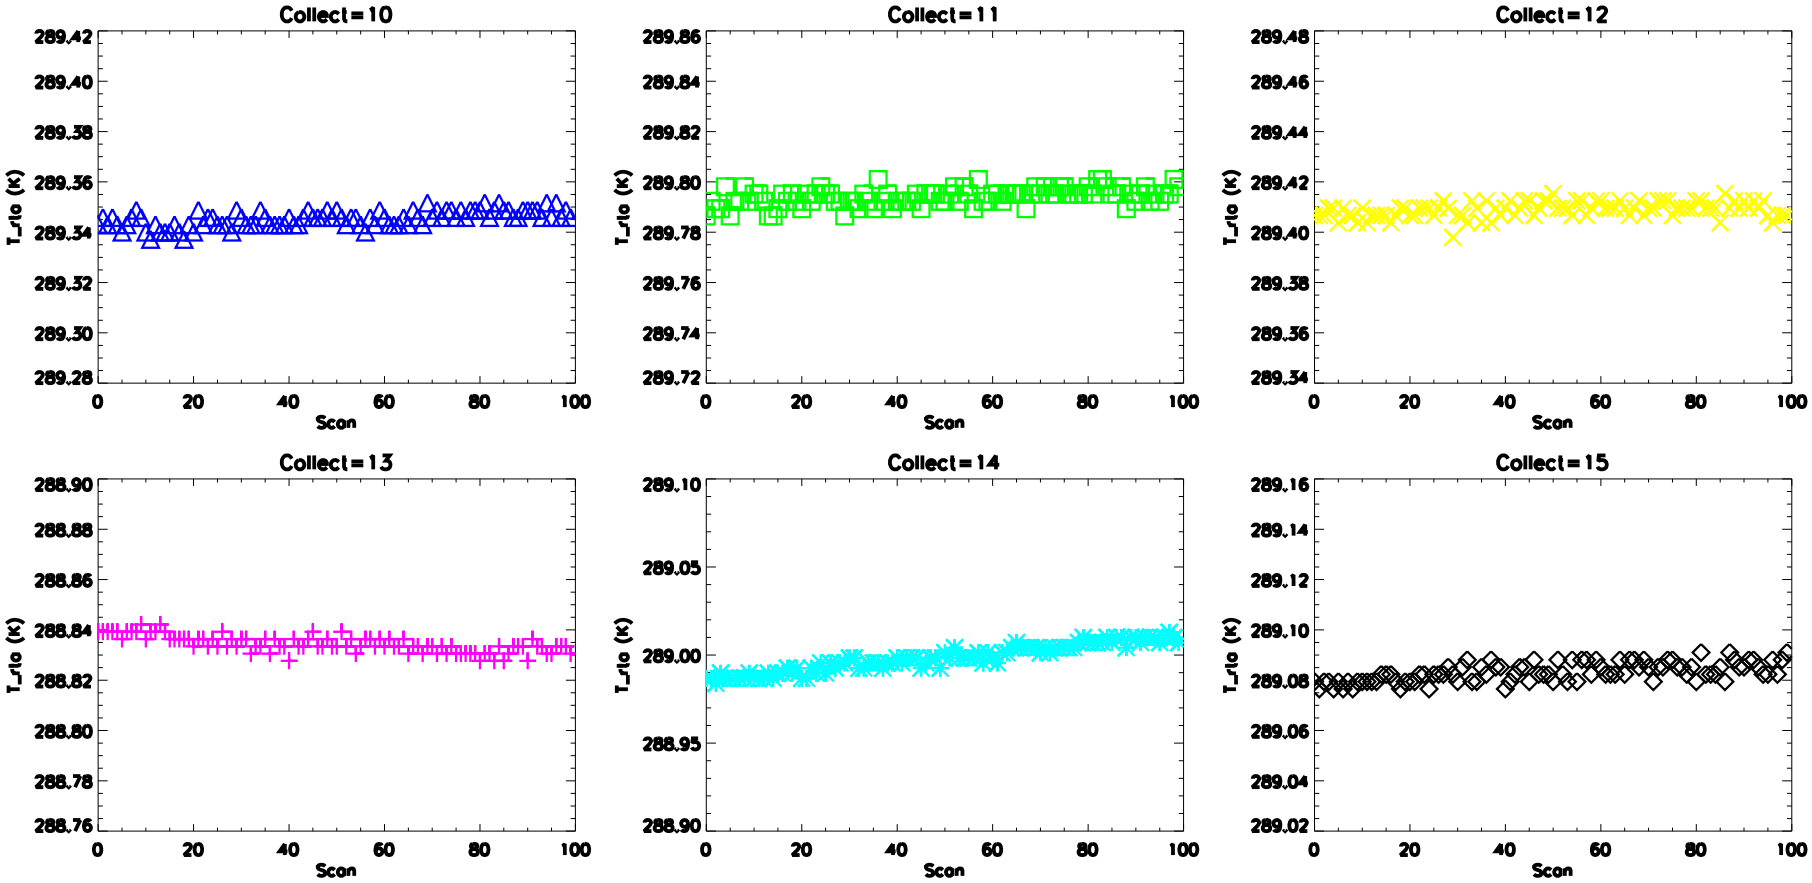
Collect = 10
T_rta (K)
289.42
289.40
289.38
289.36
289.34
289.32
289.30
289.28
0
20
40
60
80
100
Scan
Collect = 11
T_rta (K)
289.86
289.84
289.82
289.80
289.78
289.76
289.74
289.72
0
20
40
60
80
100
Scan
Collect = 12
T_rta (K)
289.48
289.46
289.44
289.42
289.40
289.38
289.36
289.34
0
20
40
60
80
100
Scan
Collect = 13
T_rta (K)
288.90
288.88
288.86
288.84
288.82
288.80
288.78
288.76
0
20
40
60
80
100
Scan
Collect = 14
T_rta (K)
289.10
289.05
289.00
288.95
288.90
0
20
40
60
80
100
Scan
Collect = 15
T_rta (K)
289.16
289.14
289.12
289.10
289.08
289.06
289.04
289.02
0
20
40
60
80
100
Scan

T_cav vs Scan

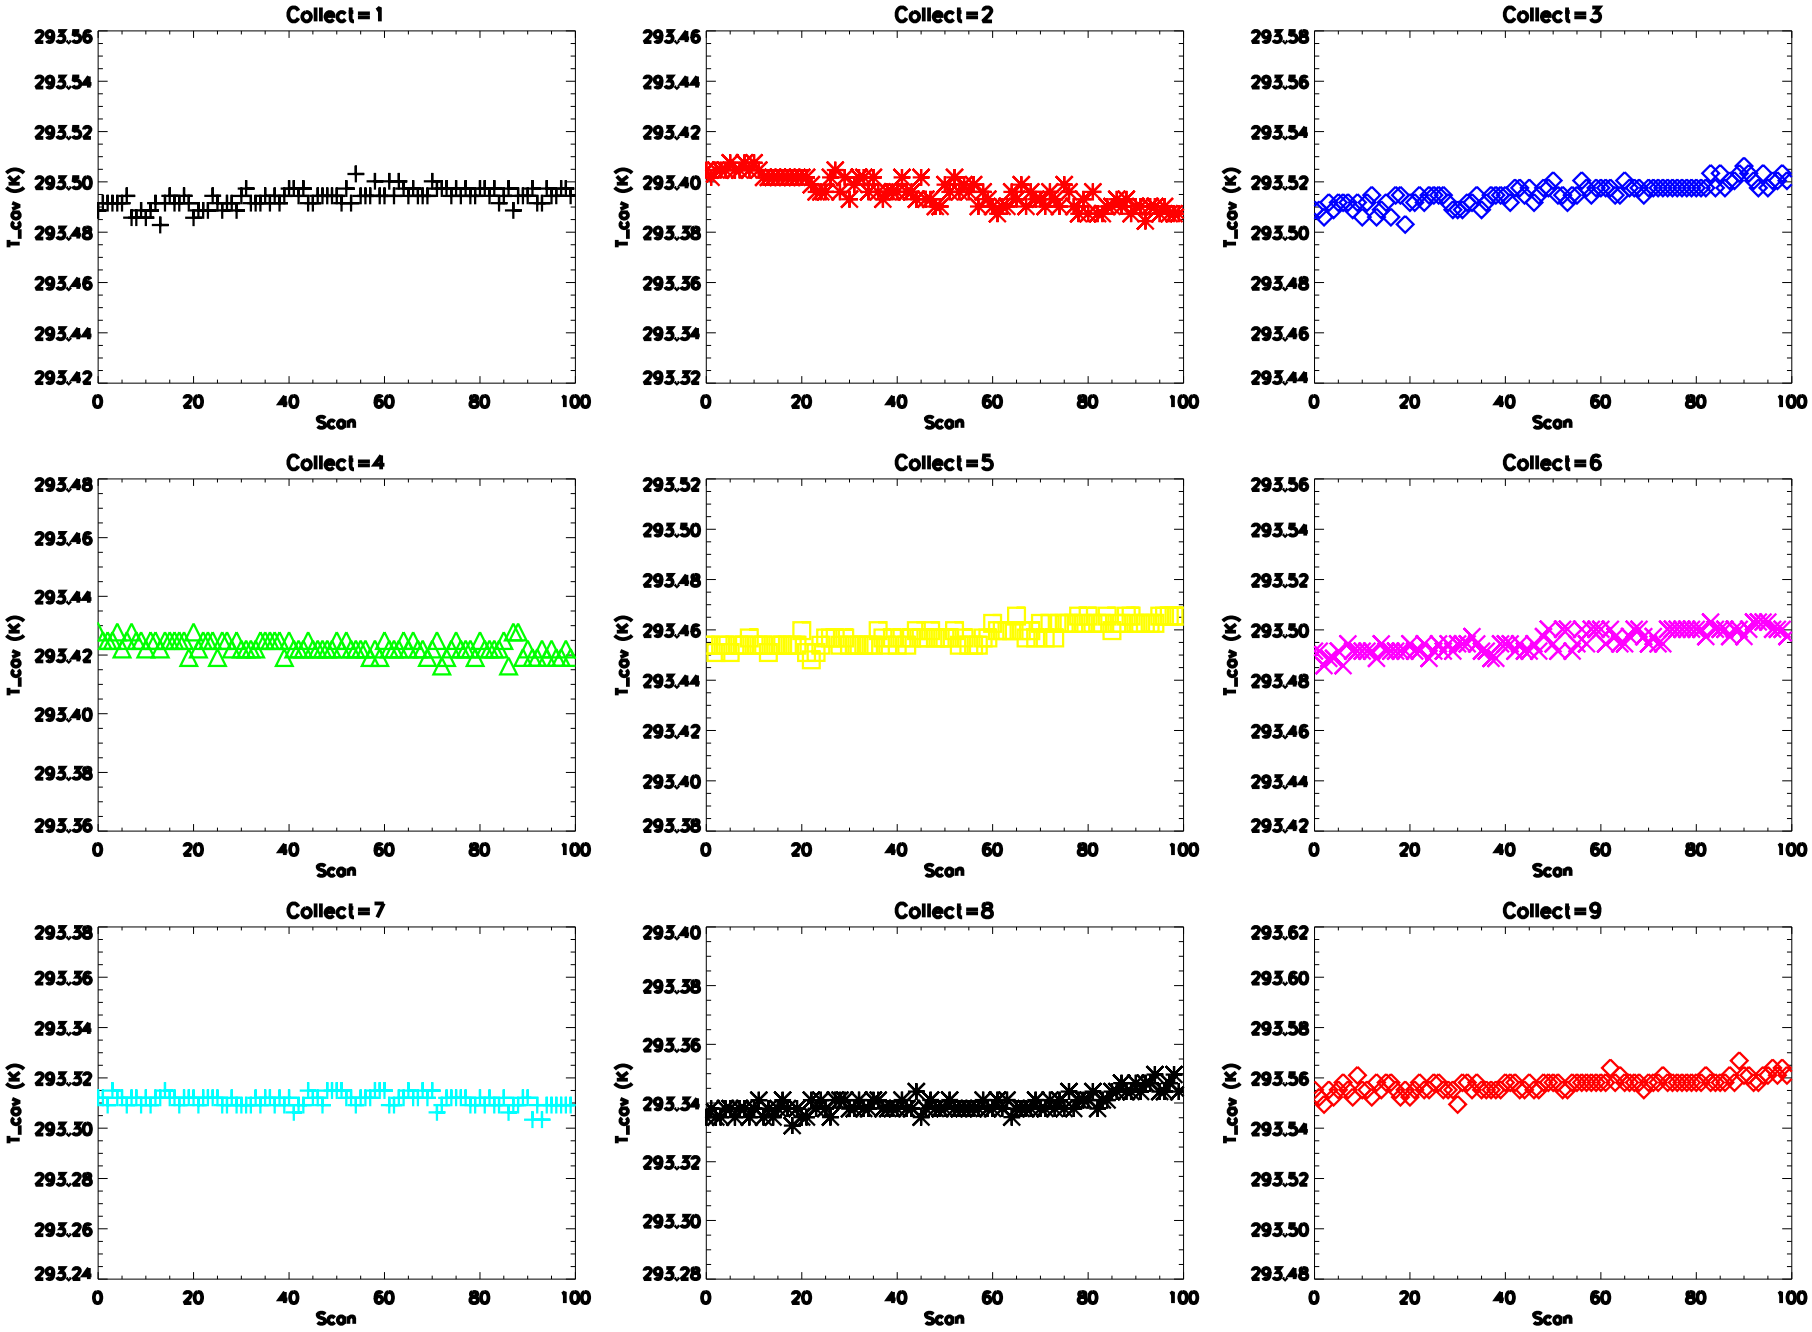
Collect=1
293.56
293.54
293.52
293.50
293.48
293.46
293.44
293.42
T_cav (K)
0
20
40
60
80
100
Scan
Collect=2
293.46
293.44
293.42
293.40
293.38
293.36
293.34
293.32
T_cav (K)
0
20
40
60
80
100
Scan
Collect=3
293.58
293.56
293.54
293.52
293.50
293.48
293.46
293.44
T_cav (K)
0
20
40
60
80
100
Scan
Collect=4
293.48
293.46
293.44
293.42
293.40
293.38
293.36
T_cav (K)
0
20
40
60
80
100
Scan
Collect=5
293.52
293.50
293.48
293.46
293.44
293.42
293.40
293.38
T_cav (K)
0
20
40
60
80
100
Scan
Collect=6
293.56
293.54
293.52
293.50
293.48
293.46
293.44
293.42
T_cav (K)
0
20
40
60
80
100
Scan
Collect=7
293.38
293.36
293.34
293.32
293.30
293.28
293.26
293.24
T_cav (K)
0
20
40
60
80
100
Scan
Collect=8
293.40
293.38
293.36
293.34
293.32
293.30
293.28
T_cav (K)
0
20
40
60
80
100
Scan
Collect=9
293.62
293.60
293.58
293.56
293.54
293.52
293.50
293.48
T_cav (K)
0
20
40
60
80
100
Scan

T_cav vs Scan

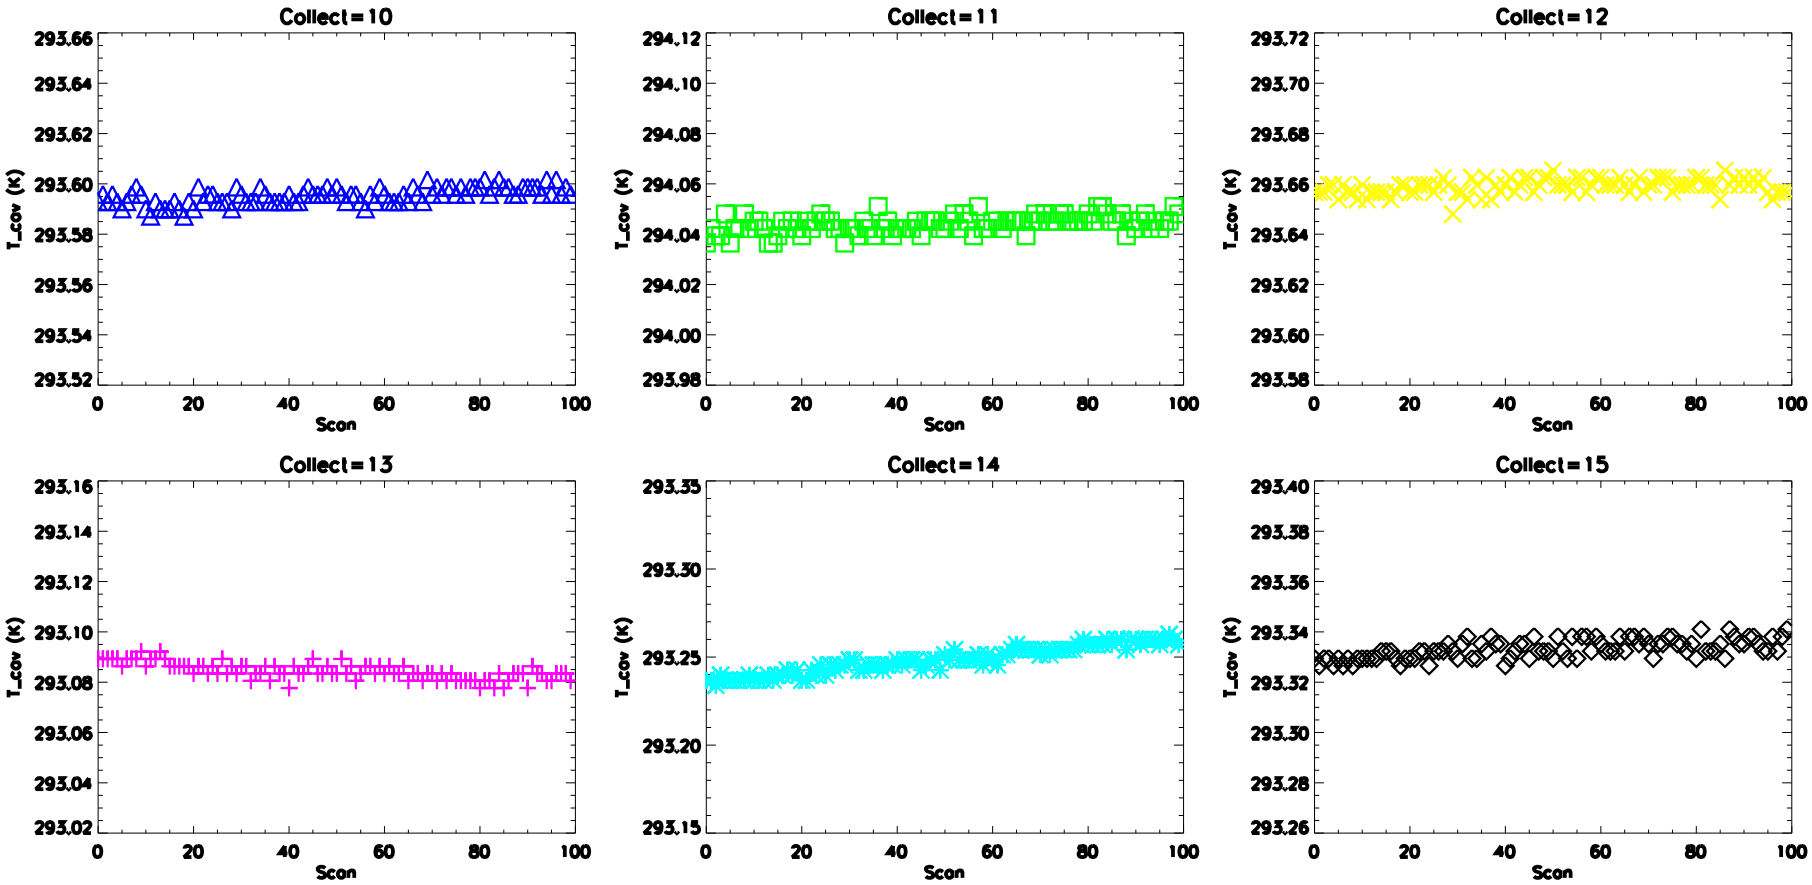
Collect = 10
T_cav (K)
293.66
293.64
293.62
293.60
293.58
293.56
293.54
293.52
0
20
40
60
80
100
Scan
Collect = 11
T_cav (K)
294.12
294.10
294.08
294.06
294.04
294.02
294.00
293.98
0
20
40
60
80
100
Scan
Collect = 12
T_cav (K)
293.72
293.70
293.68
293.66
293.64
293.62
293.60
293.58
0
20
40
60
80
100
Scan
Collect = 13
T_cav (K)
293.16
293.14
293.12
293.10
293.08
293.06
293.04
293.02
0
20
40
60
80
100
Scan
Collect = 14
T_cav (K)
293.35
293.30
293.25
293.20
293.15
0
20
40
60
80
100
Scan
Collect = 15
T_cav (K)
293.40
293.38
293.36
293.34
293.32
293.30
293.28
293.26
0
20
40
60
80
100
Scan

T_sh vs Scan

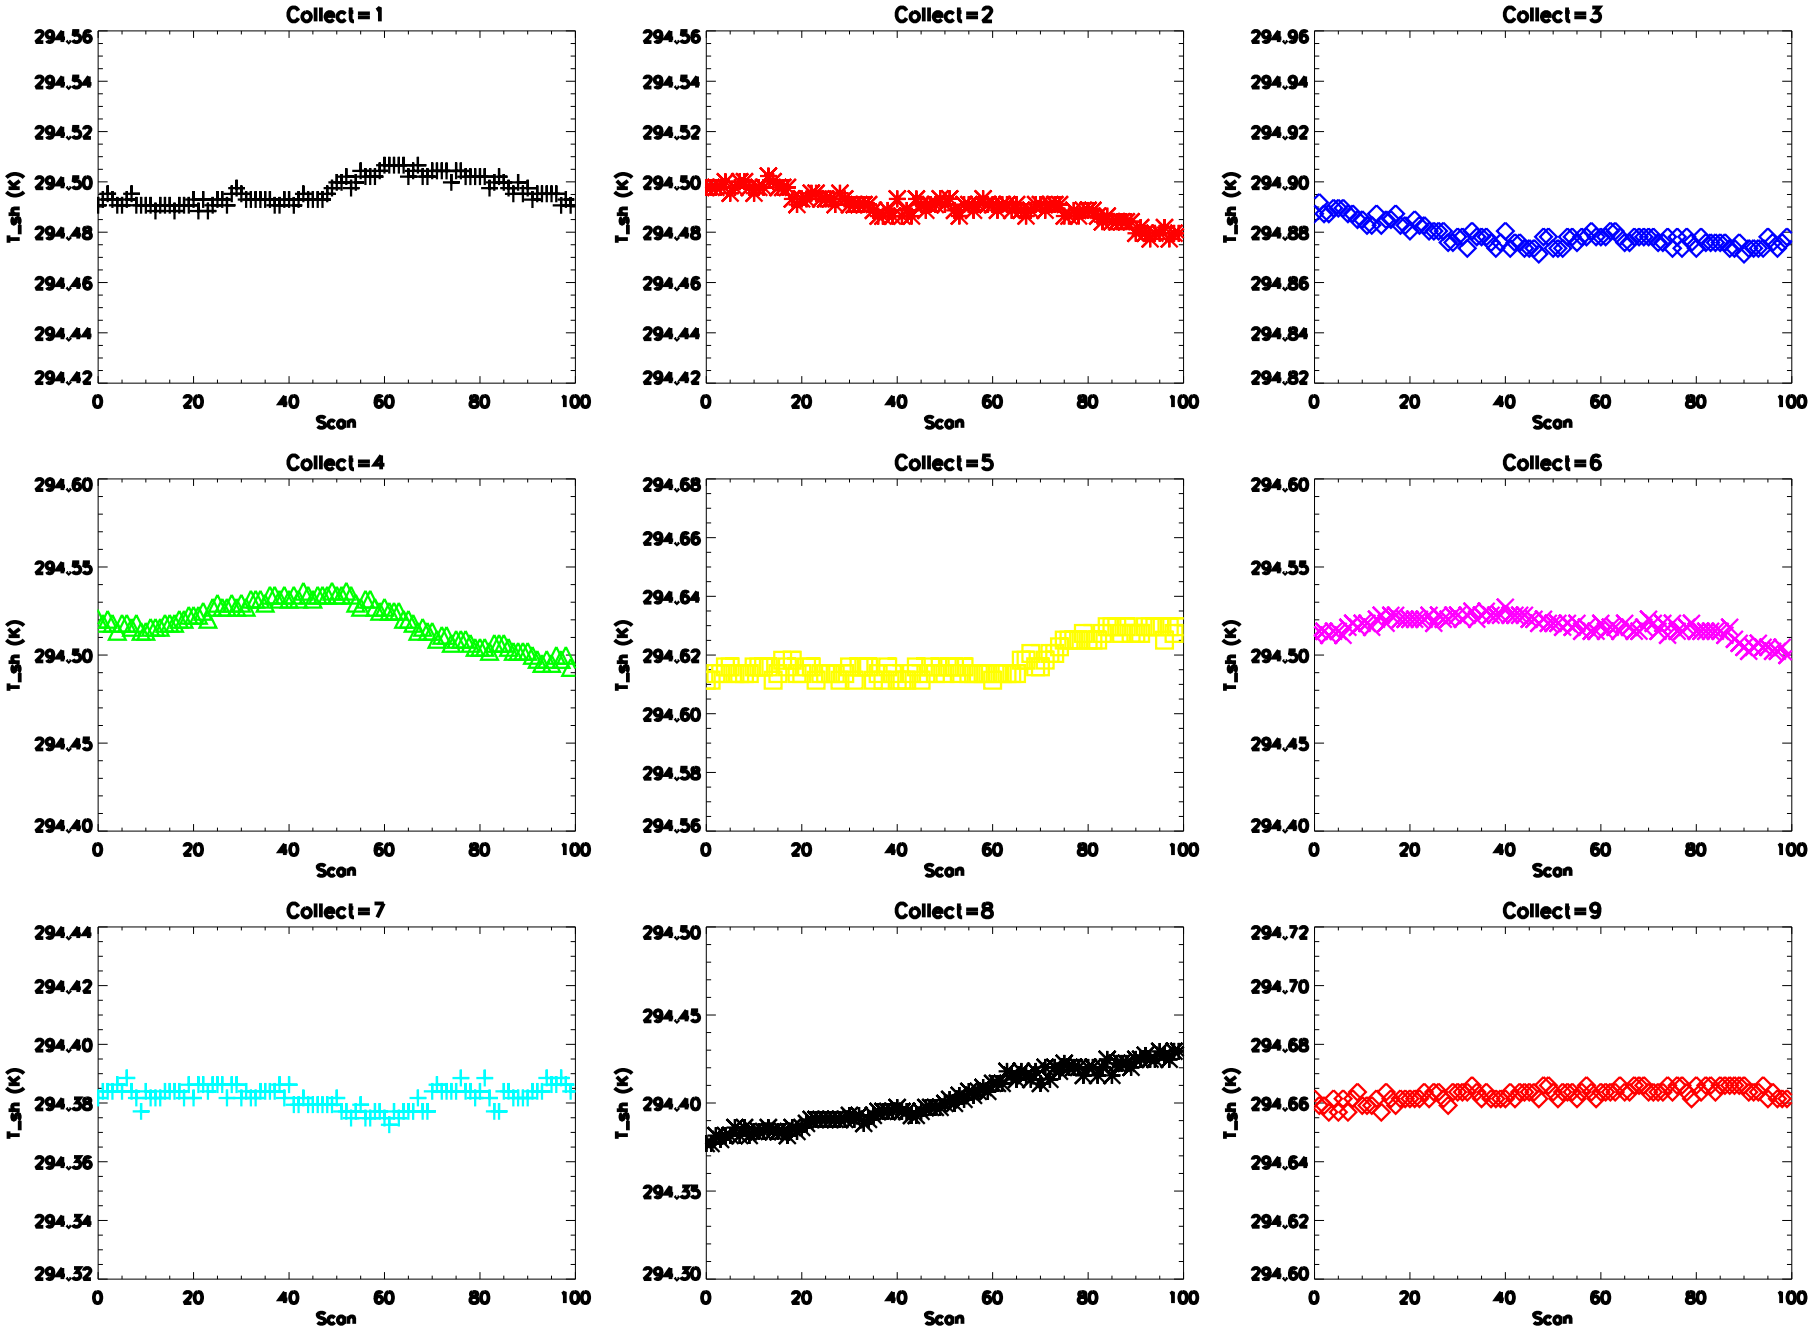
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
T_sh (K)
Scan

T_sh vs Scan

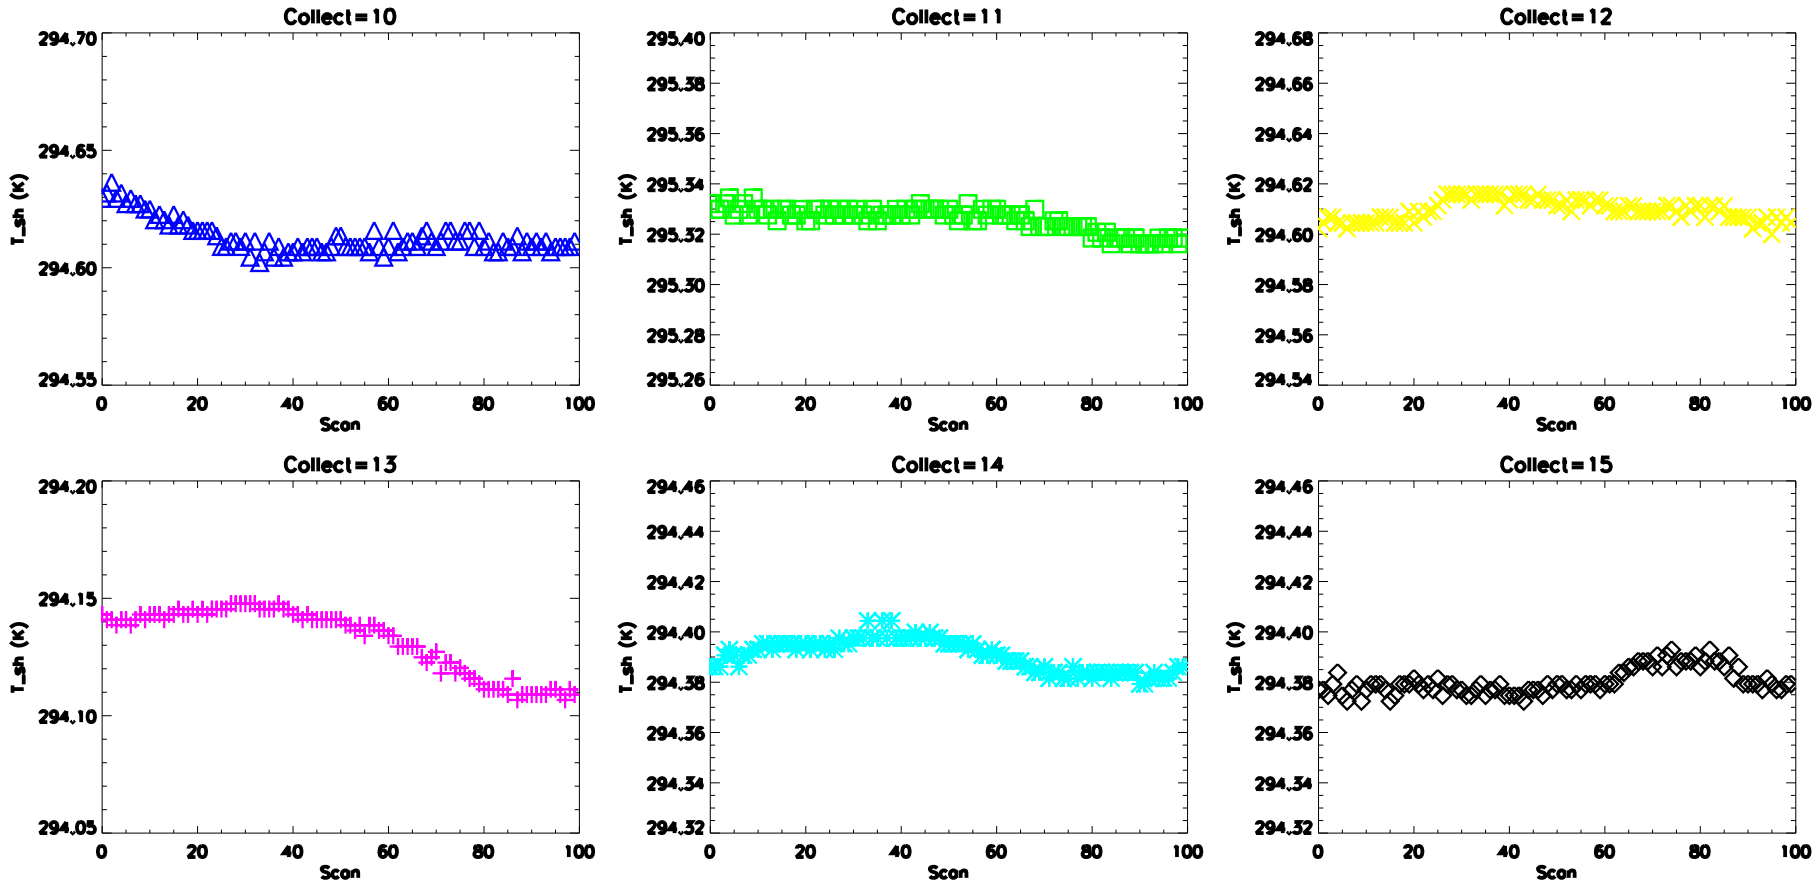
Collect = 10
T_sh (K)
294.70
294.65
294.60
294.55
0
20
40
60
80
100
Scan
Collect = 11
T_sh (K)
295.40
295.38
295.36
295.34
295.32
295.30
295.28
295.26
0
20
40
60
80
100
Scan
Collect = 12
T_sh (K)
294.68
294.66
294.64
294.62
294.60
294.58
294.56
294.54
0
20
40
60
80
100
Scan
Collect = 13
T_sh (K)
294.20
294.15
294.10
294.05
0
20
40
60
80
100
Scan
Collect = 14
T_sh (K)
294.46
294.44
294.42
294.40
294.38
294.36
294.34
294.32
0
20
40
60
80
100
Scan
Collect = 15
T_sh (K)
294.46
294.44
294.42
294.40
294.38
294.36
294.34
294.32
0
20
40
60
80
100
Scan

T_ham vs Scan

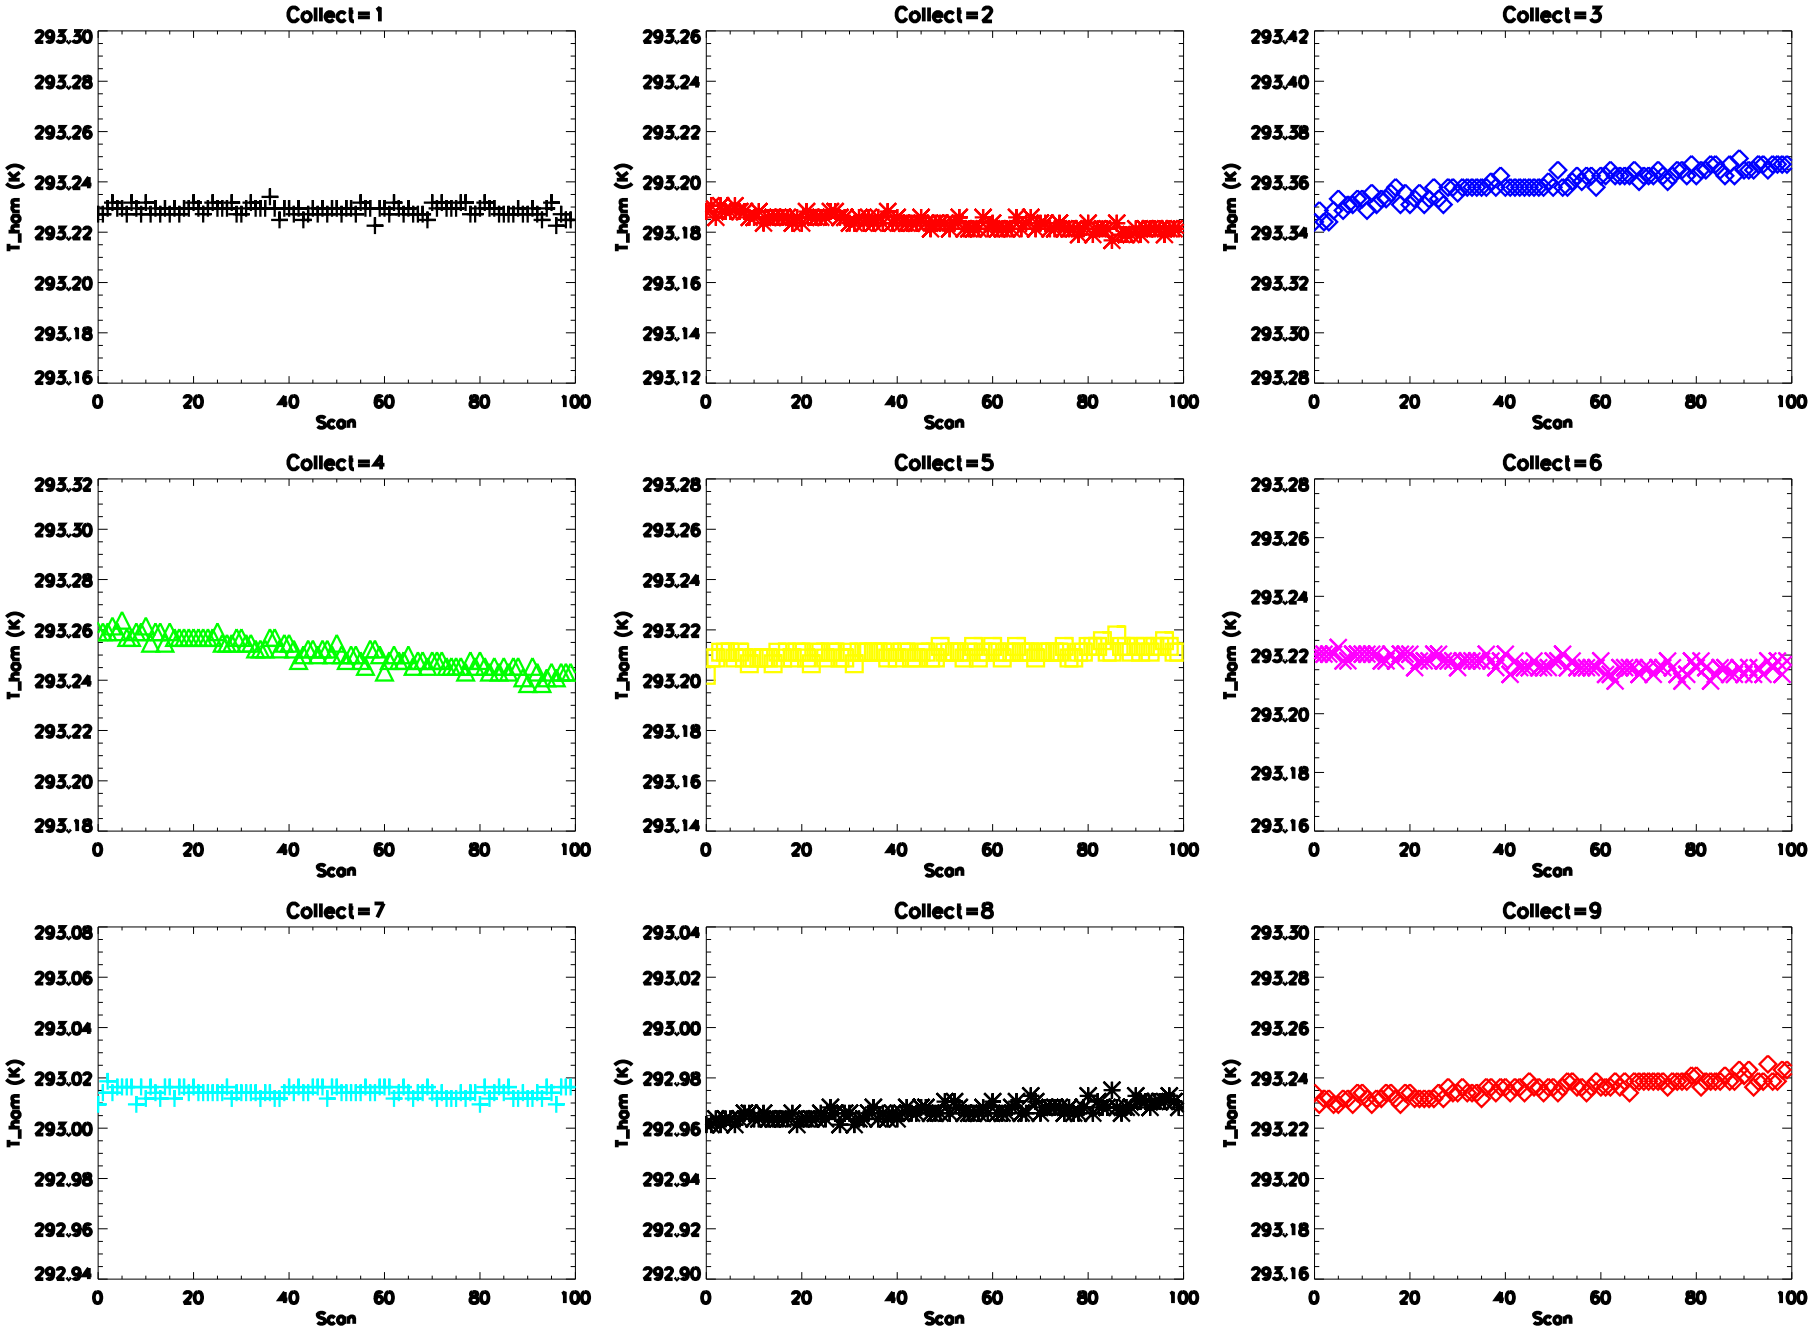
Collect=1
293.30
293.28
293.26
293.24
293.22
293.20
293.18
293.16
T_ham (K)
0
20
40
60
80
100
Scan
Collect=2
293.26
293.24
293.22
293.20
293.18
293.16
293.14
293.12
T_ham (K)
0
20
40
60
80
100
Scan
Collect=3
293.42
293.40
293.38
293.36
293.34
293.32
293.30
293.28
T_ham (K)
0
20
40
60
80
100
Scan
Collect=4
293.32
293.30
293.28
293.26
293.24
293.22
293.20
293.18
T_ham (K)
0
20
40
60
80
100
Scan
Collect=5
293.28
293.26
293.24
293.22
293.20
293.18
293.16
293.14
T_ham (K)
0
20
40
60
80
100
Scan
Collect=6
293.28
293.26
293.24
293.22
293.20
293.18
293.16
T_ham (K)
0
20
40
60
80
100
Scan
Collect=7
293.08
293.06
293.04
293.02
293.00
292.98
292.96
292.94
T_ham (K)
0
20
40
60
80
100
Scan
Collect=8
293.04
293.02
293.00
292.98
292.96
292.94
292.92
292.90
T_ham (K)
0
20
40
60
80
100
Scan
Collect=9
293.30
293.28
293.26
293.24
293.22
293.20
293.18
293.16
T_ham (K)
0
20
40
60
80
100
Scan

T_ham vs Scan

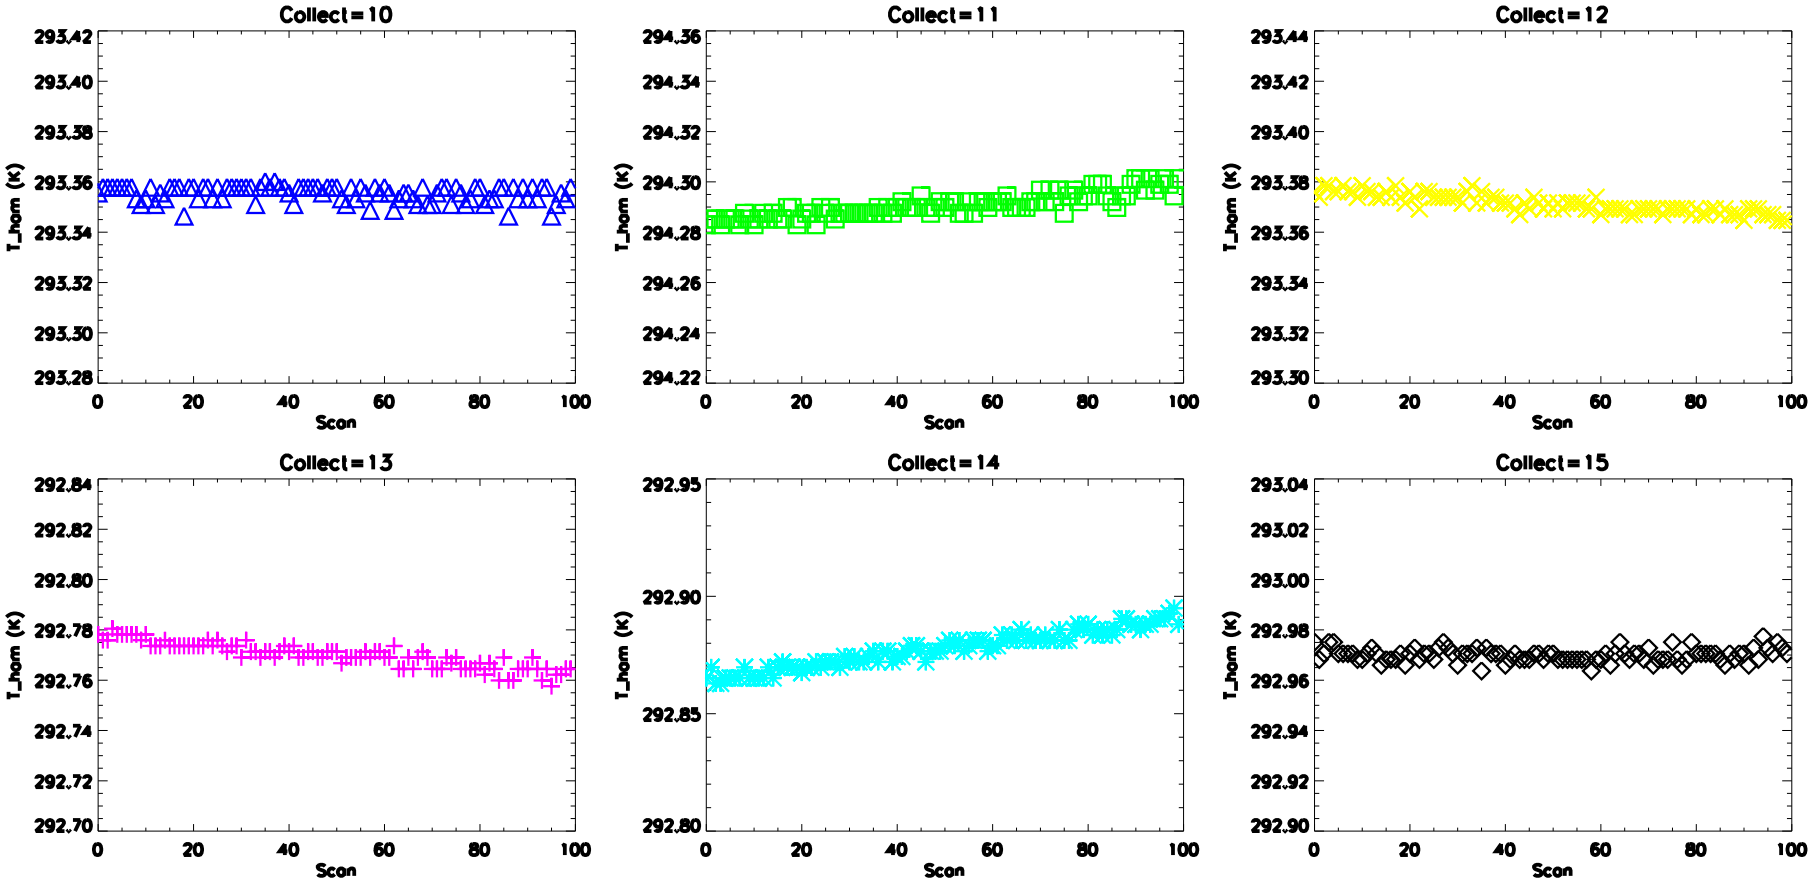
Collect = 10
T_ham (K)
293.42
293.40
293.38
293.36
293.34
293.32
293.30
293.28
0
20
40
60
80
100
Scan
Collect = 11
T_ham (K)
294.36
294.34
294.32
294.30
294.28
294.26
294.24
294.22
0
20
40
60
80
100
Scan
Collect = 12
T_ham (K)
293.44
293.42
293.40
293.38
293.36
293.34
293.32
293.30
0
20
40
60
80
100
Scan
Collect = 13
T_ham (K)
292.84
292.82
292.80
292.78
292.76
292.74
292.72
292.70
0
20
40
60
80
100
Scan
Collect = 14
T_ham (K)
292.95
292.90
292.85
292.80
0
20
40
60
80
100
Scan
Collect = 15
T_ham (K)
293.04
293.02
293.00
292.98
292.96
292.94
292.92
292.90
0
20
40
60
80
100
Scan

T_obc vs Scan

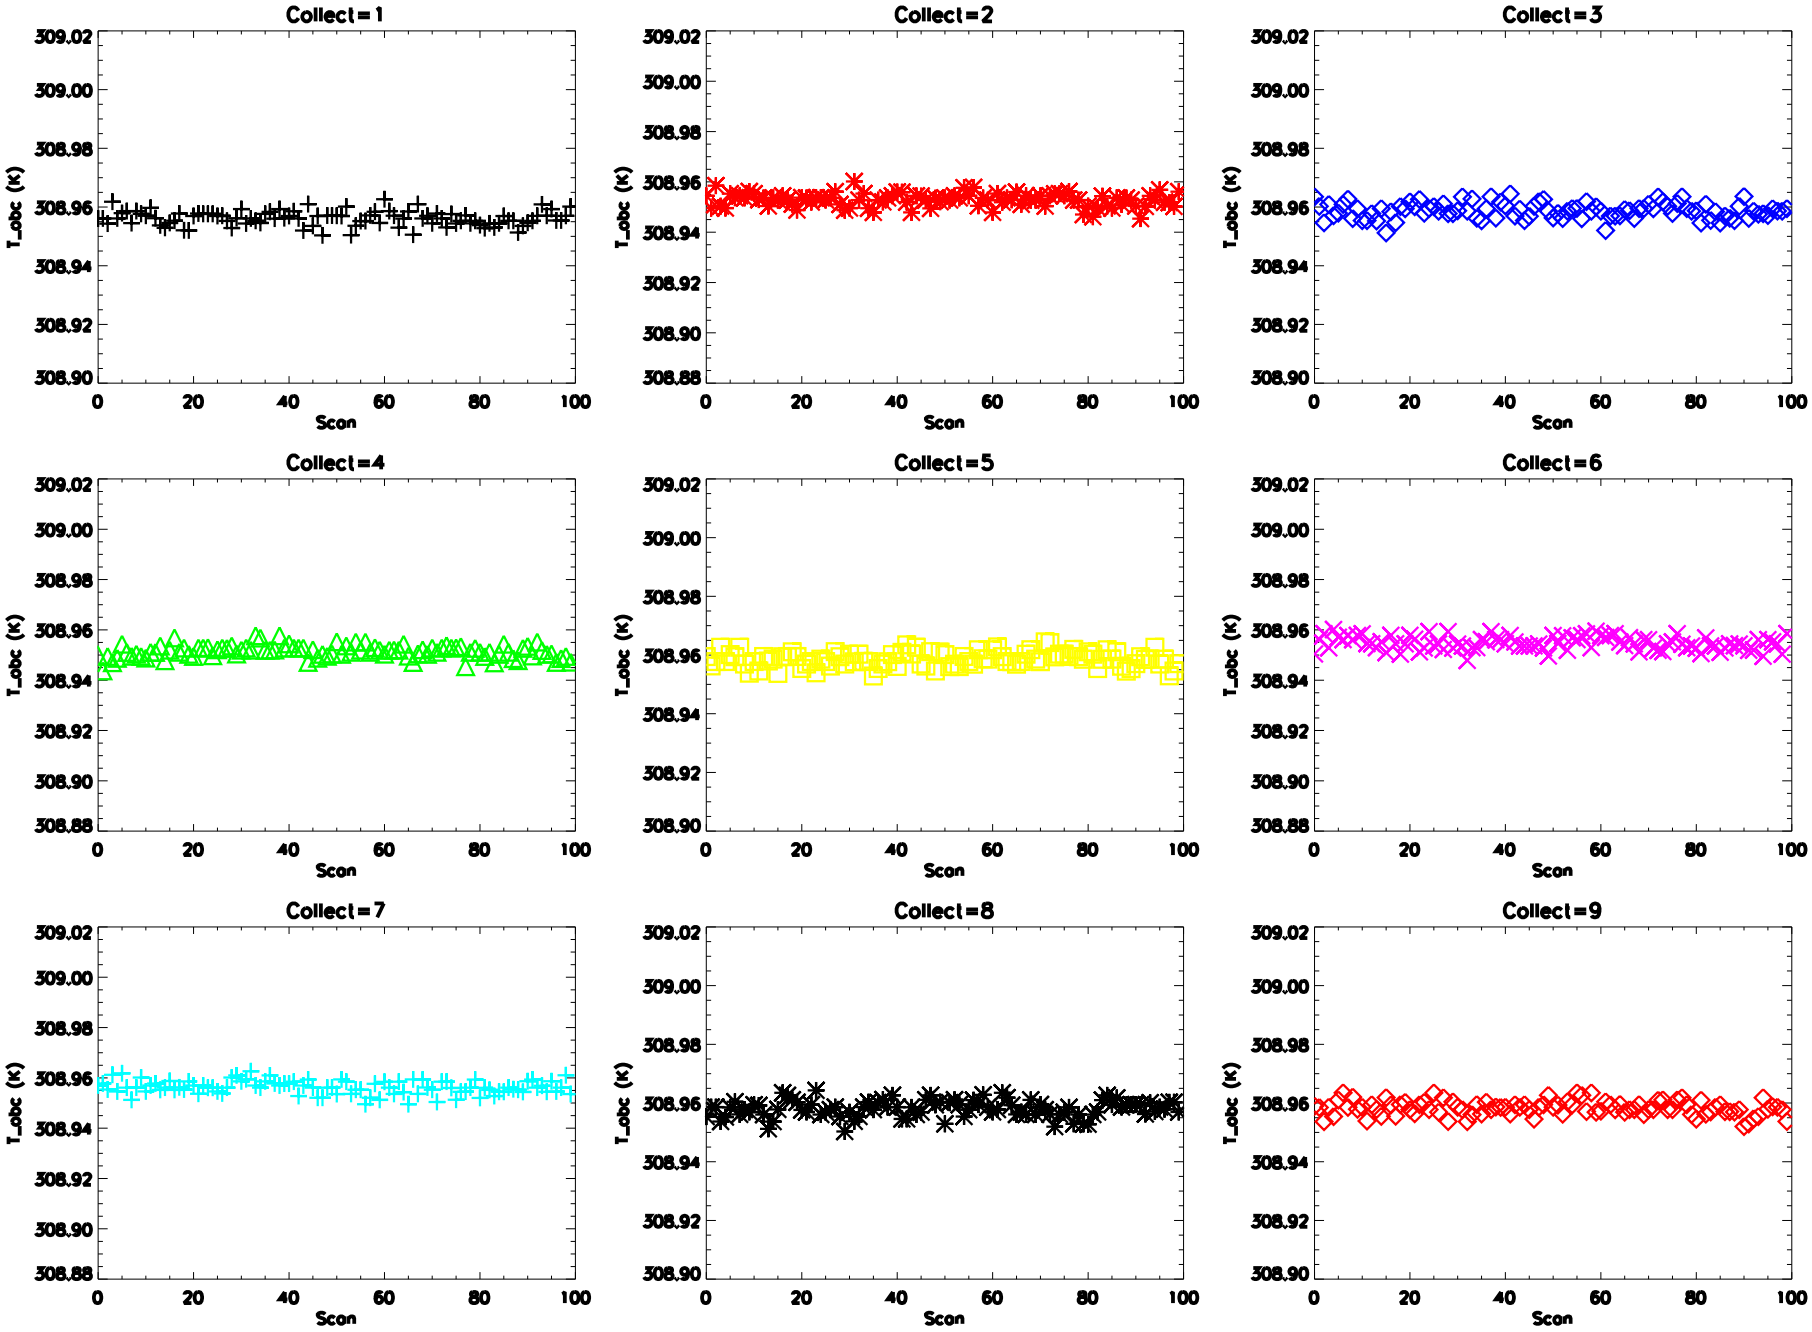
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
T_obc (K)
Scan
309.02
309.00
308.98
308.96
308.94
308.92
308.90
308.88
0
20
40
60
80
100

T_obc vs Scan

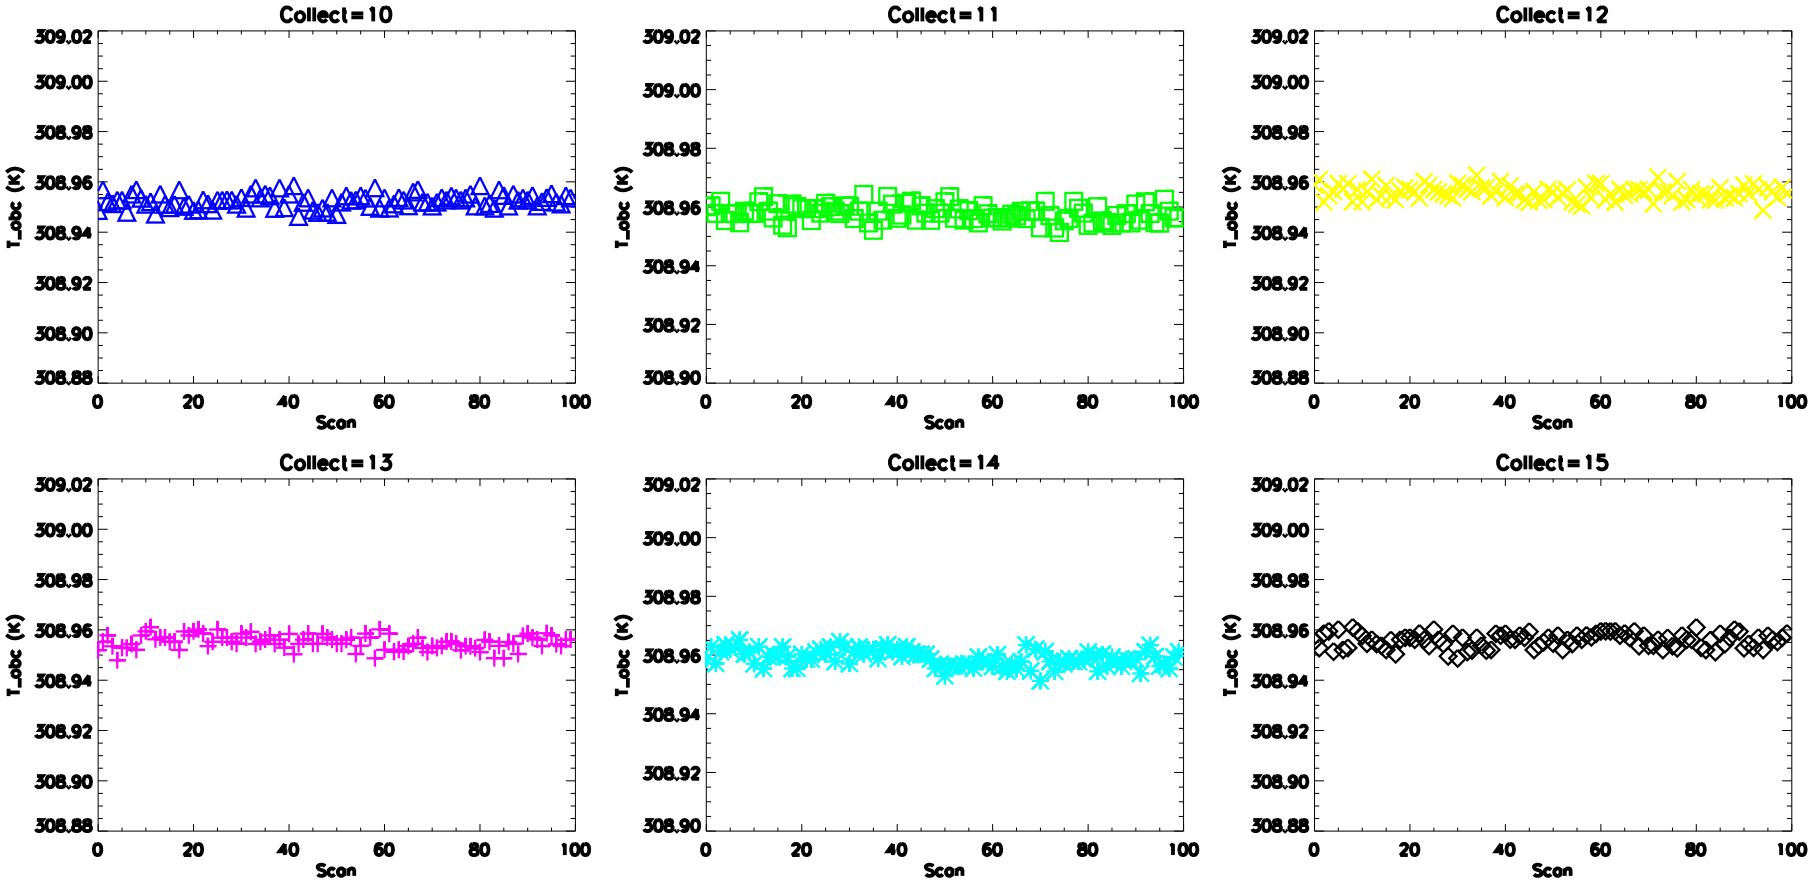
Collect = 10
Collect = 11
Collect = 12
Collect = 13
Collect = 14
Collect = 15
T_obc (K)
Scan
309.02
309.00
308.98
308.96
308.94
308.92
308.90
308.88
0
20
40
60
80
100

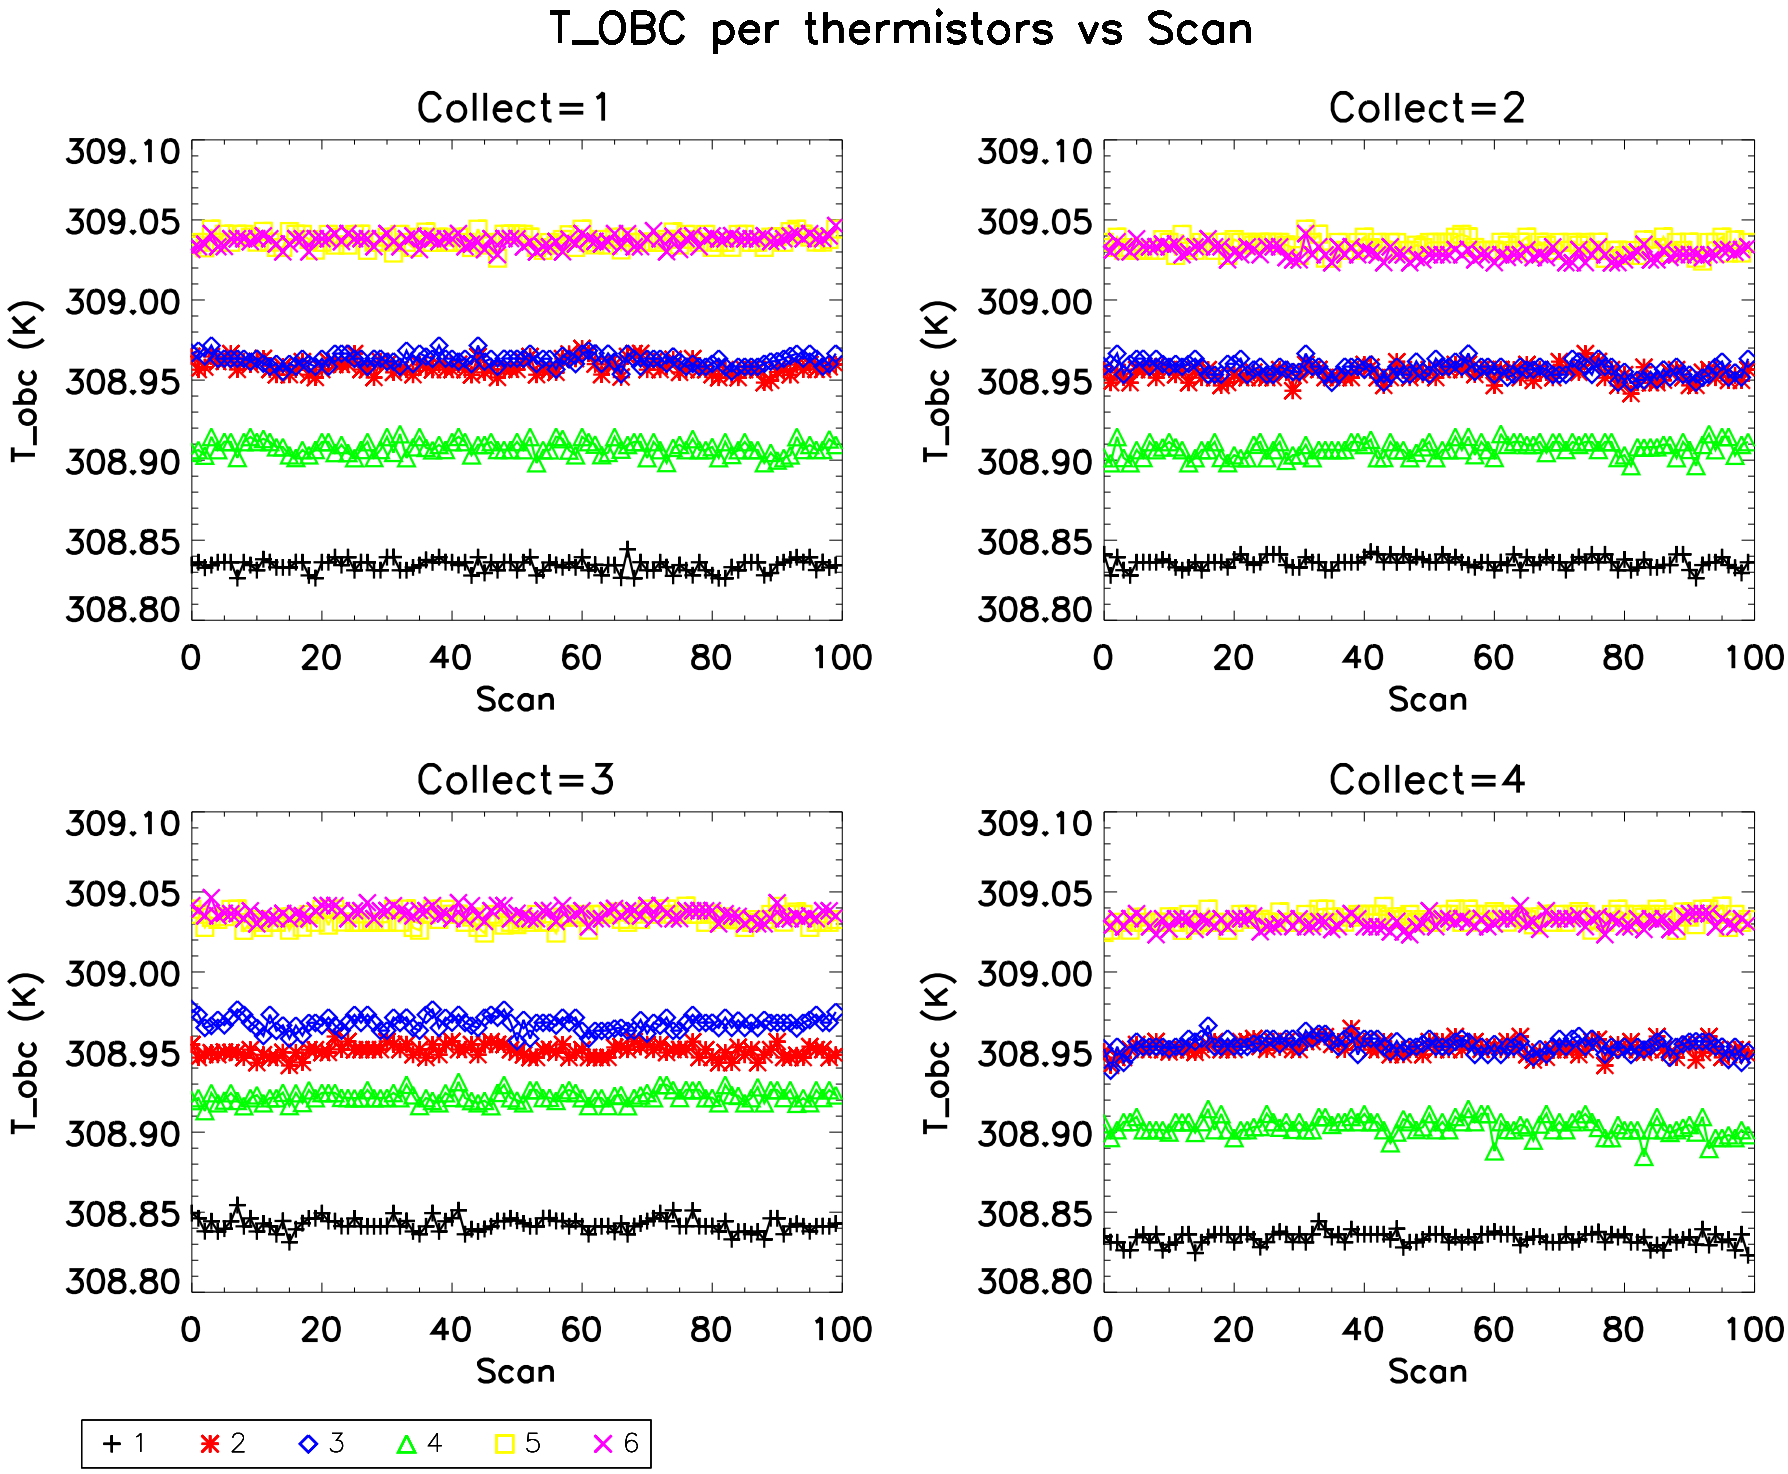
T_OBC per thermistors vs Scan
Collect=1
Collect=2
Collect=3
Collect=4
T_obc (K)
Scan
309.10
309.05
309.00
308.95
308.90
308.85
308.80
0
20
40
60
80
100
1
2
3
4
5
6

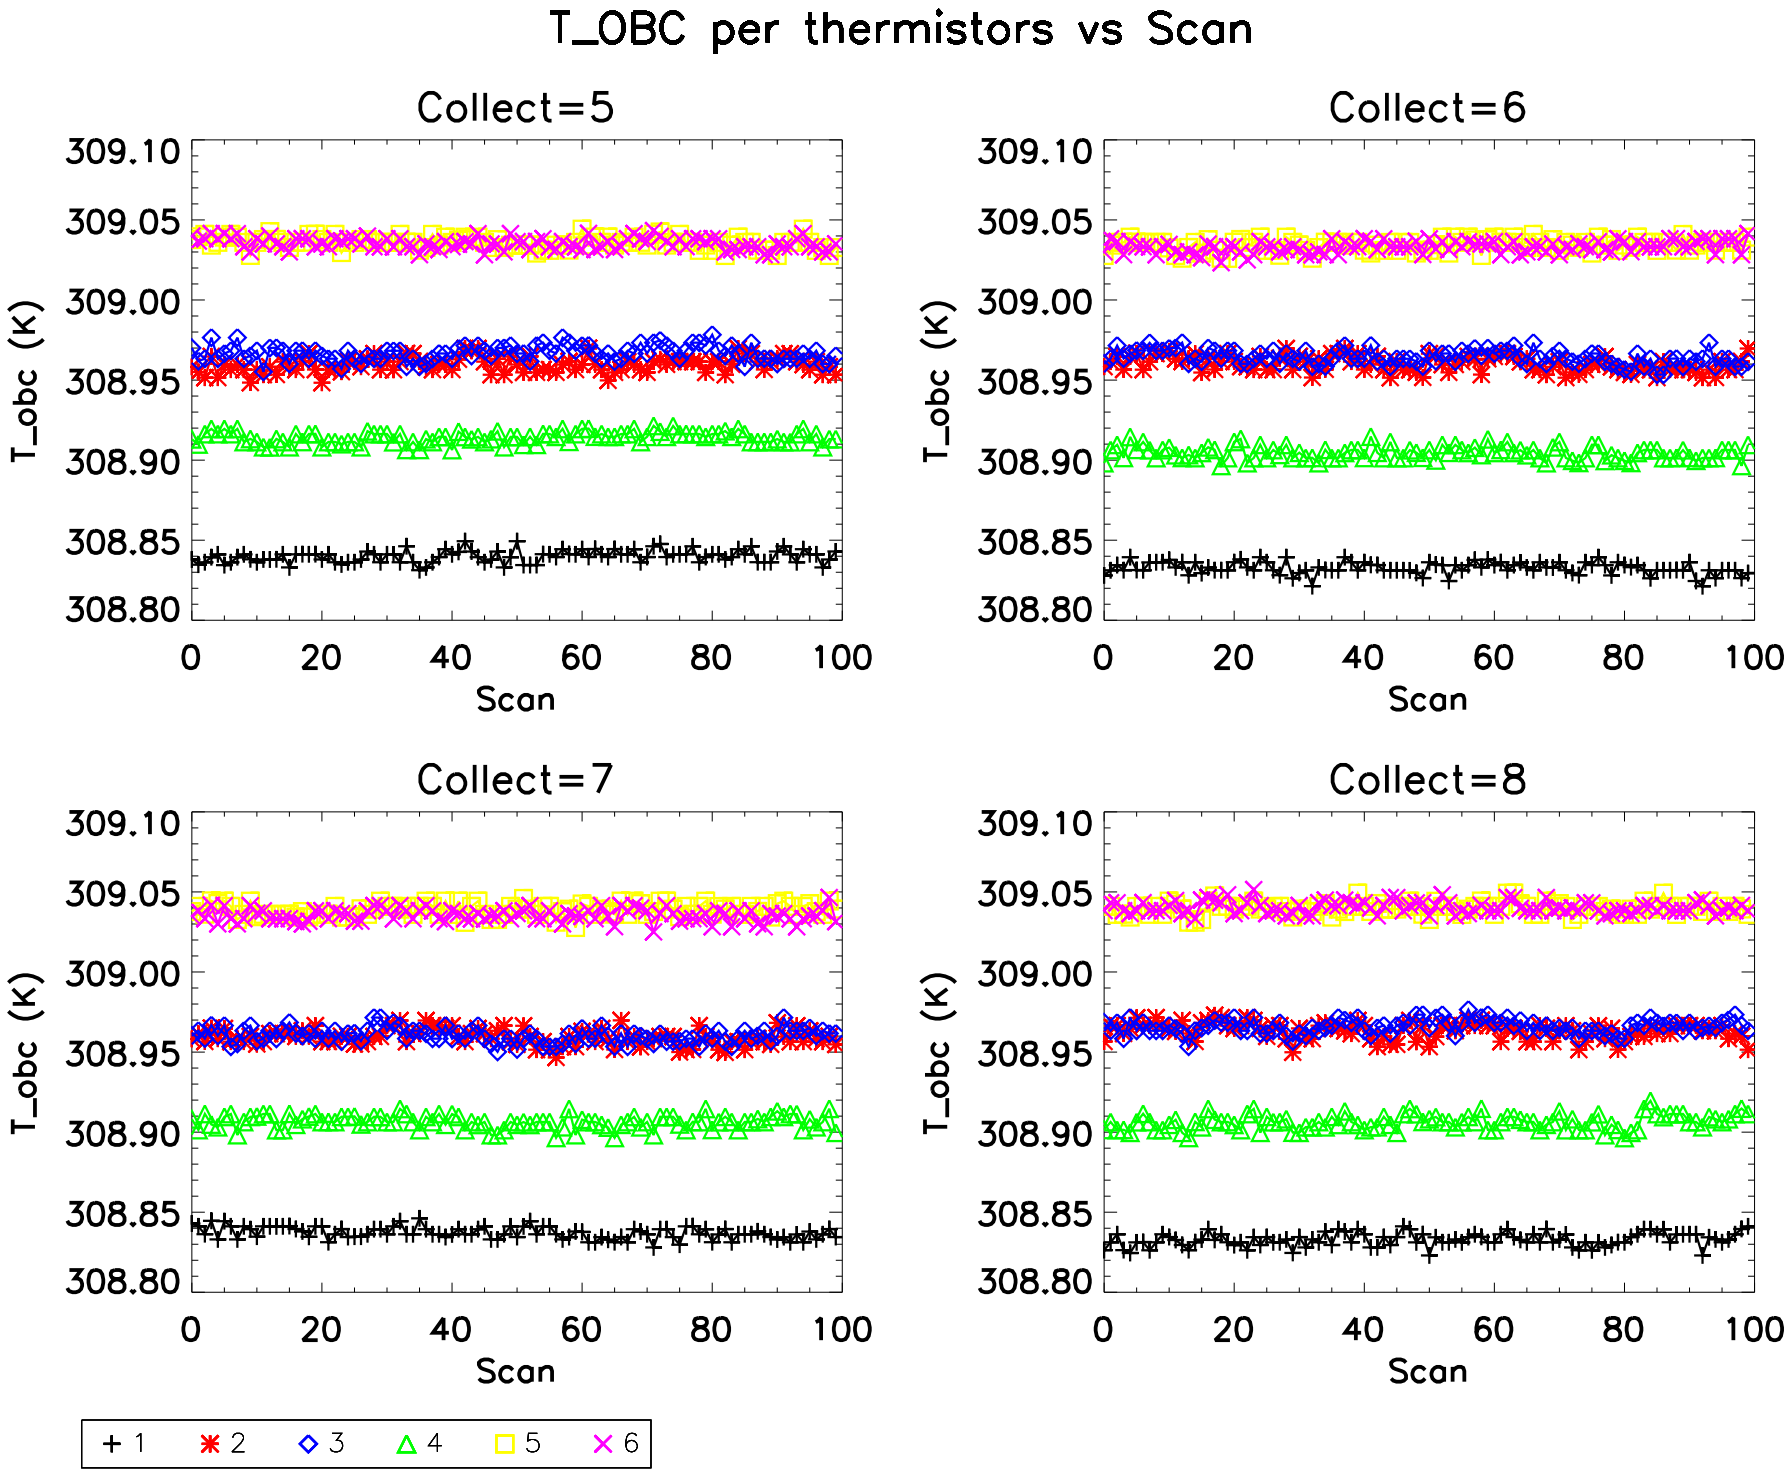
T_OBC per thermistors vs Scan
Collect=5
Collect=6
Collect=7
Collect=8
T_obc (K)
Scan
309.10
309.05
309.00
308.95
308.90
308.85
308.80
0
20
40
60
80
100
1
2
3
4
5
6

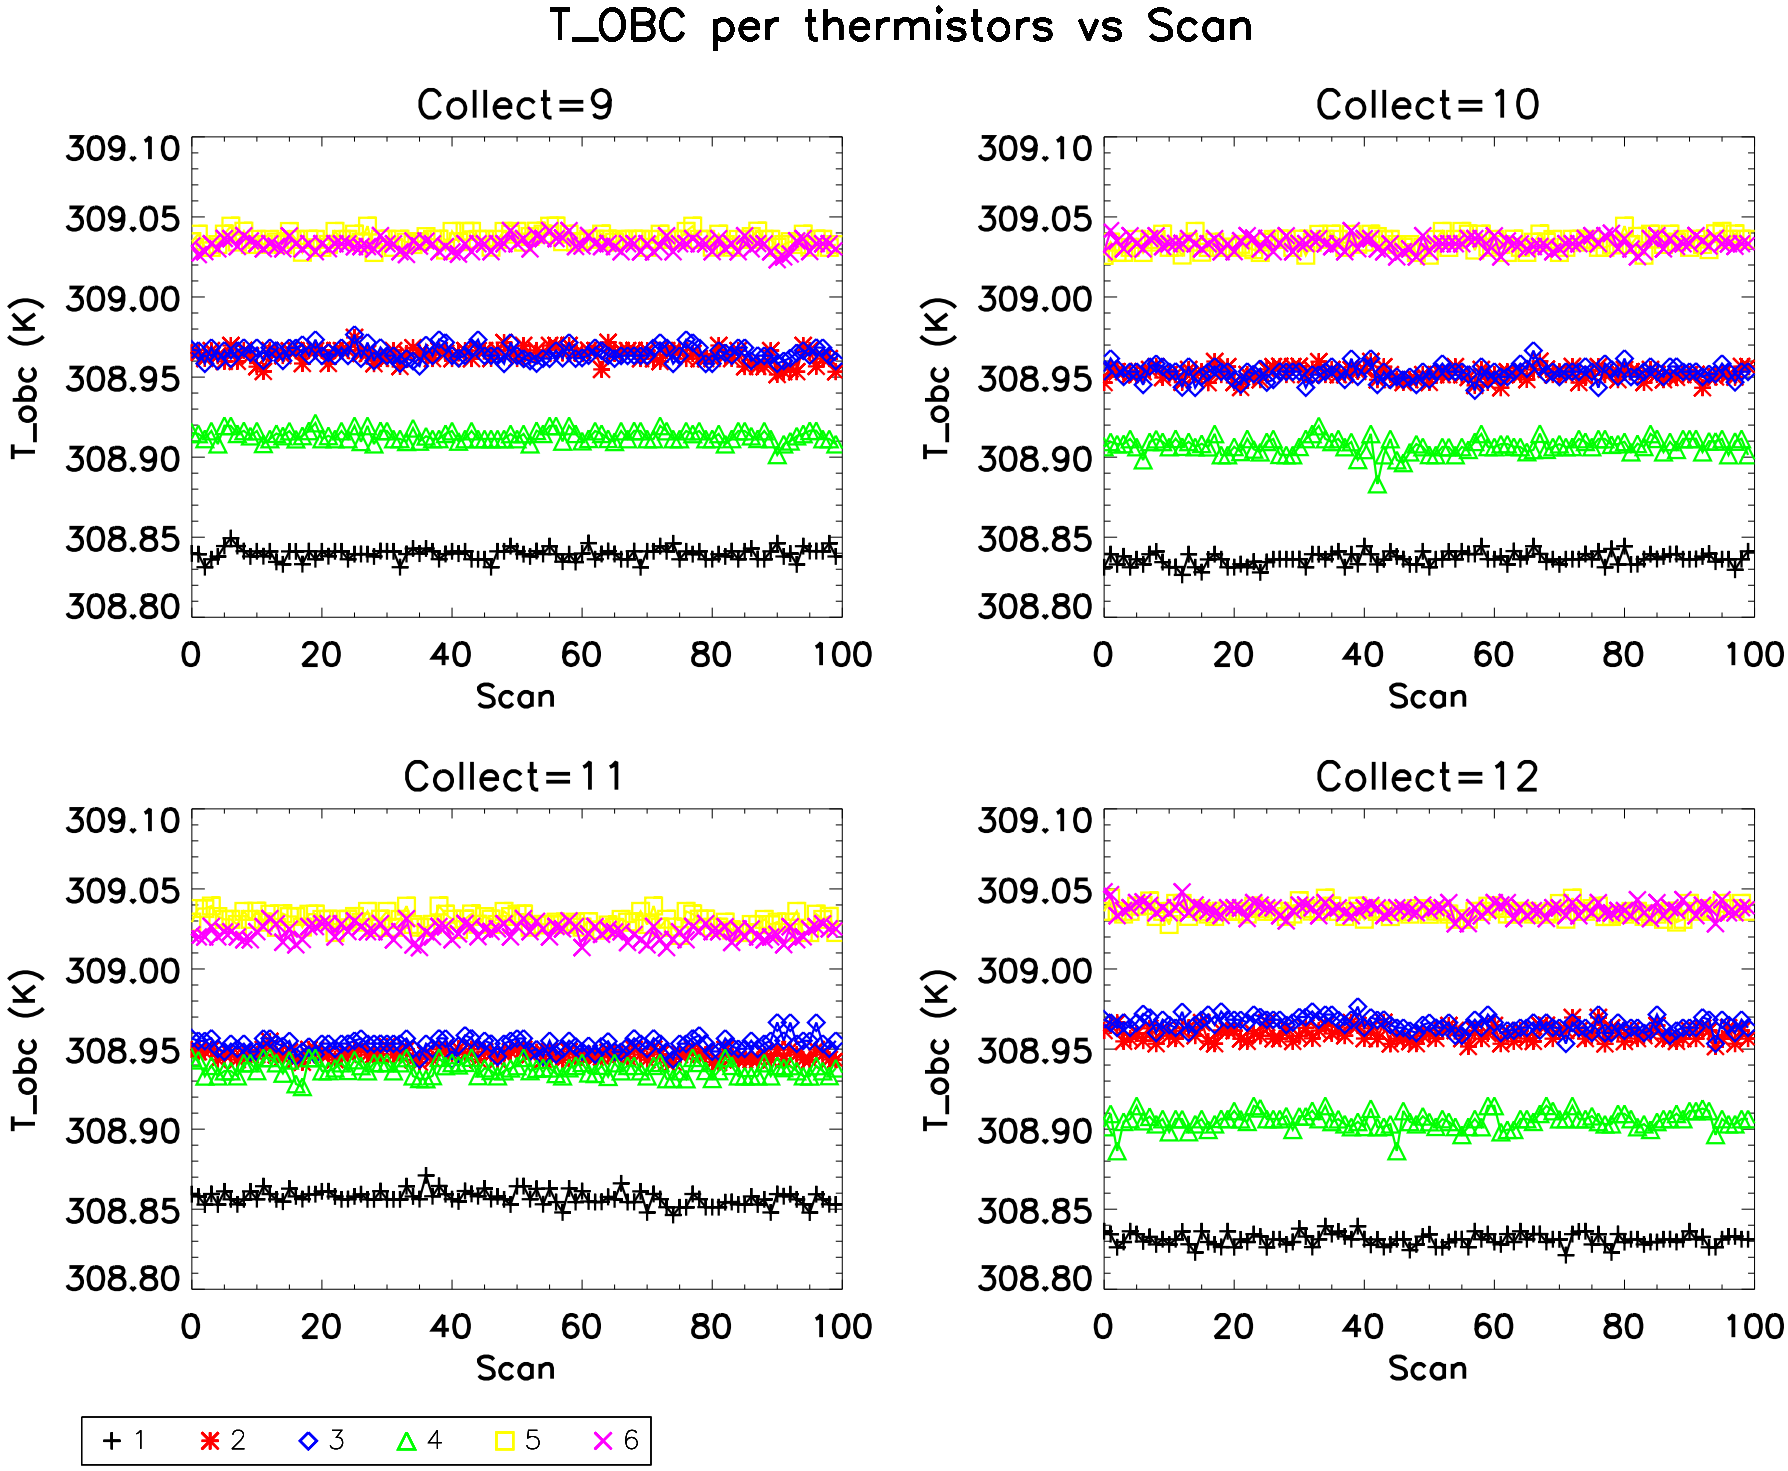
T_OBC per thermistors vs Scan
Collect=9
Collect=10
Collect=11
Collect=12
T_obc (K)
Scan
309.10
309.05
309.00
308.95
308.90
308.85
308.80
0
20
40
60
80
100
1
2
3
4
5
6

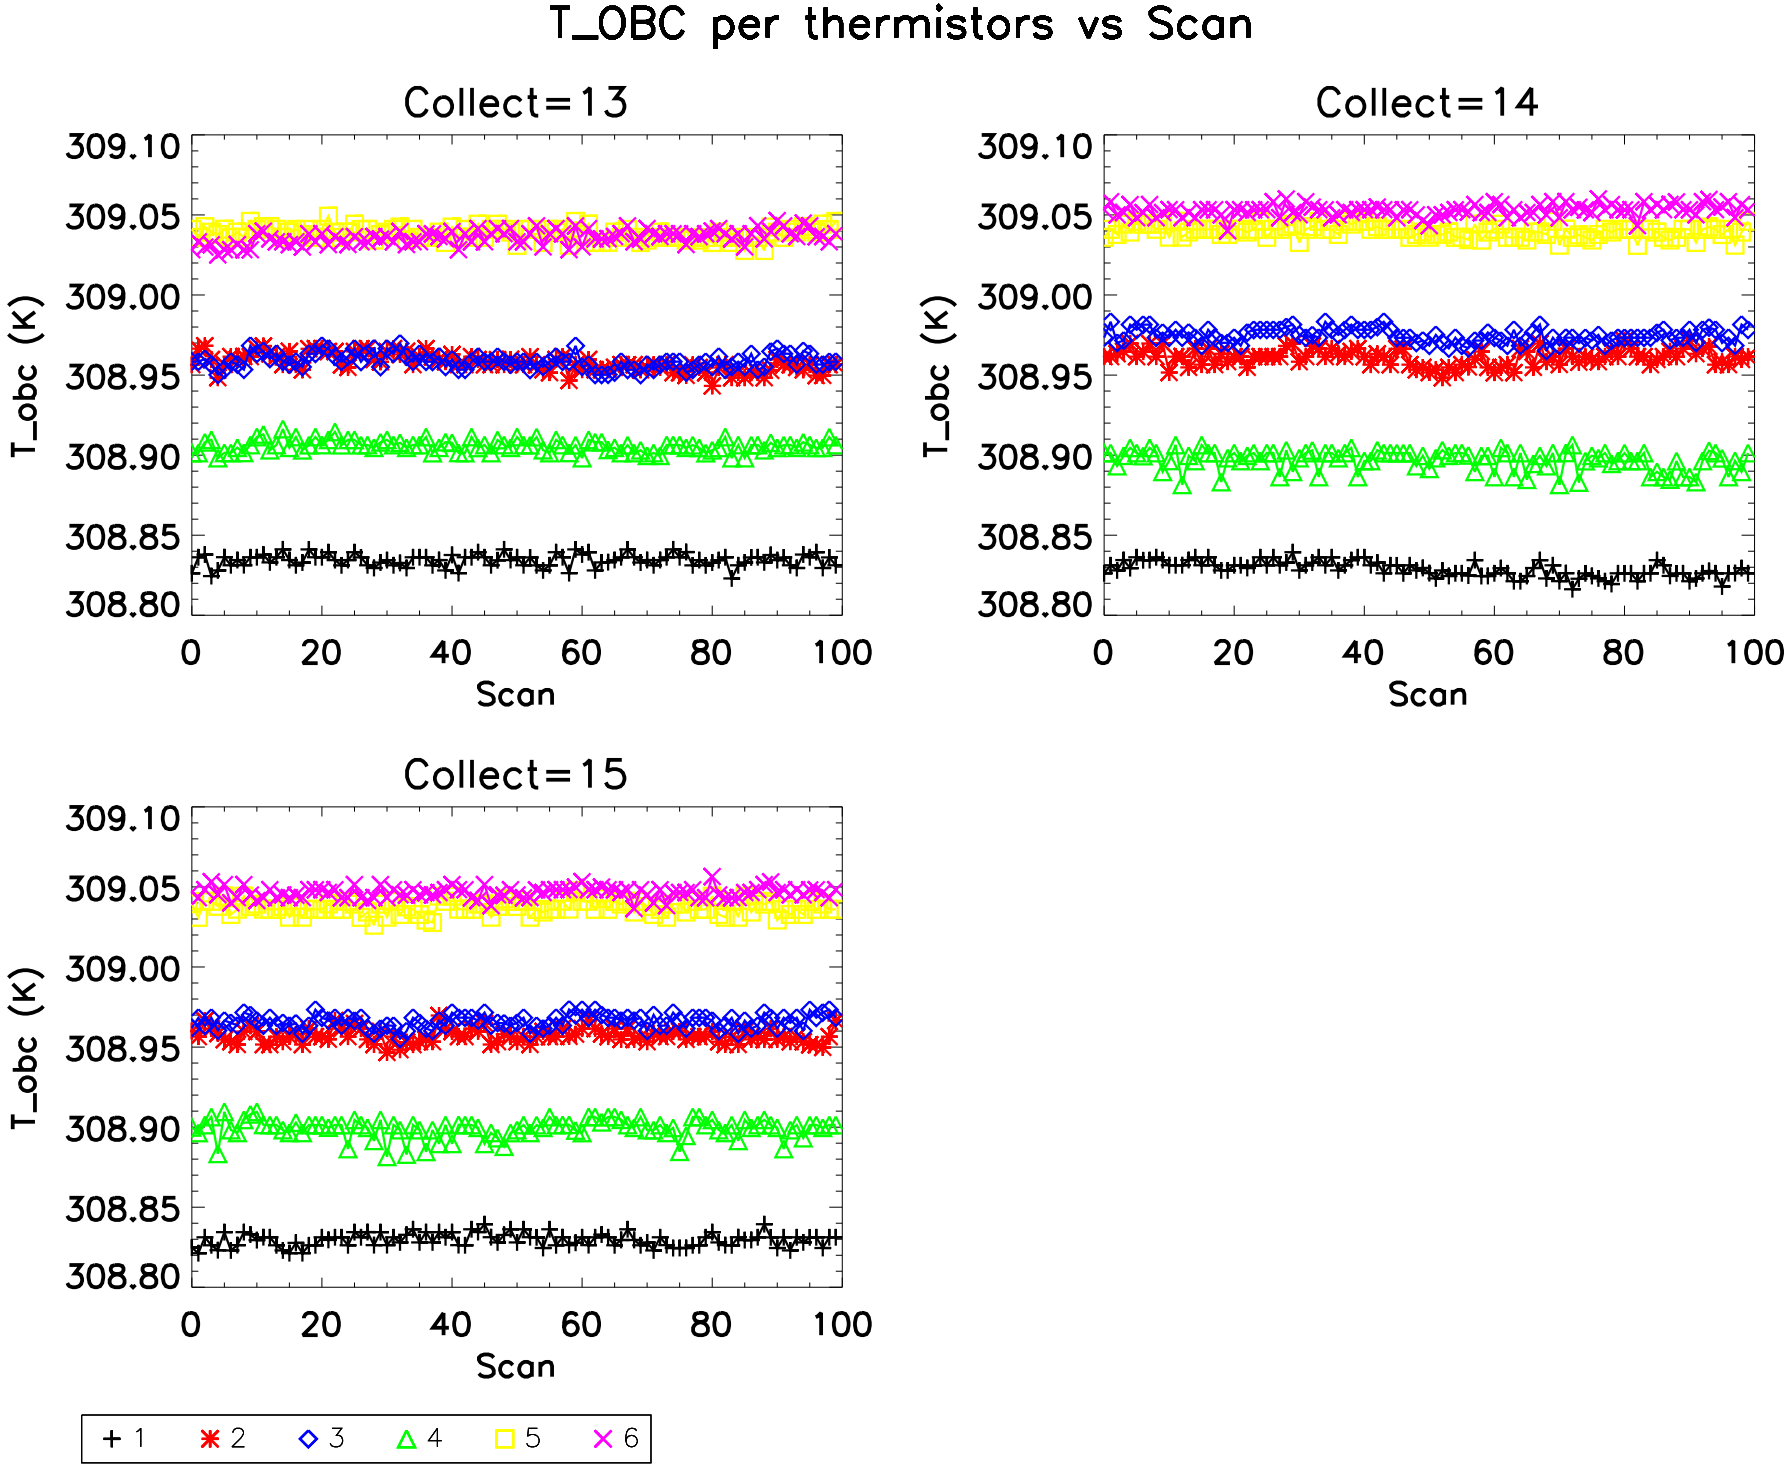
T_OBC per thermistors vs Scan
Collect=13
Collect=14
Collect=15
T_obc (K)
Scan
309.10
309.05
309.00
308.95
308.90
308.85
308.80
0
20
40
60
80
100
1
2
3
4
5
6

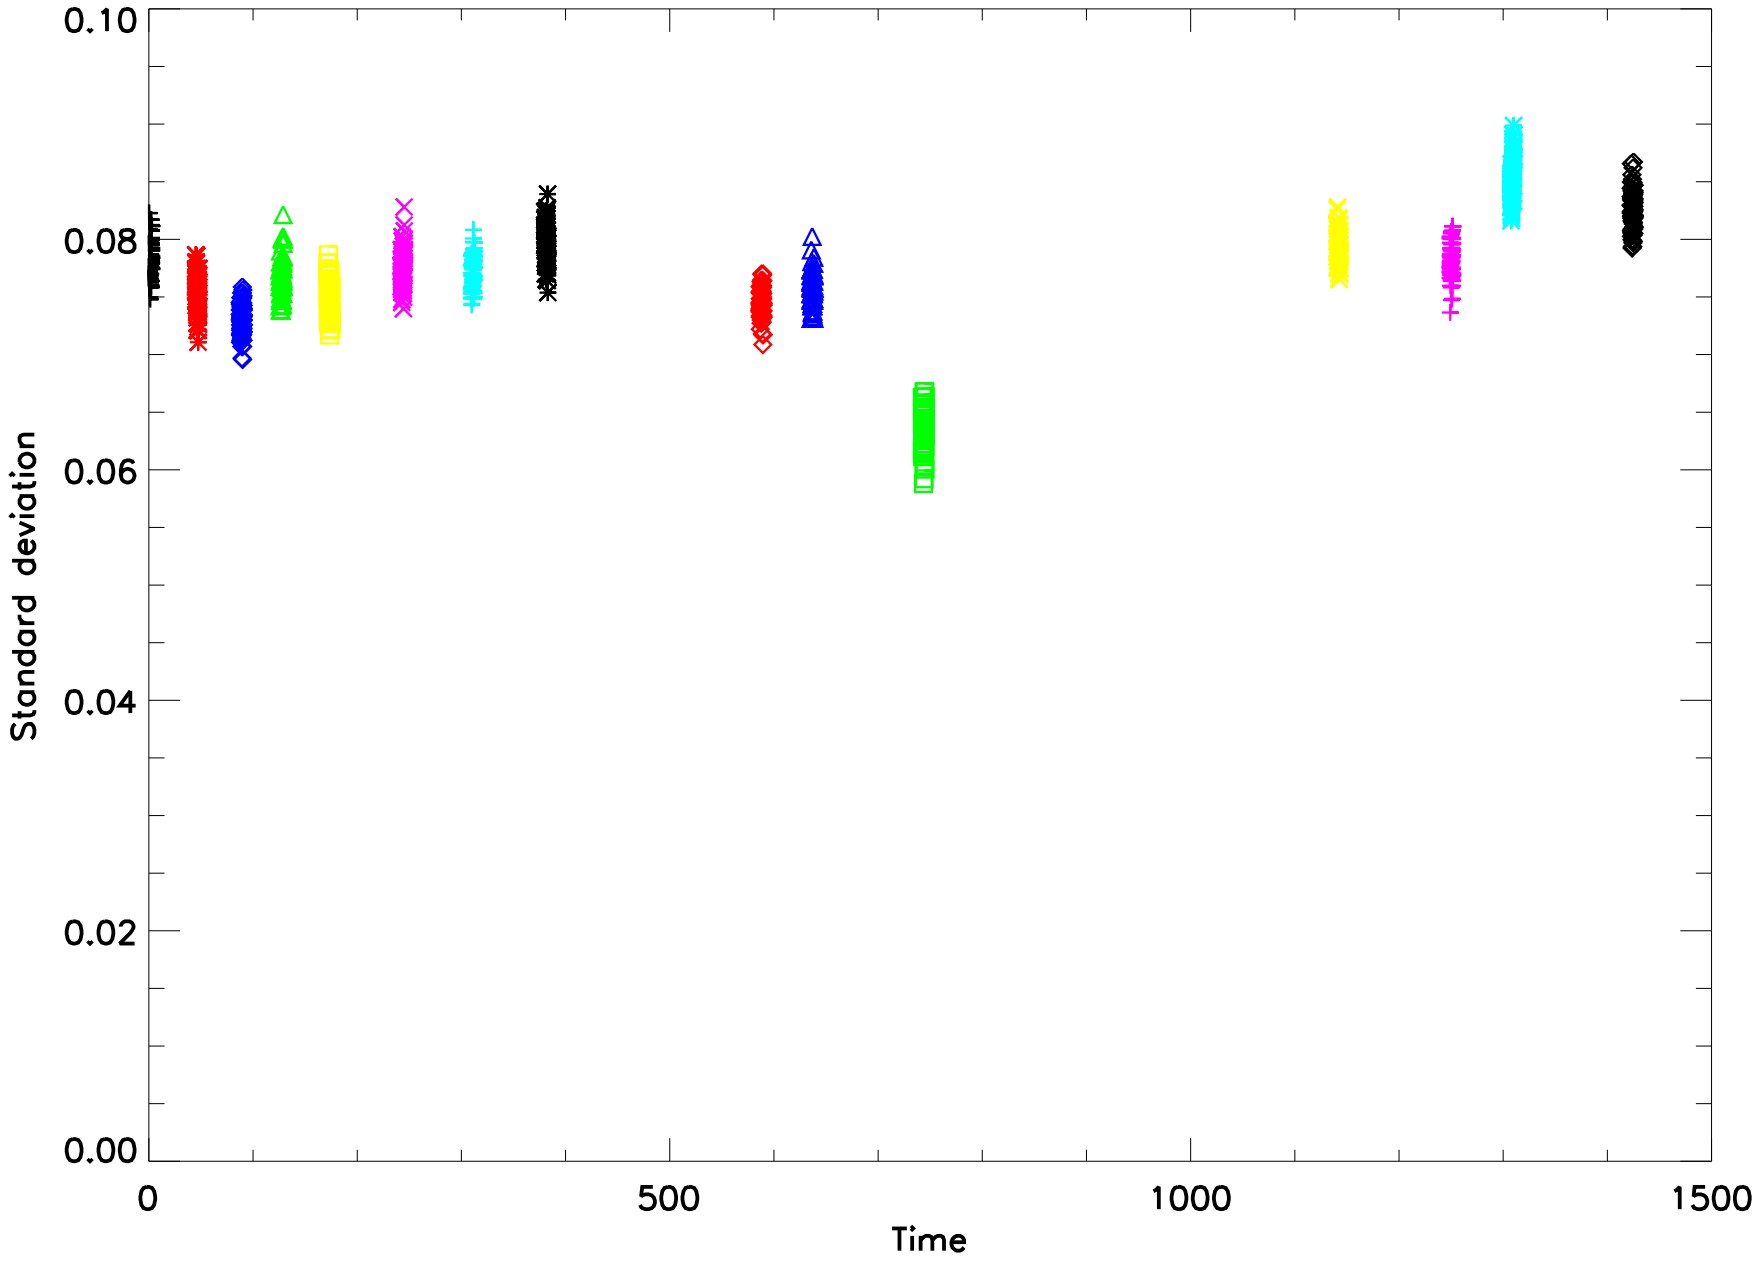
OBC thermistor standard deviation vs Time
Standard deviation
0.10
0.08
0.06
0.04
0.02
0.00
0
500
1000
1500
Time

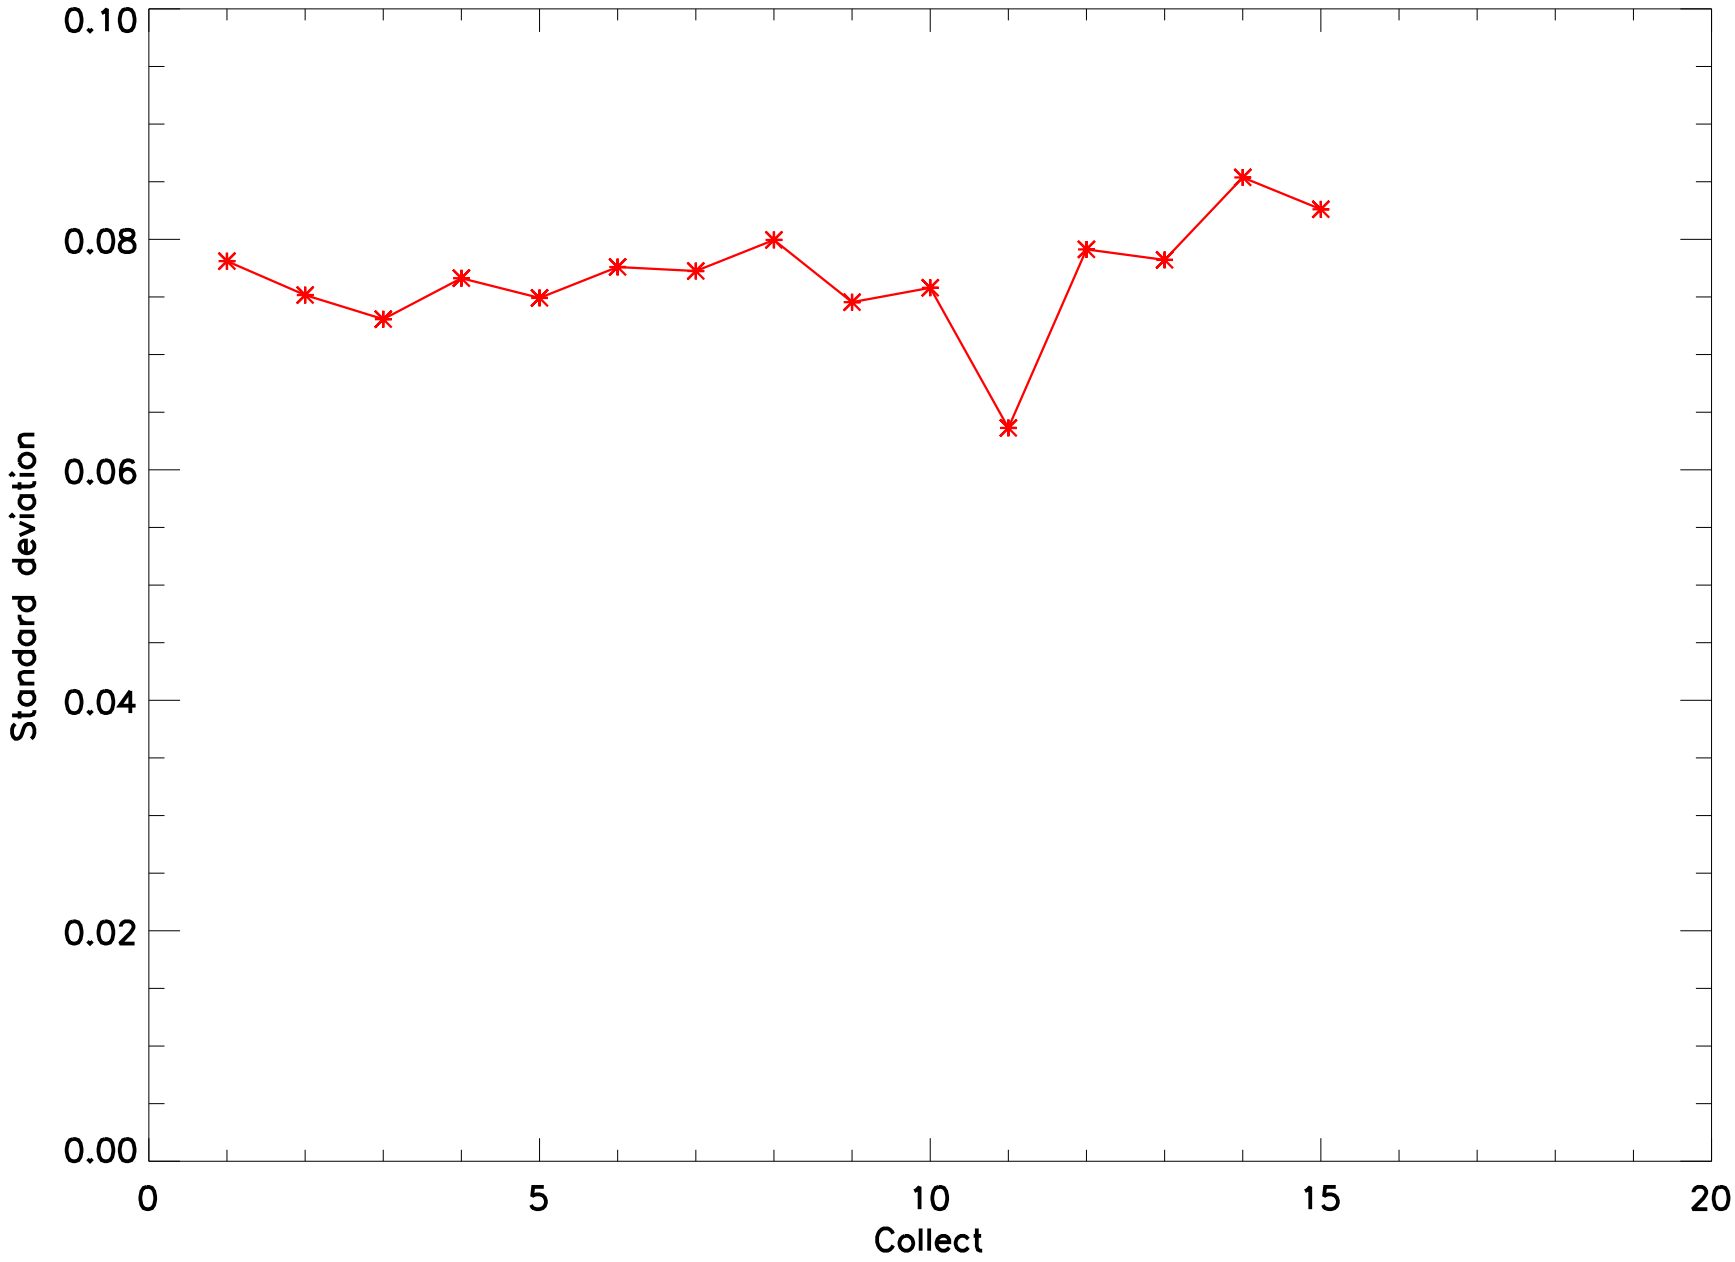
OBC thermistor standard deviation vs Collect
Standard deviation
0.10
0.08
0.06
0.04
0.02
0.00
0
5
10
15
20
Collect

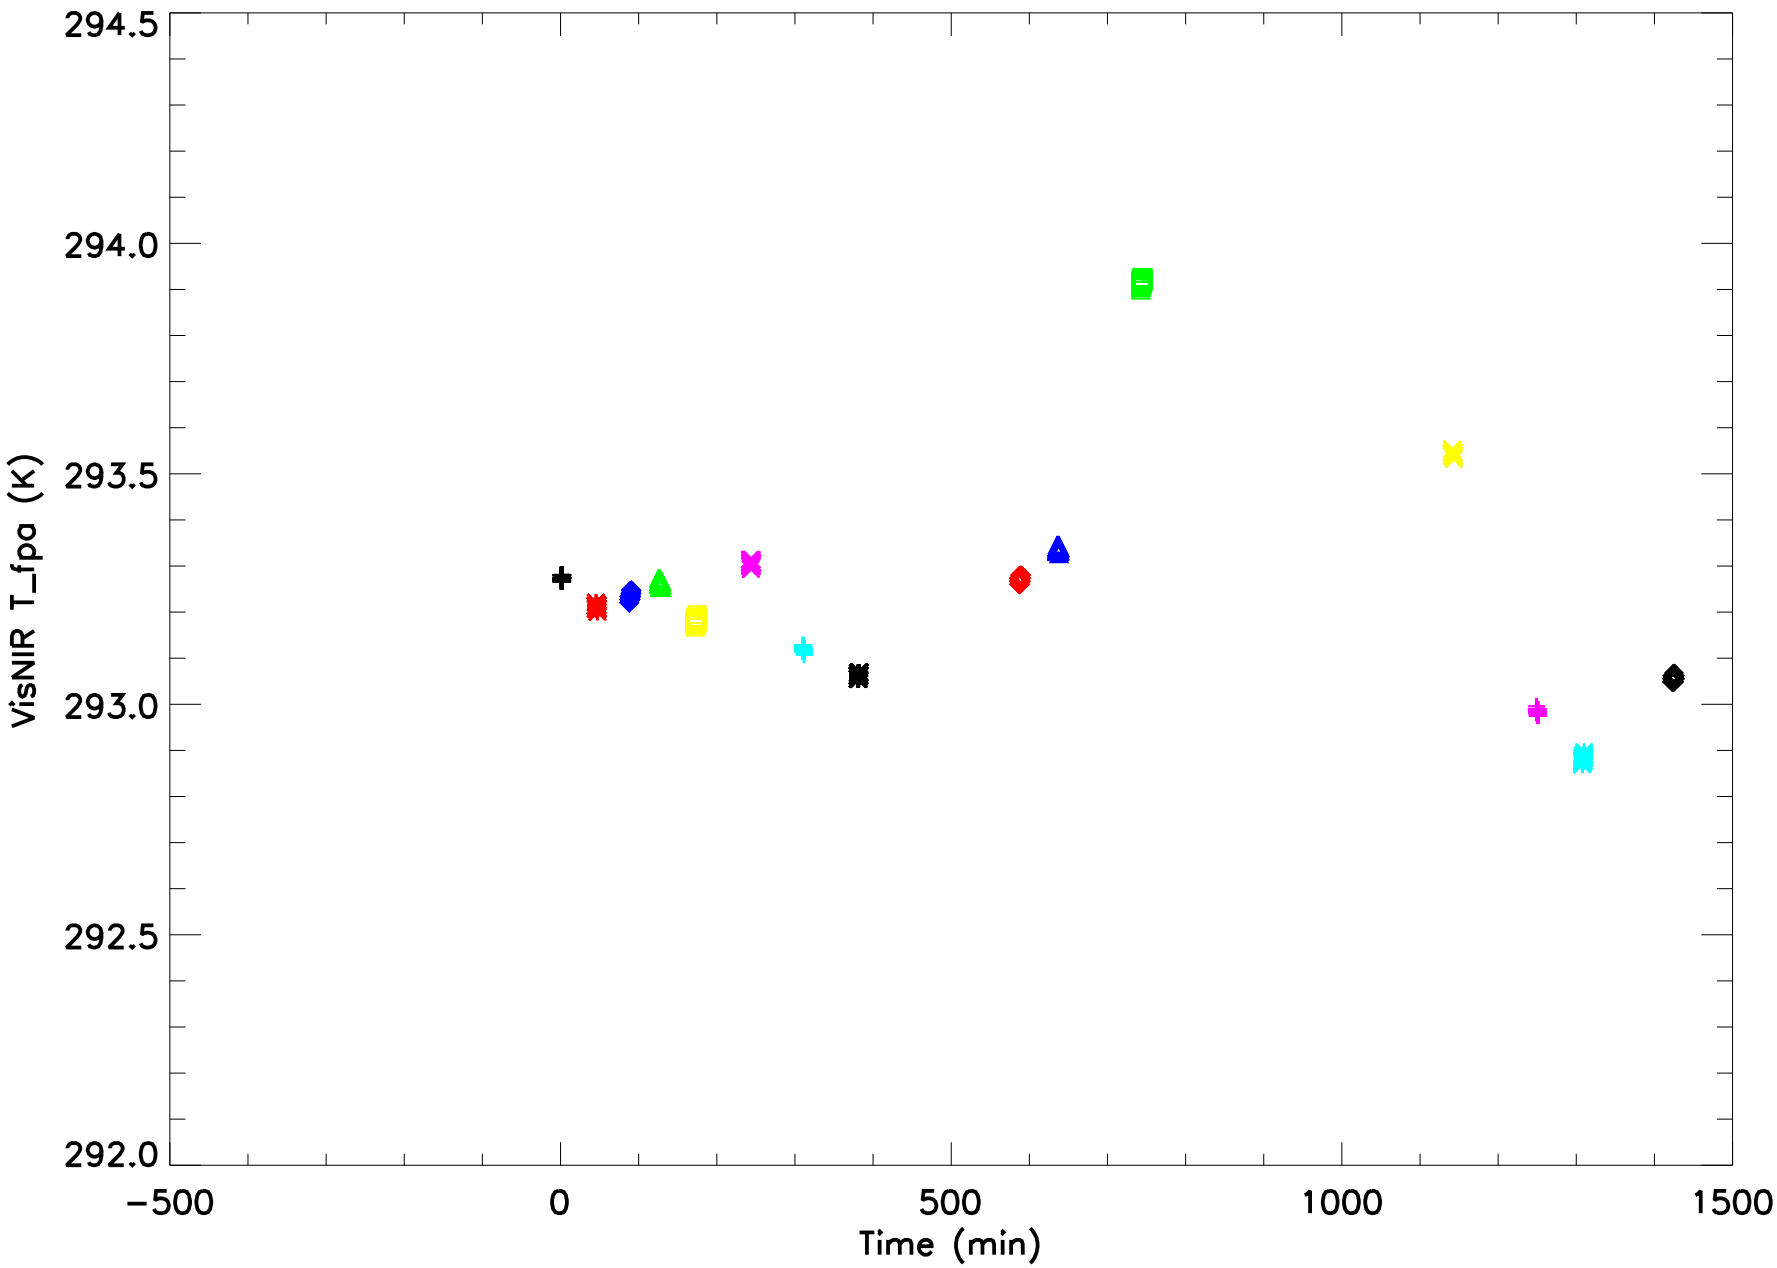
VisNIR T_fpa vs Time
294.5
294.0
293.5
293.0
292.5
292.0
VisNIR T_fpa (K)
−500
0
500
1000
1500
Time (min)

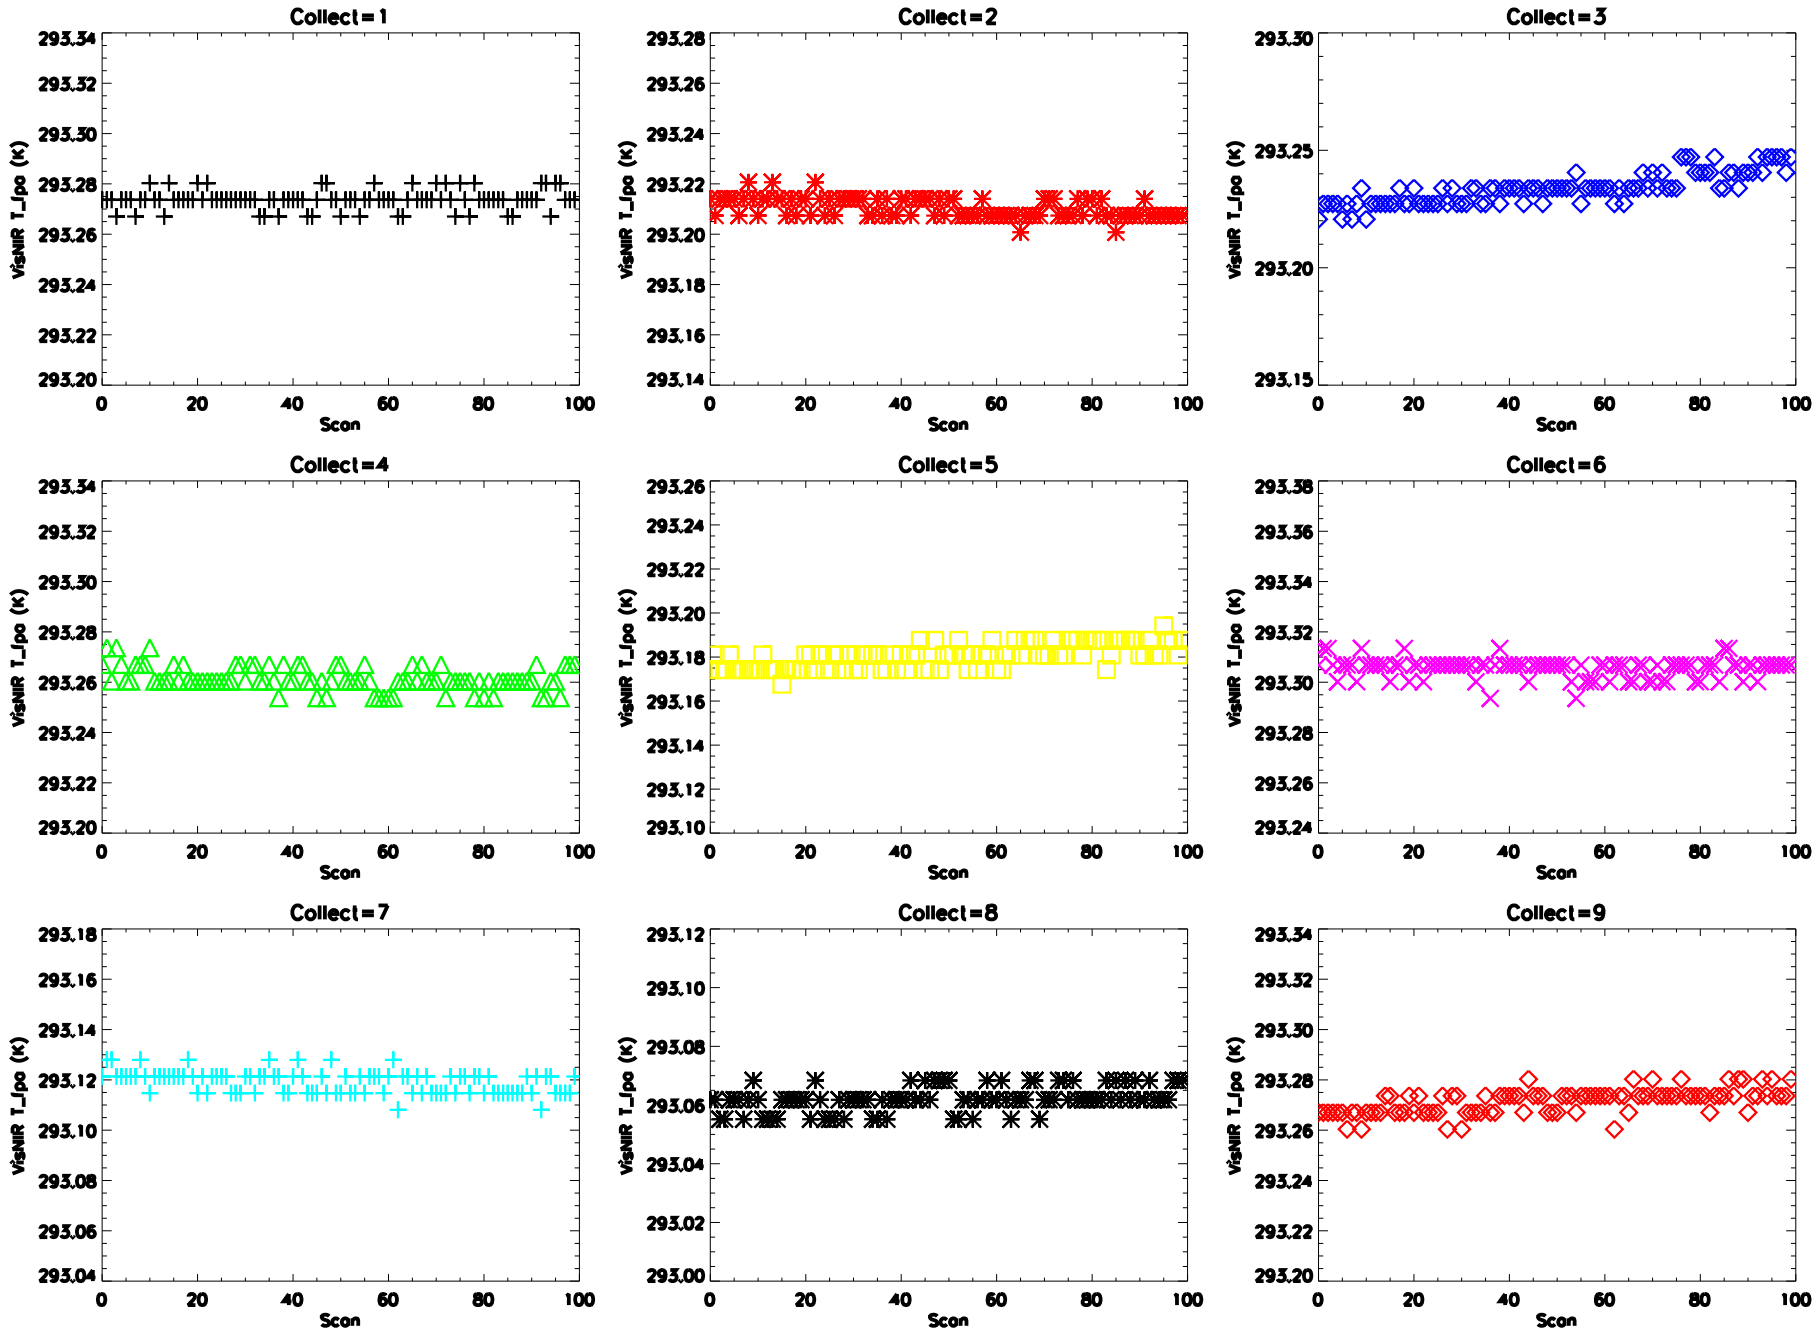
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
VisNIR T_lpo (K)
Scan

VisNIR T_fpa vs Scan

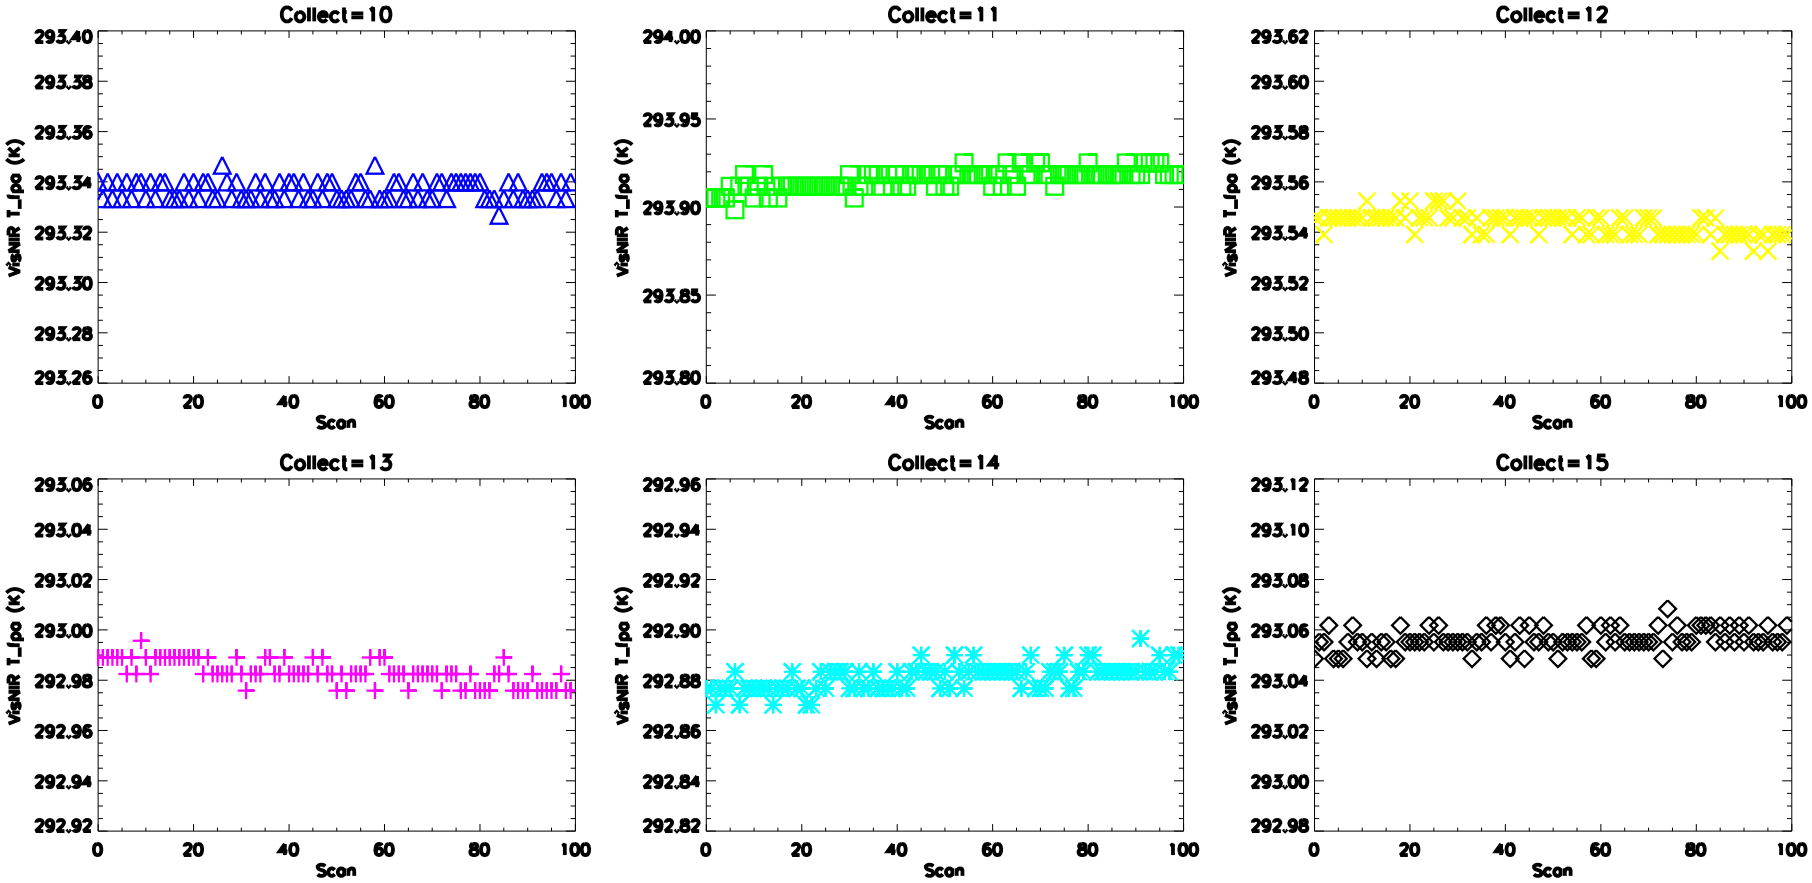

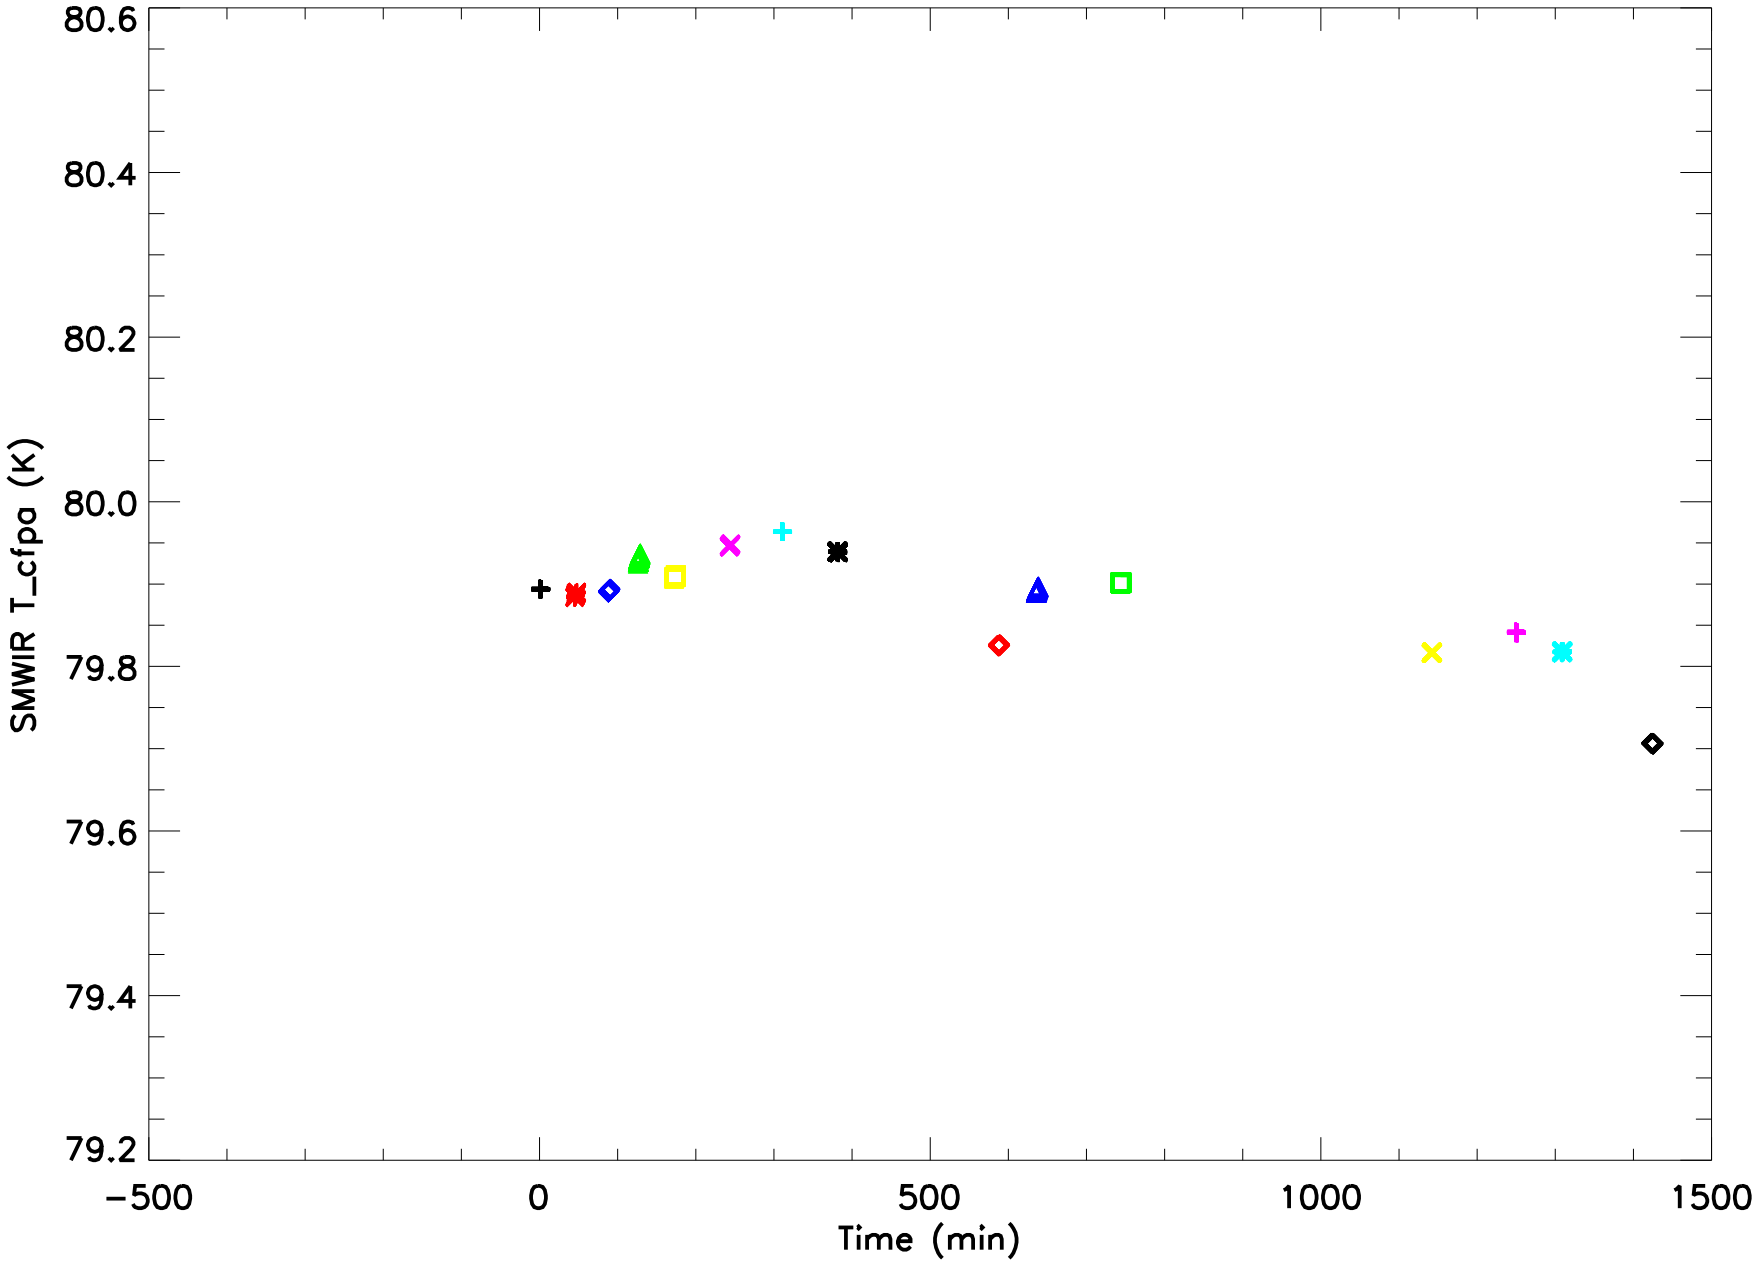
SMWIR T_cfpa vs Time
80.6
80.4
80.2
80.0
79.8
79.6
79.4
79.2
SMWIR T_cfpa (K)
−500
0
500
1000
1500
Time (min)

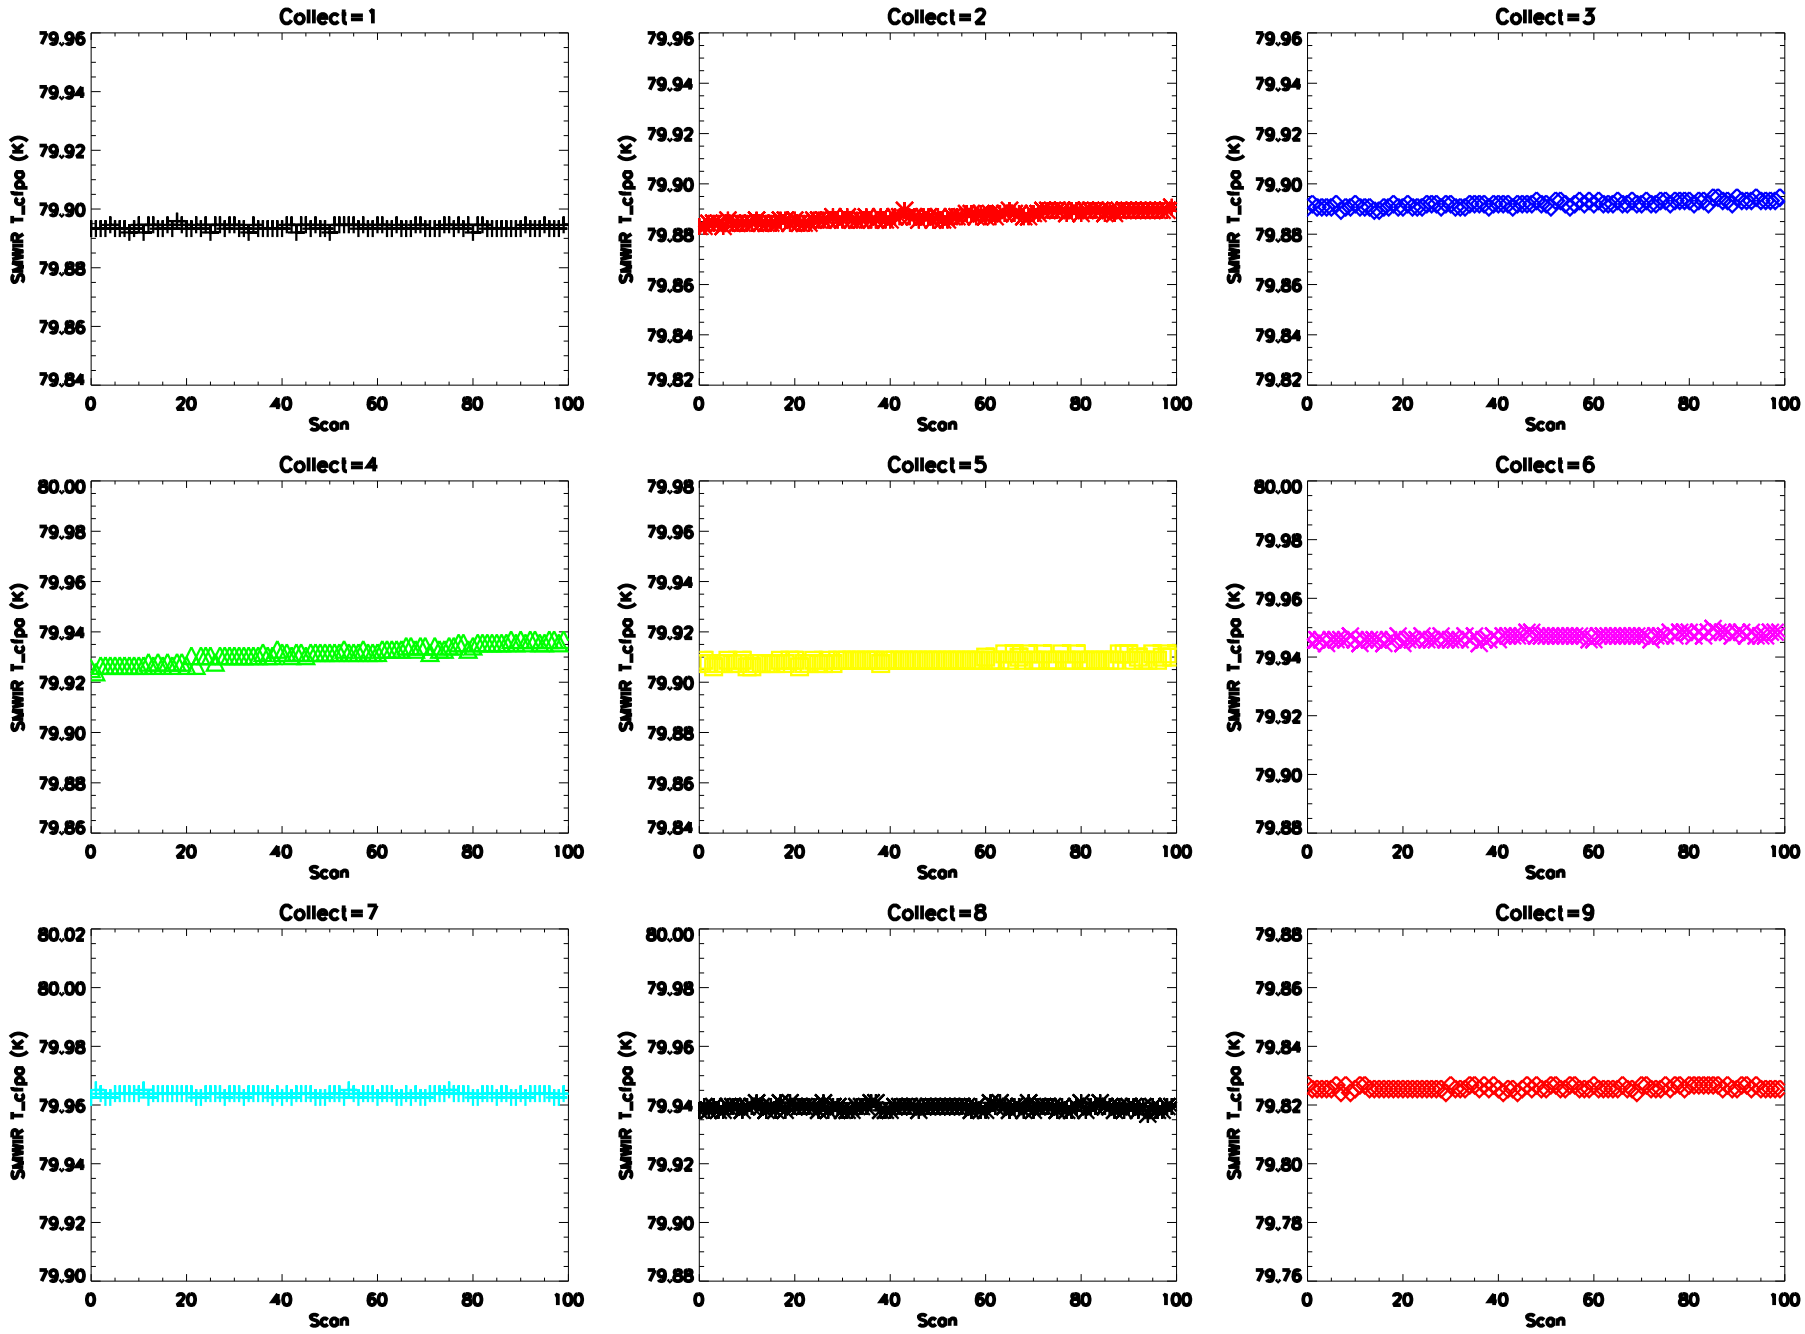
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
SMWIR T_clpa (K)
Scan

SMWIR T_cfpa vs Scan

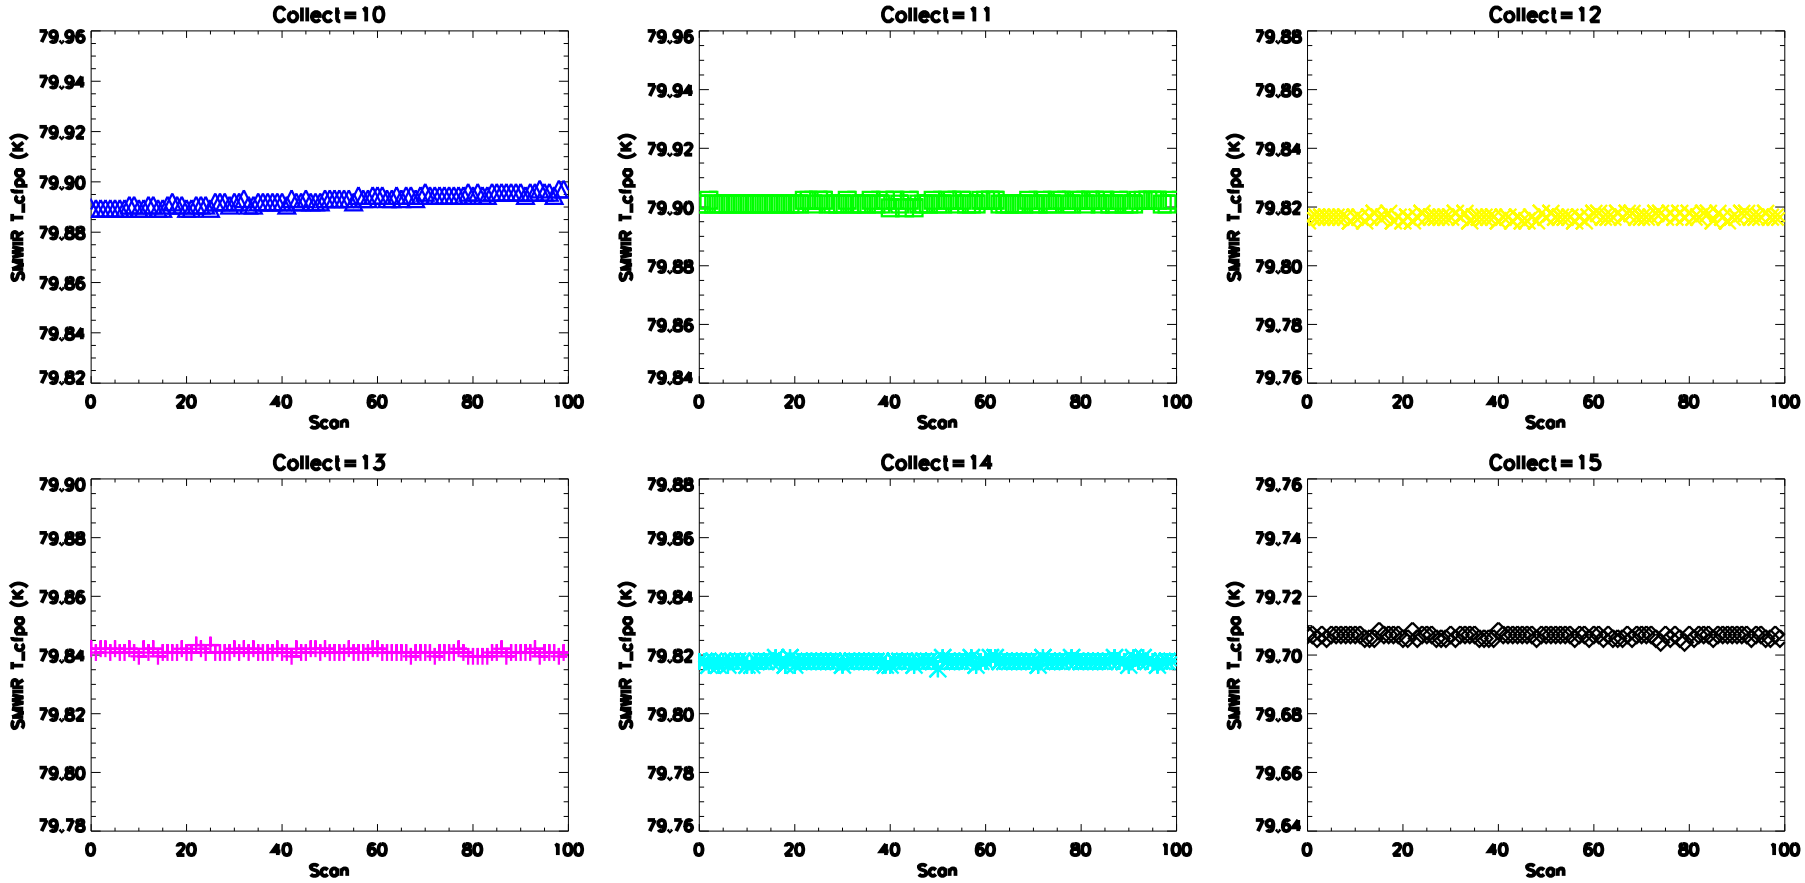

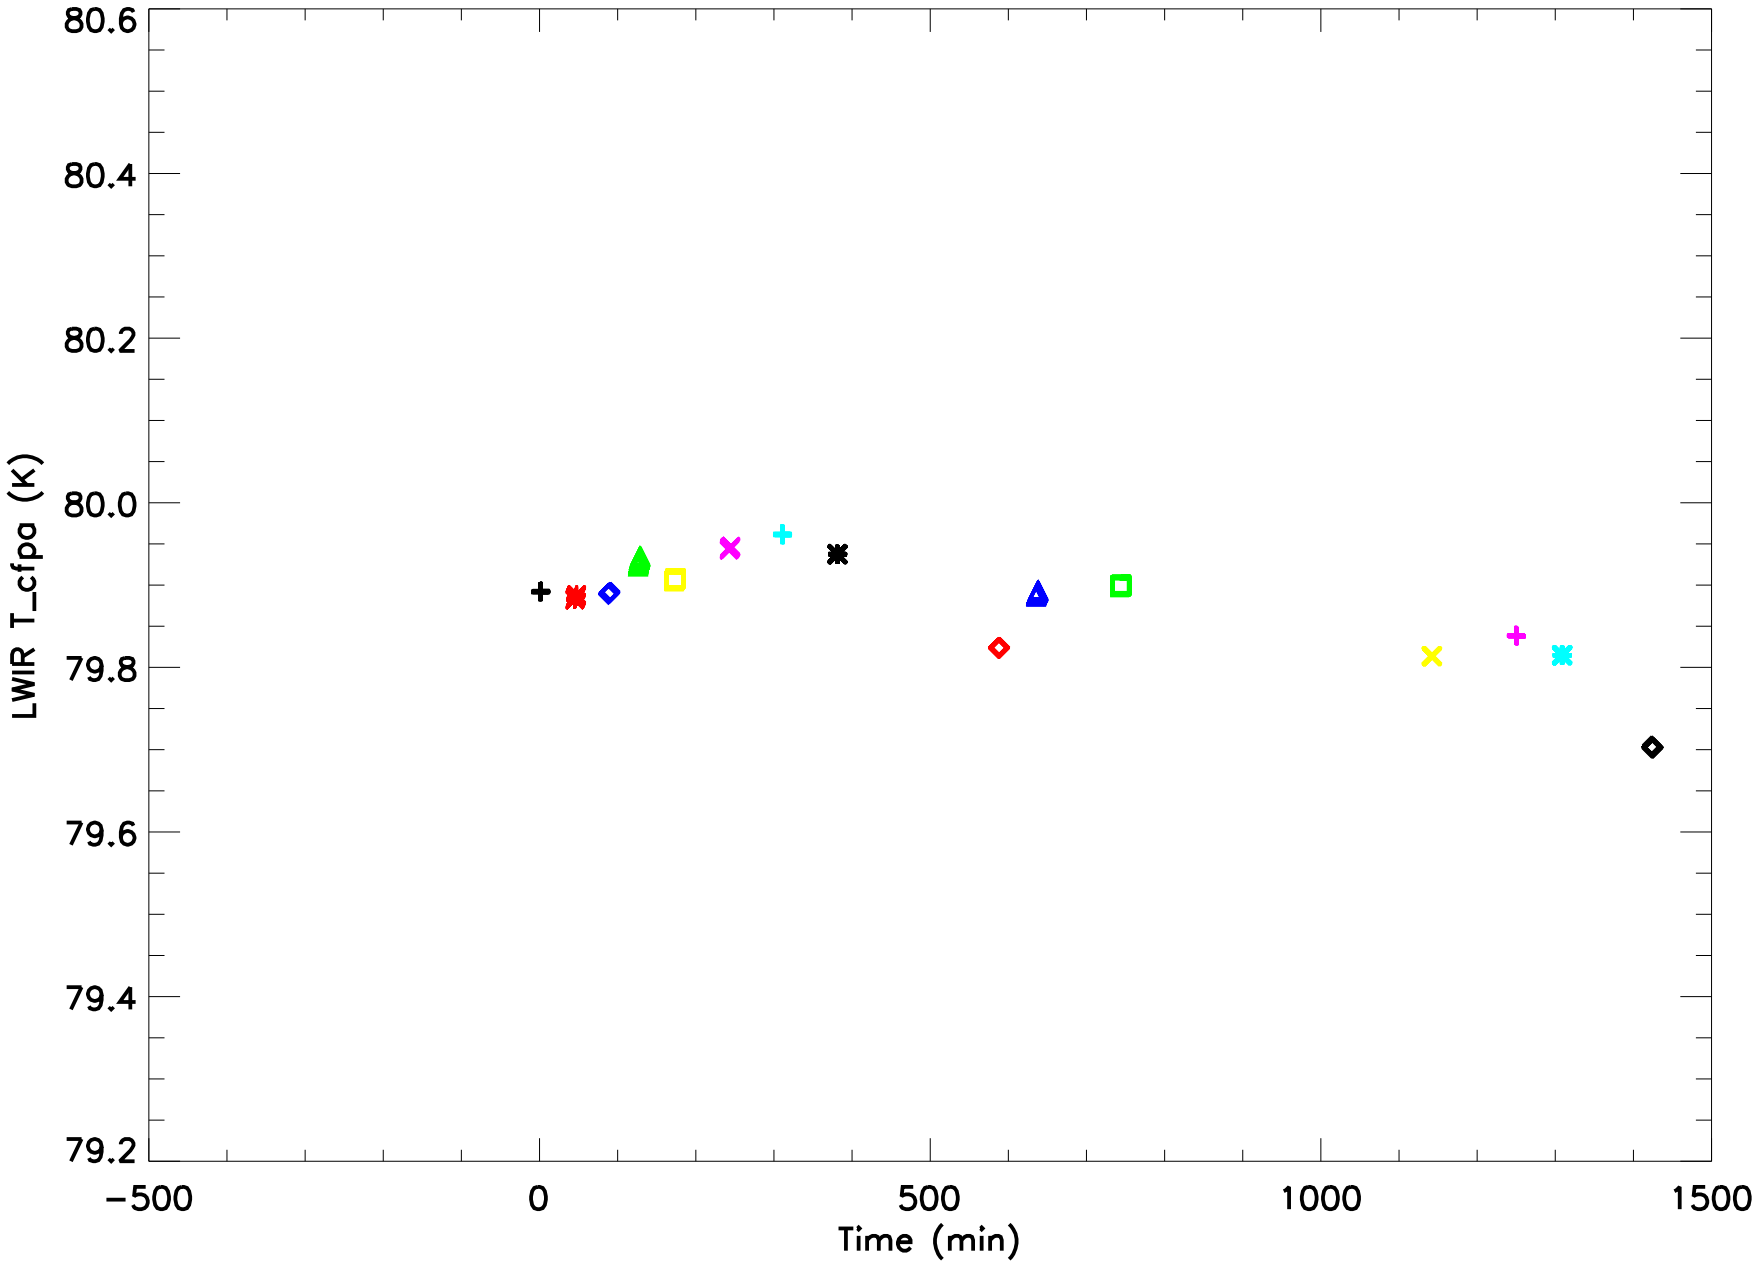
LWIR T_cfpa vs Time
80.6
80.4
80.2
80.0
79.8
79.6
79.4
79.2
LWIR T_cfpa (K)
−500
0
500
1000
1500
Time (min)

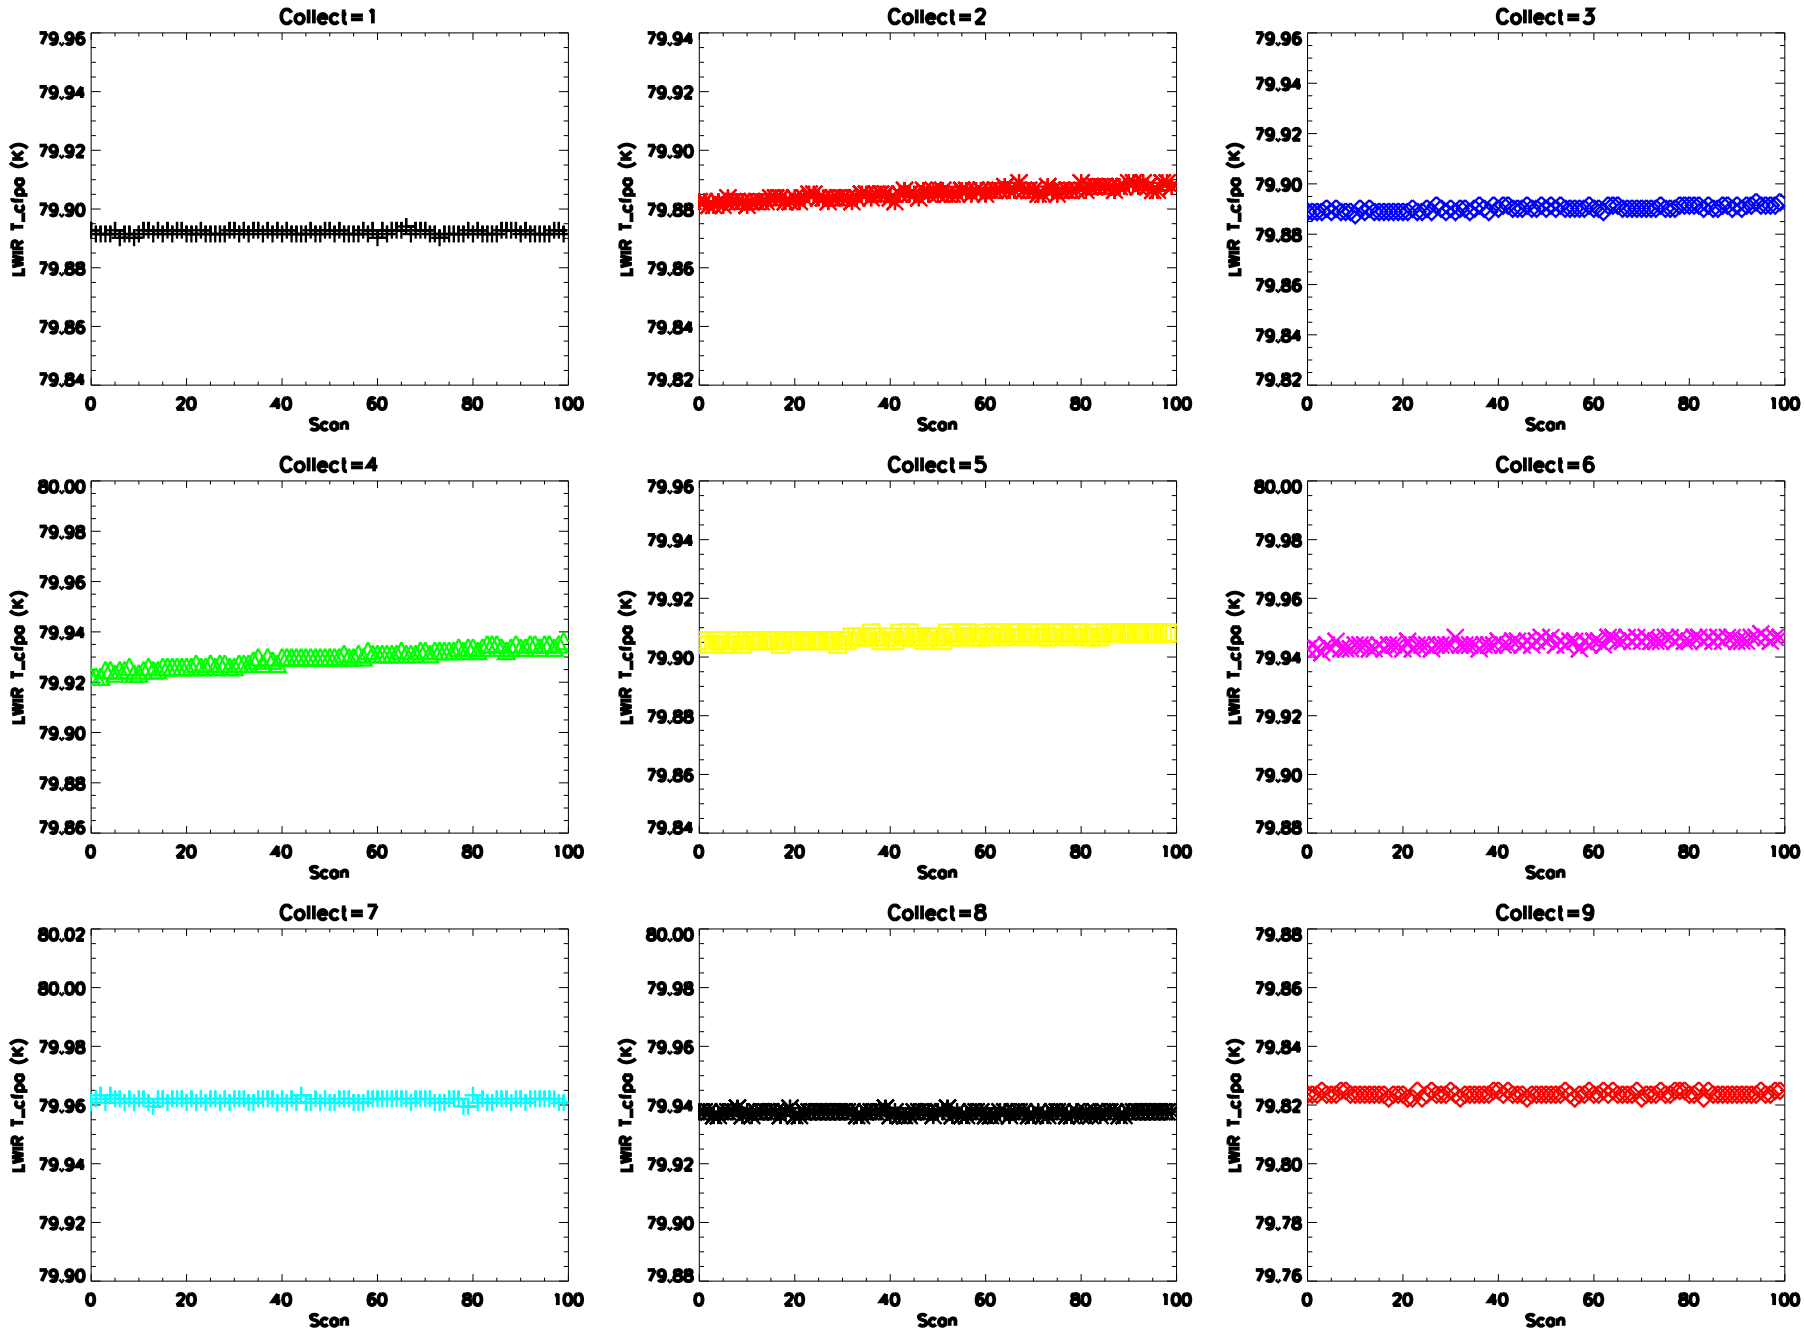
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
LWIR T_cfpa (K)
Scan

LWIR T_cfpa vs Scan

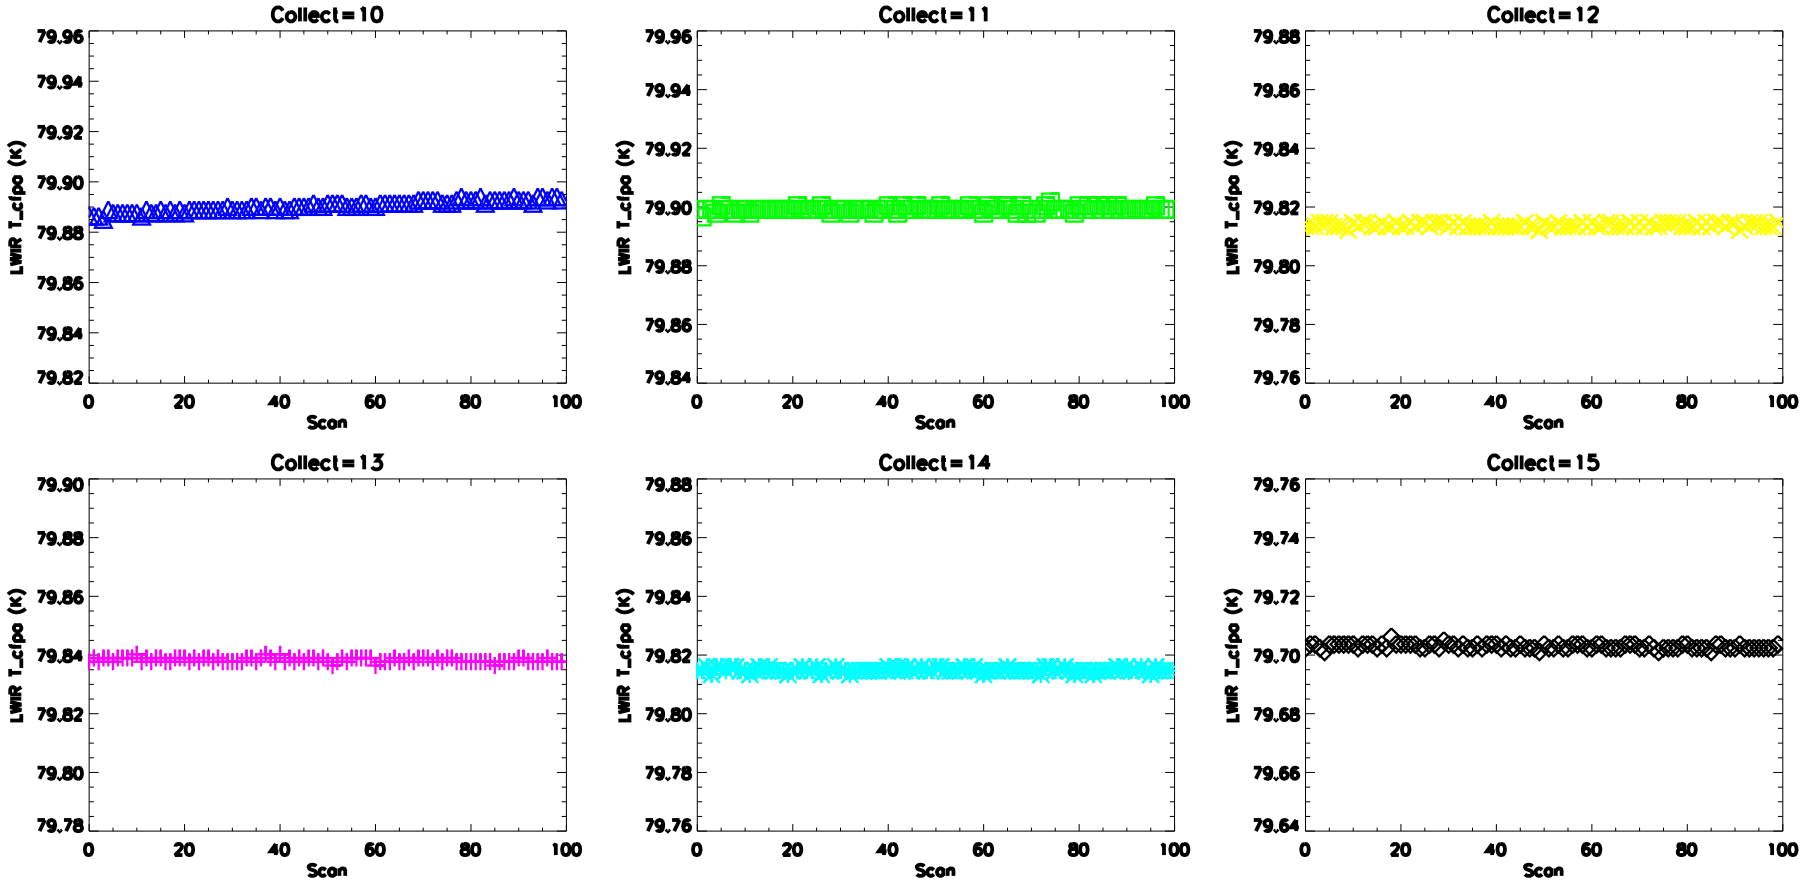

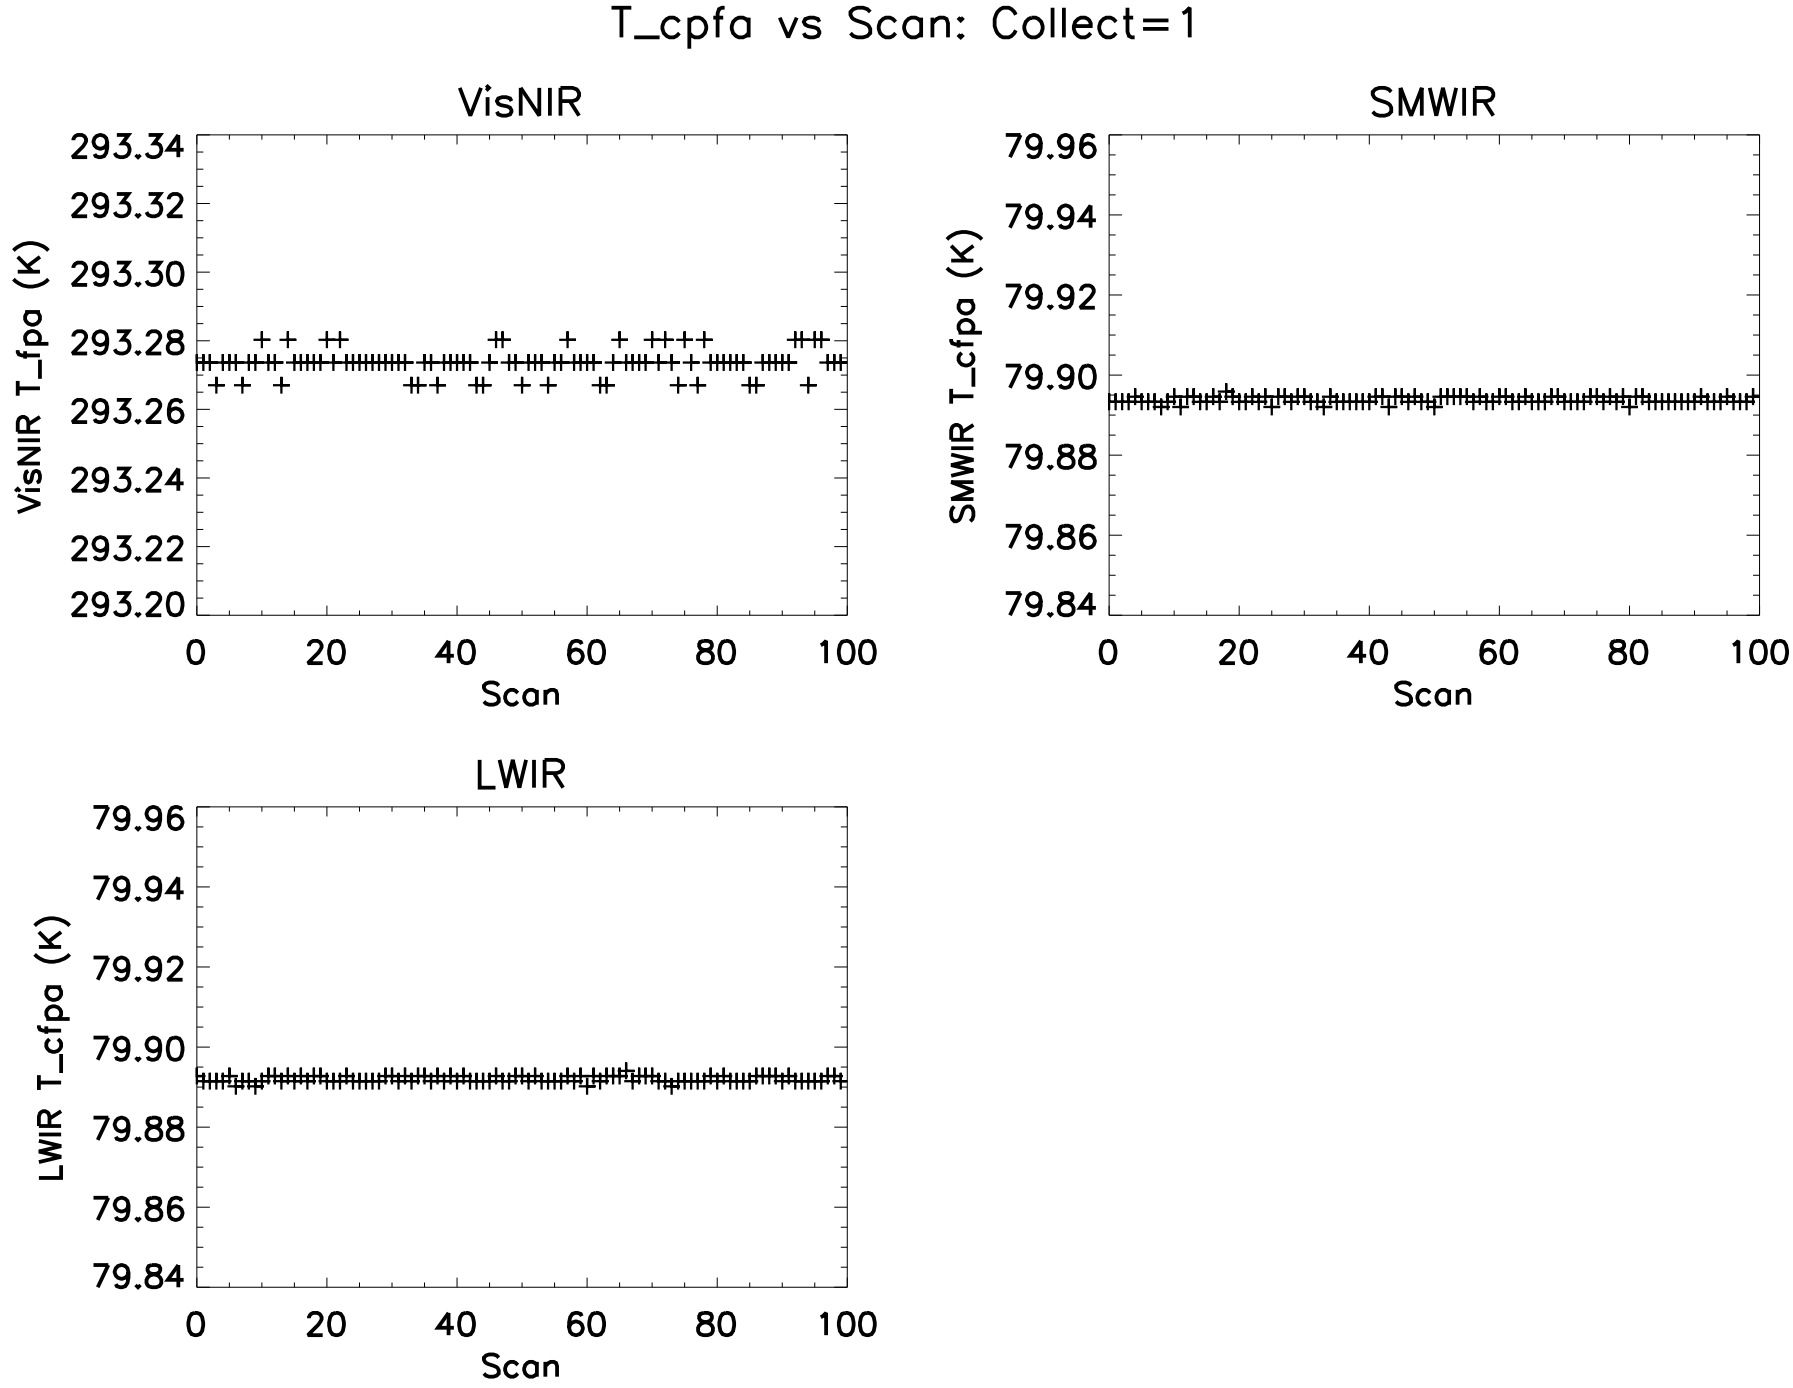
T_cpfa vs Scan: Collect=1
VisNIR
VisNIR T_fpa (K)
293.34
293.32
293.30
293.28
293.26
293.24
293.22
293.20
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan

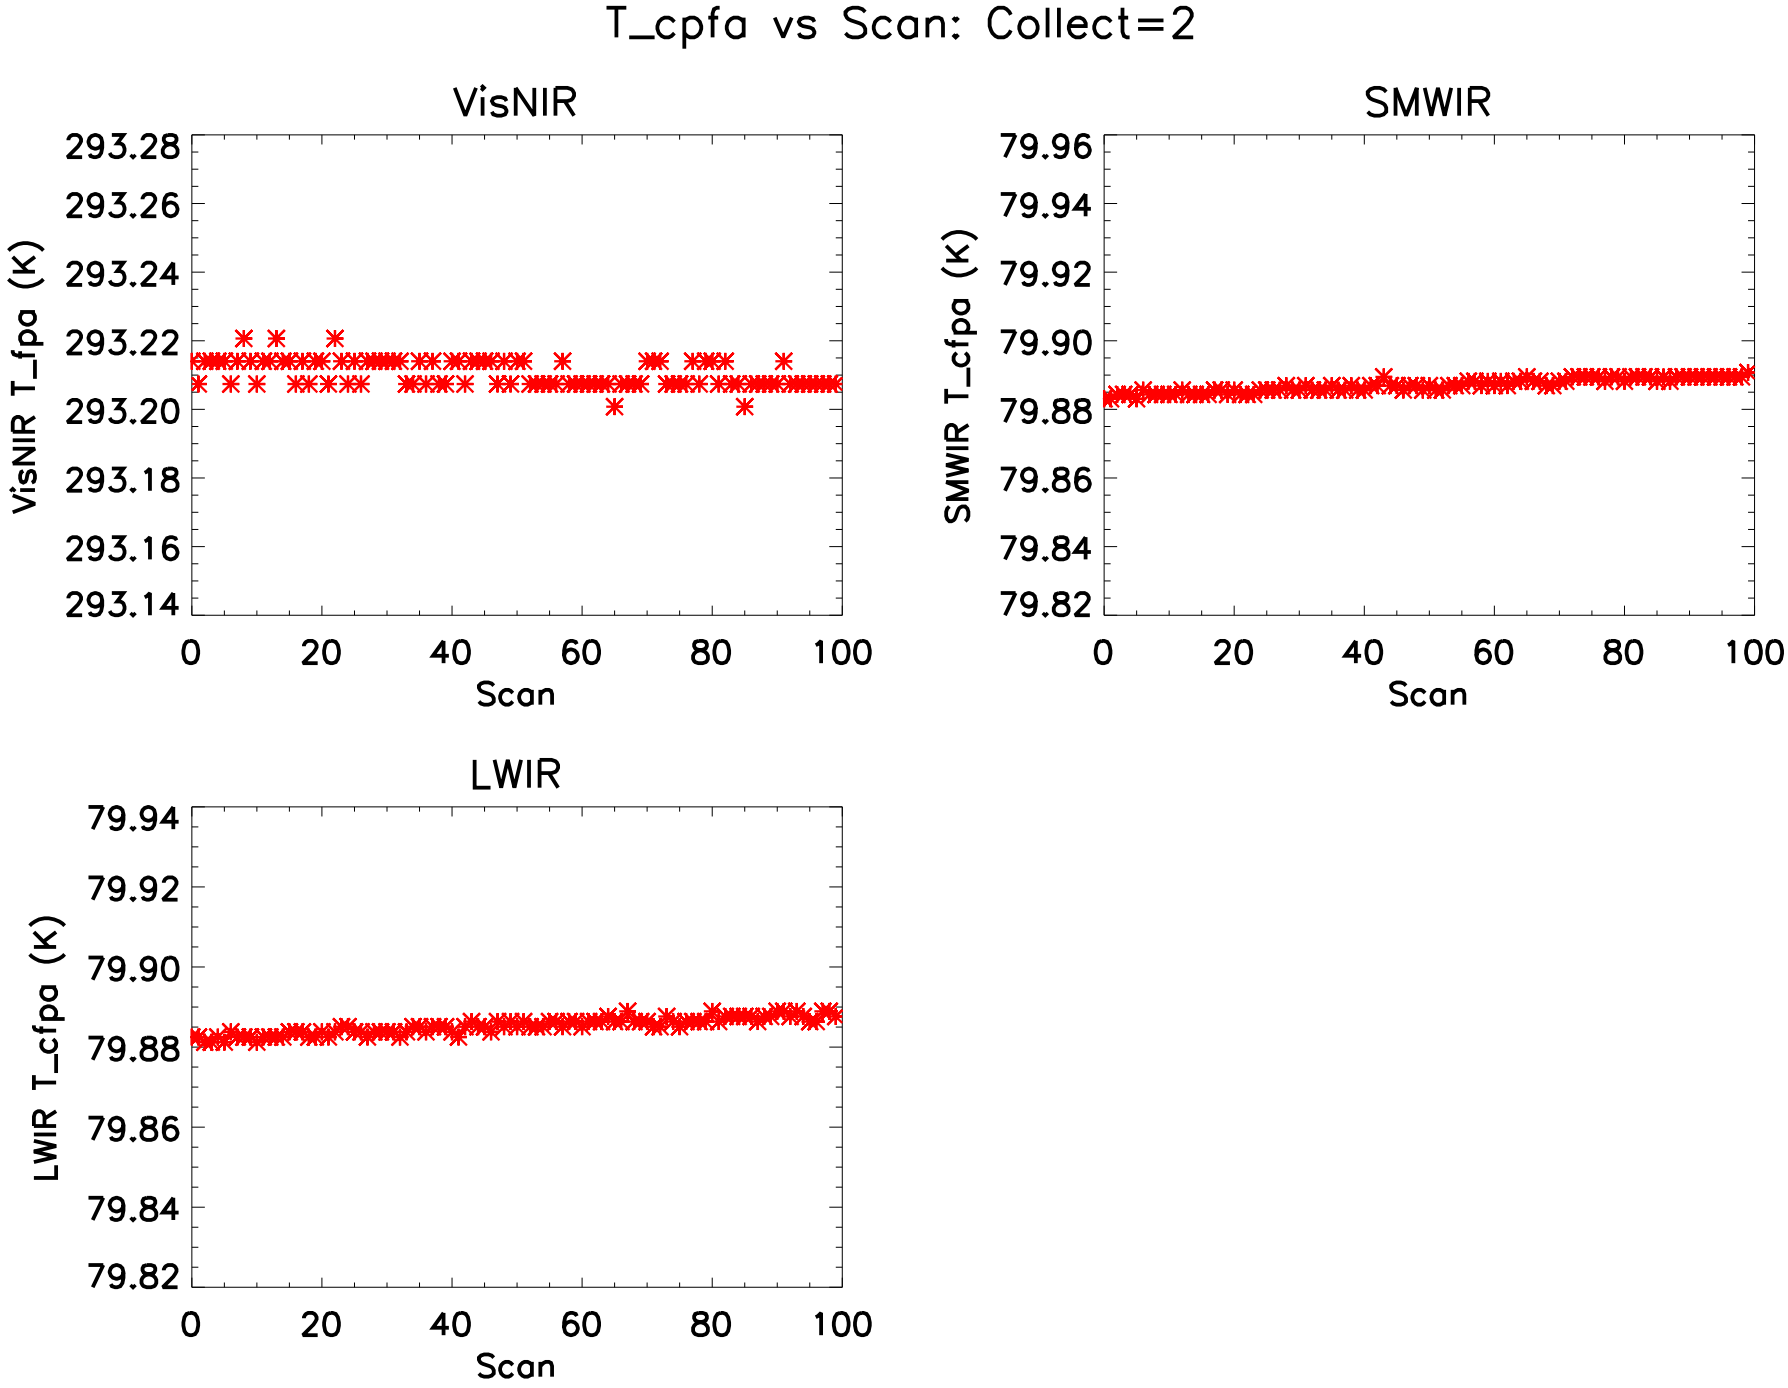
T_cpfa vs Scan: Collect=2
VisNIR
VisNIR T_fpa (K)
293.28
293.26
293.24
293.22
293.20
293.18
293.16
293.14
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan

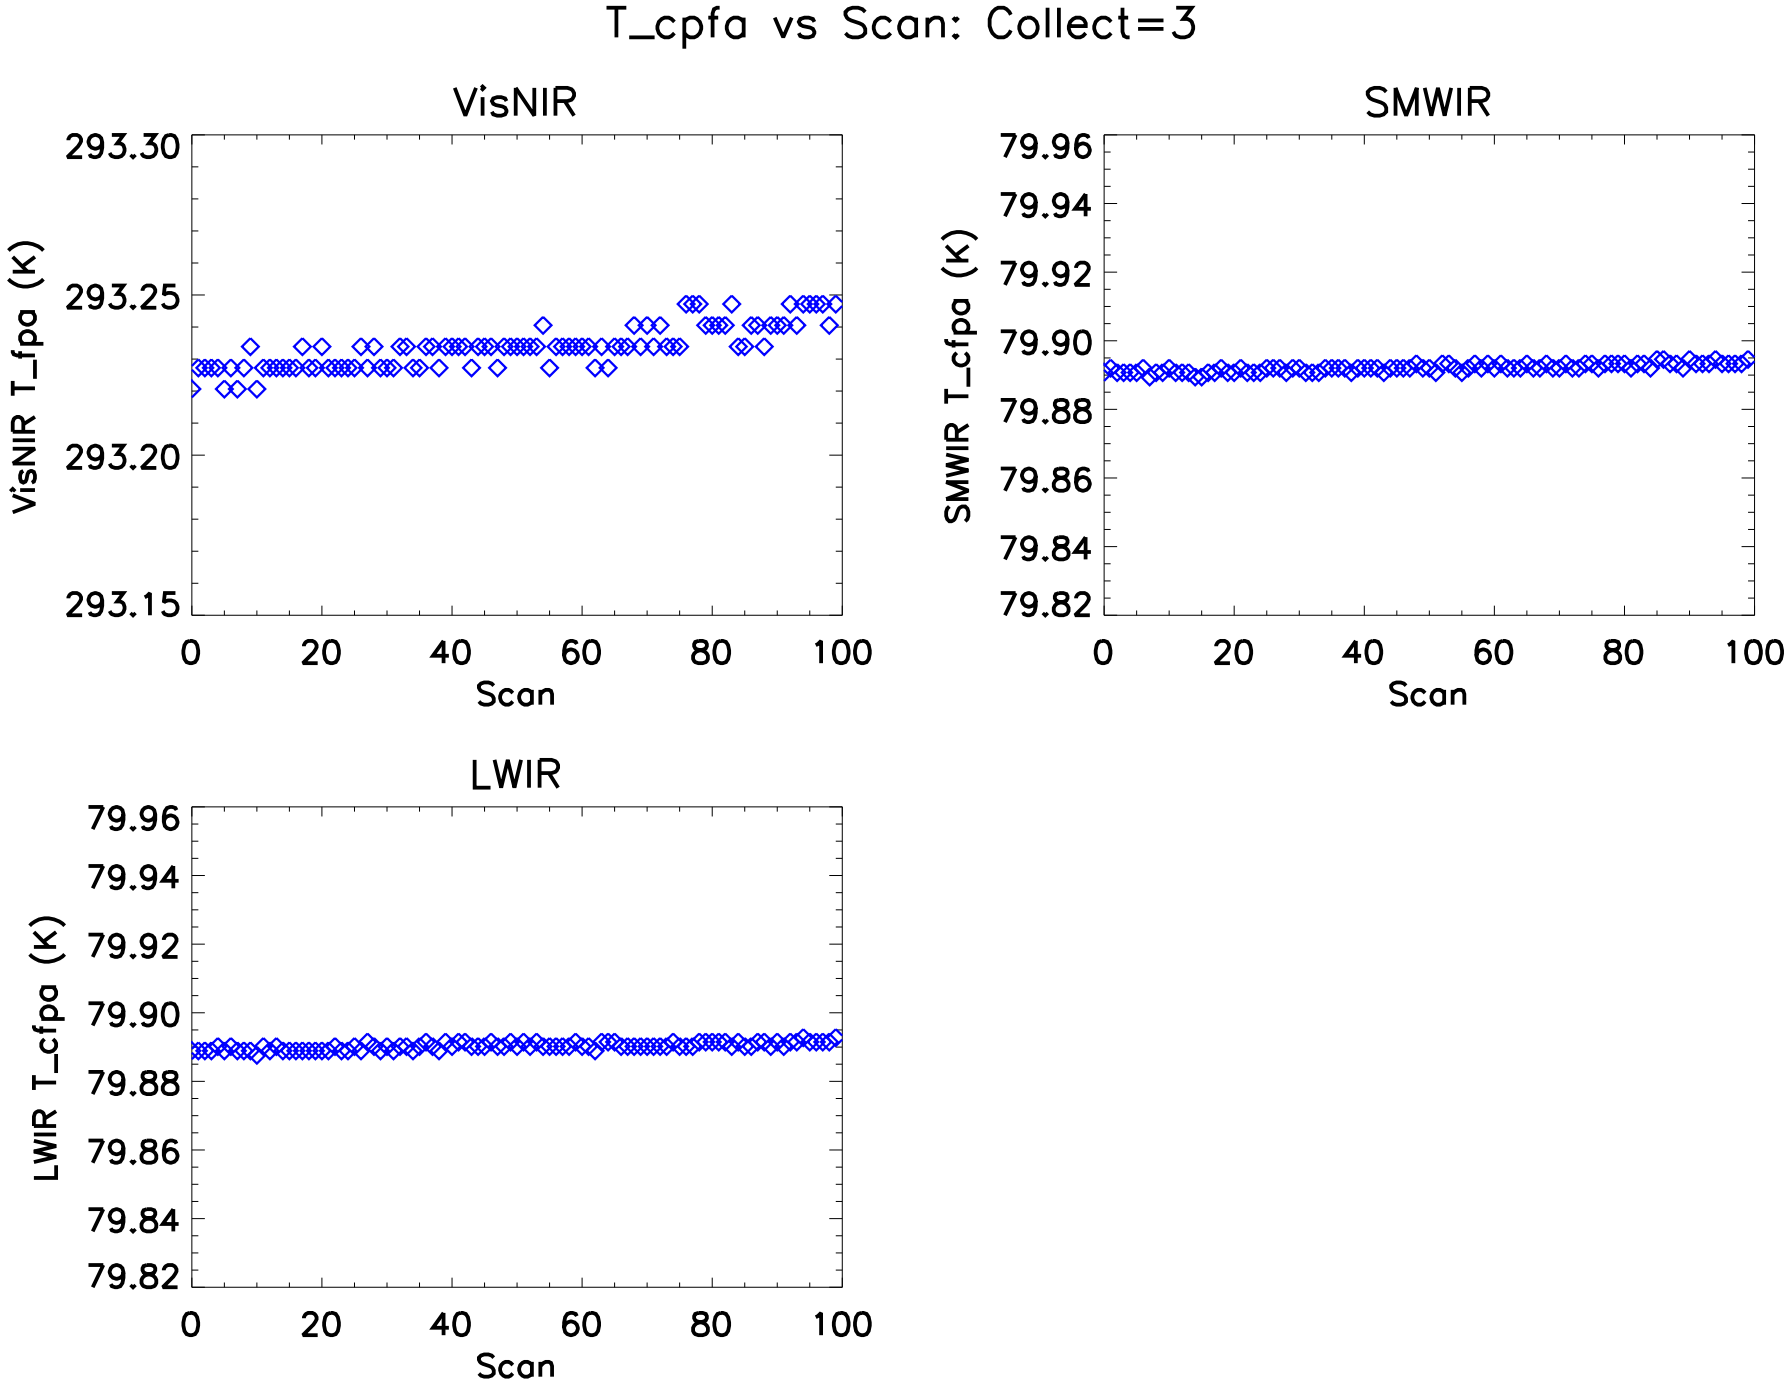
T_cpfa vs Scan: Collect=3
VisNIR
VisNIR T_fpa (K)
293.30
293.25
293.20
293.15
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan

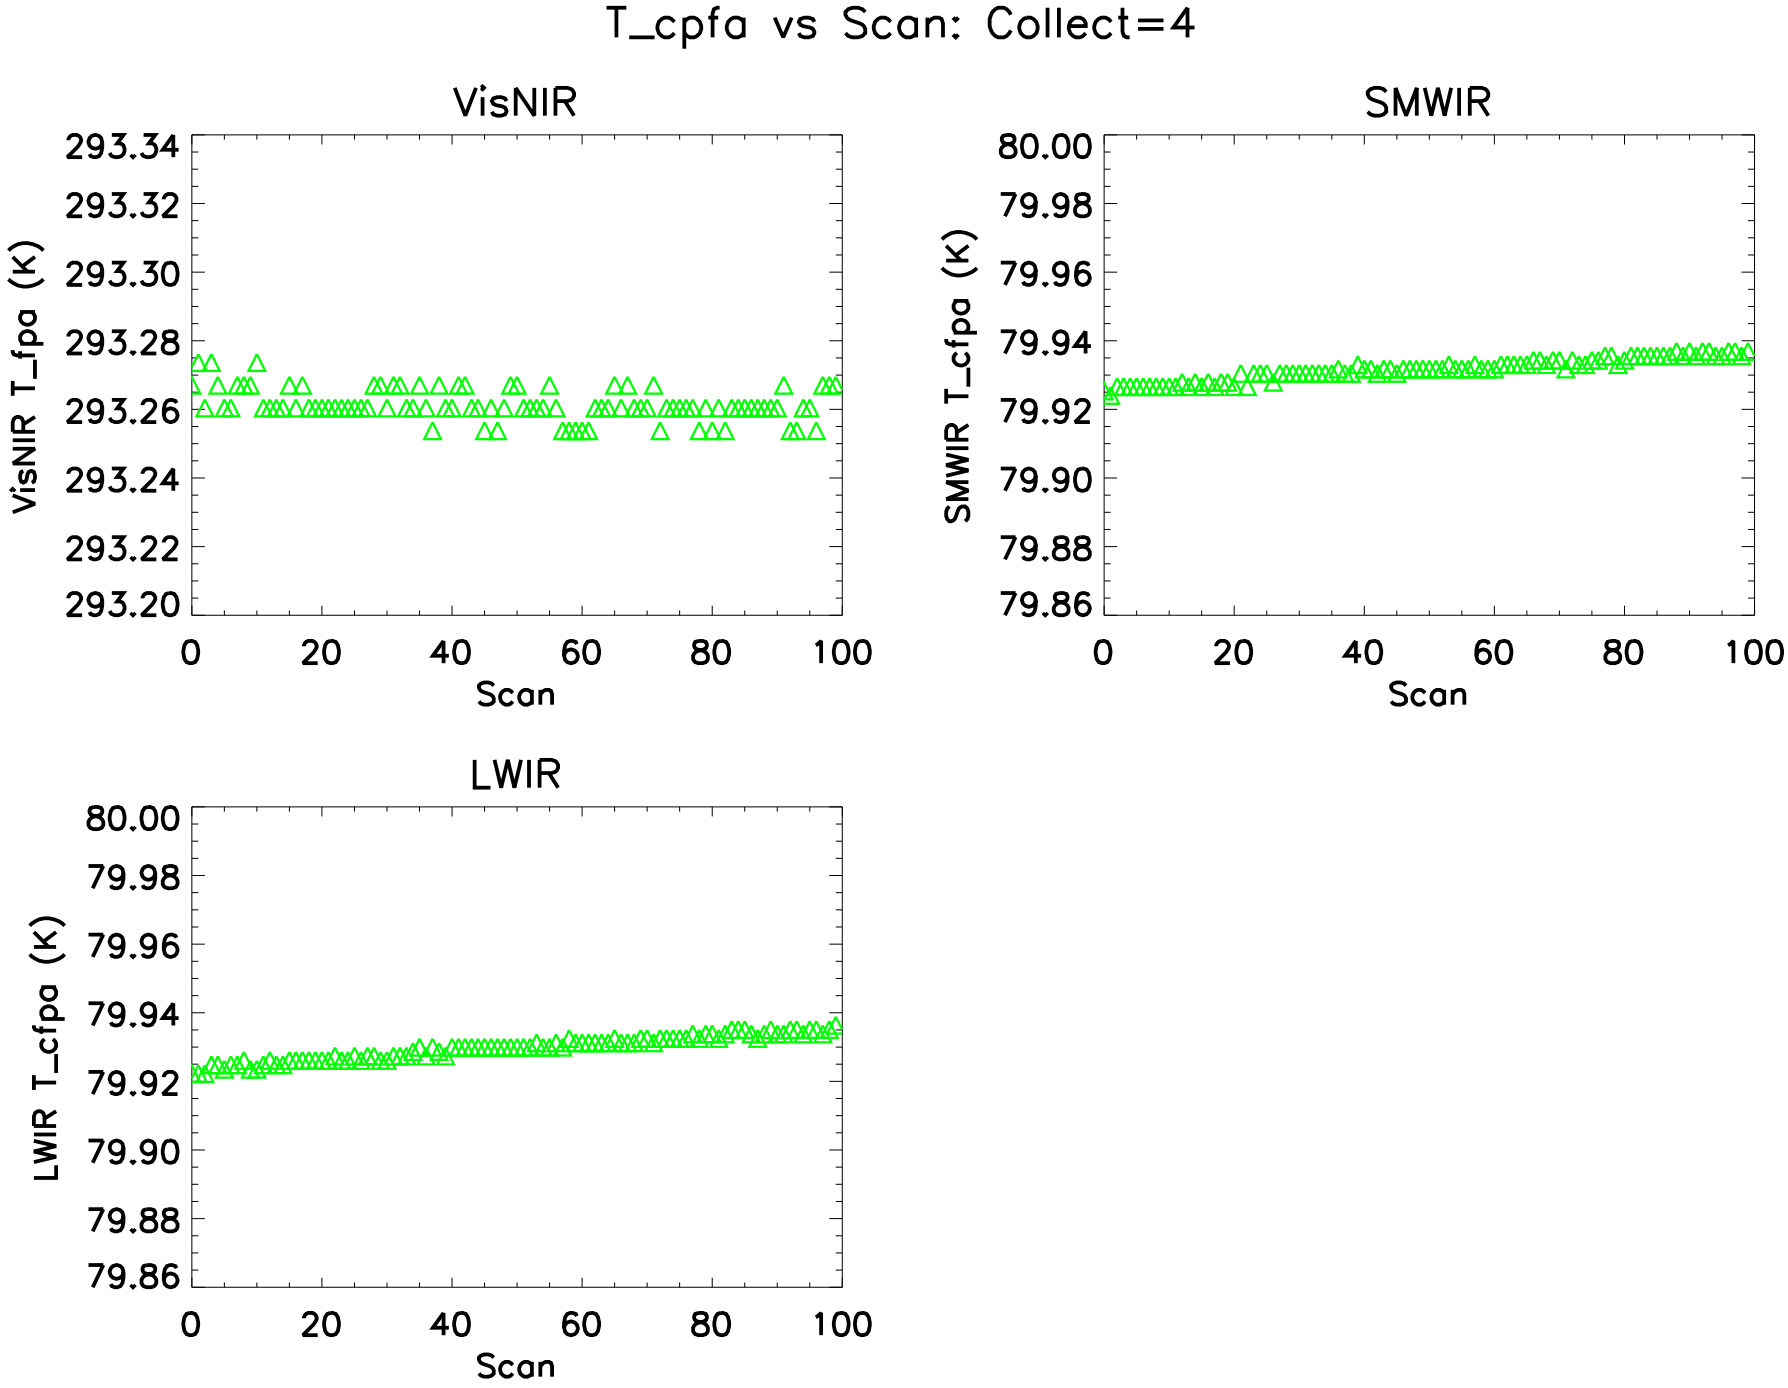
T_cpfa vs Scan: Collect=4
VisNIR
VisNIR T_fpa (K)
293.34
293.32
293.30
293.28
293.26
293.24
293.22
293.20
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
79.86
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
79.86
0
20
40
60
80
100
Scan

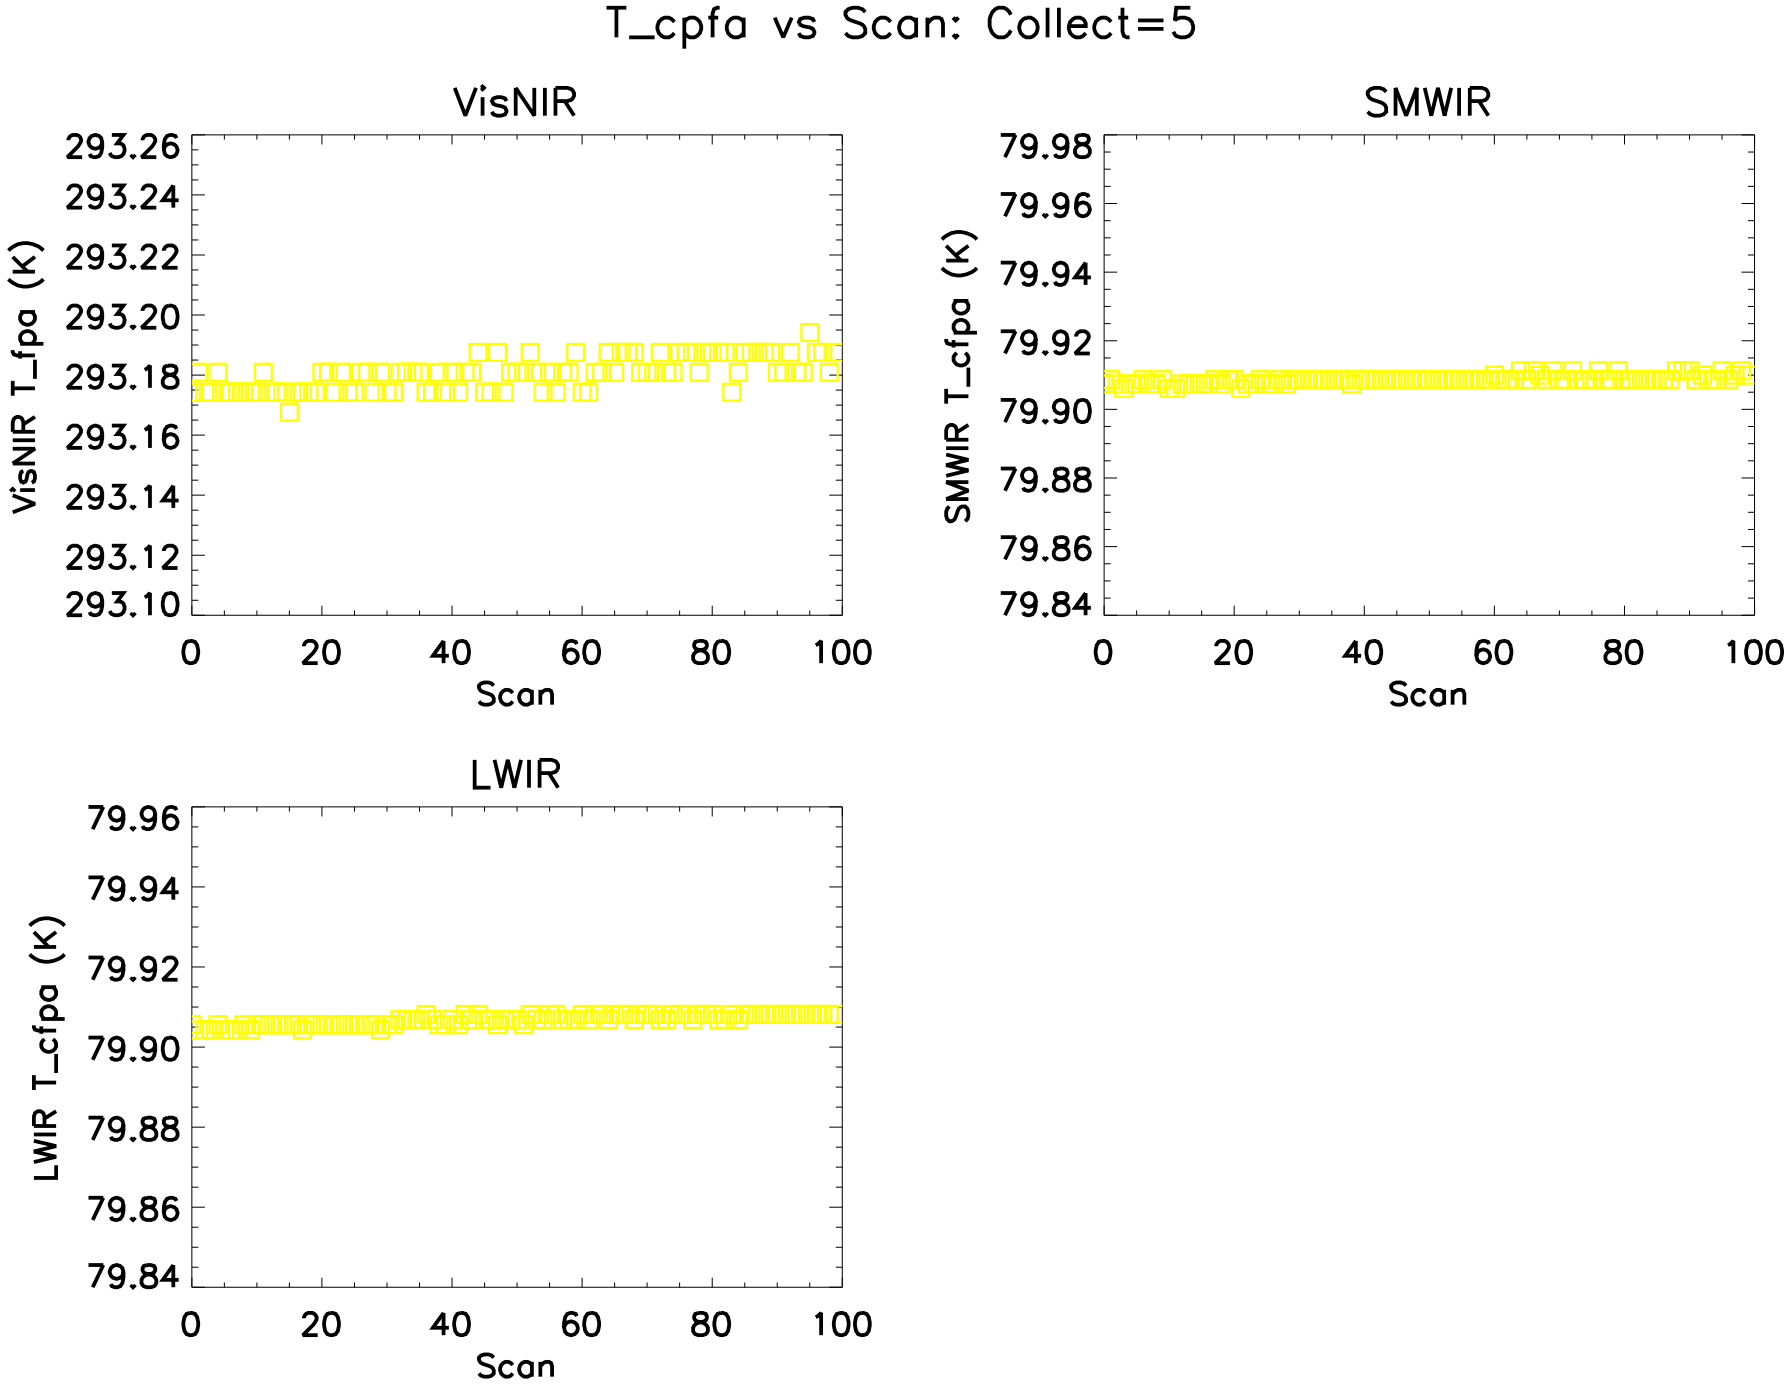
T_cpfa vs Scan: Collect=5
VisNIR
VisNIR T_fpa (K)
293.26
293.24
293.22
293.20
293.18
293.16
293.14
293.12
293.10
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.98
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan

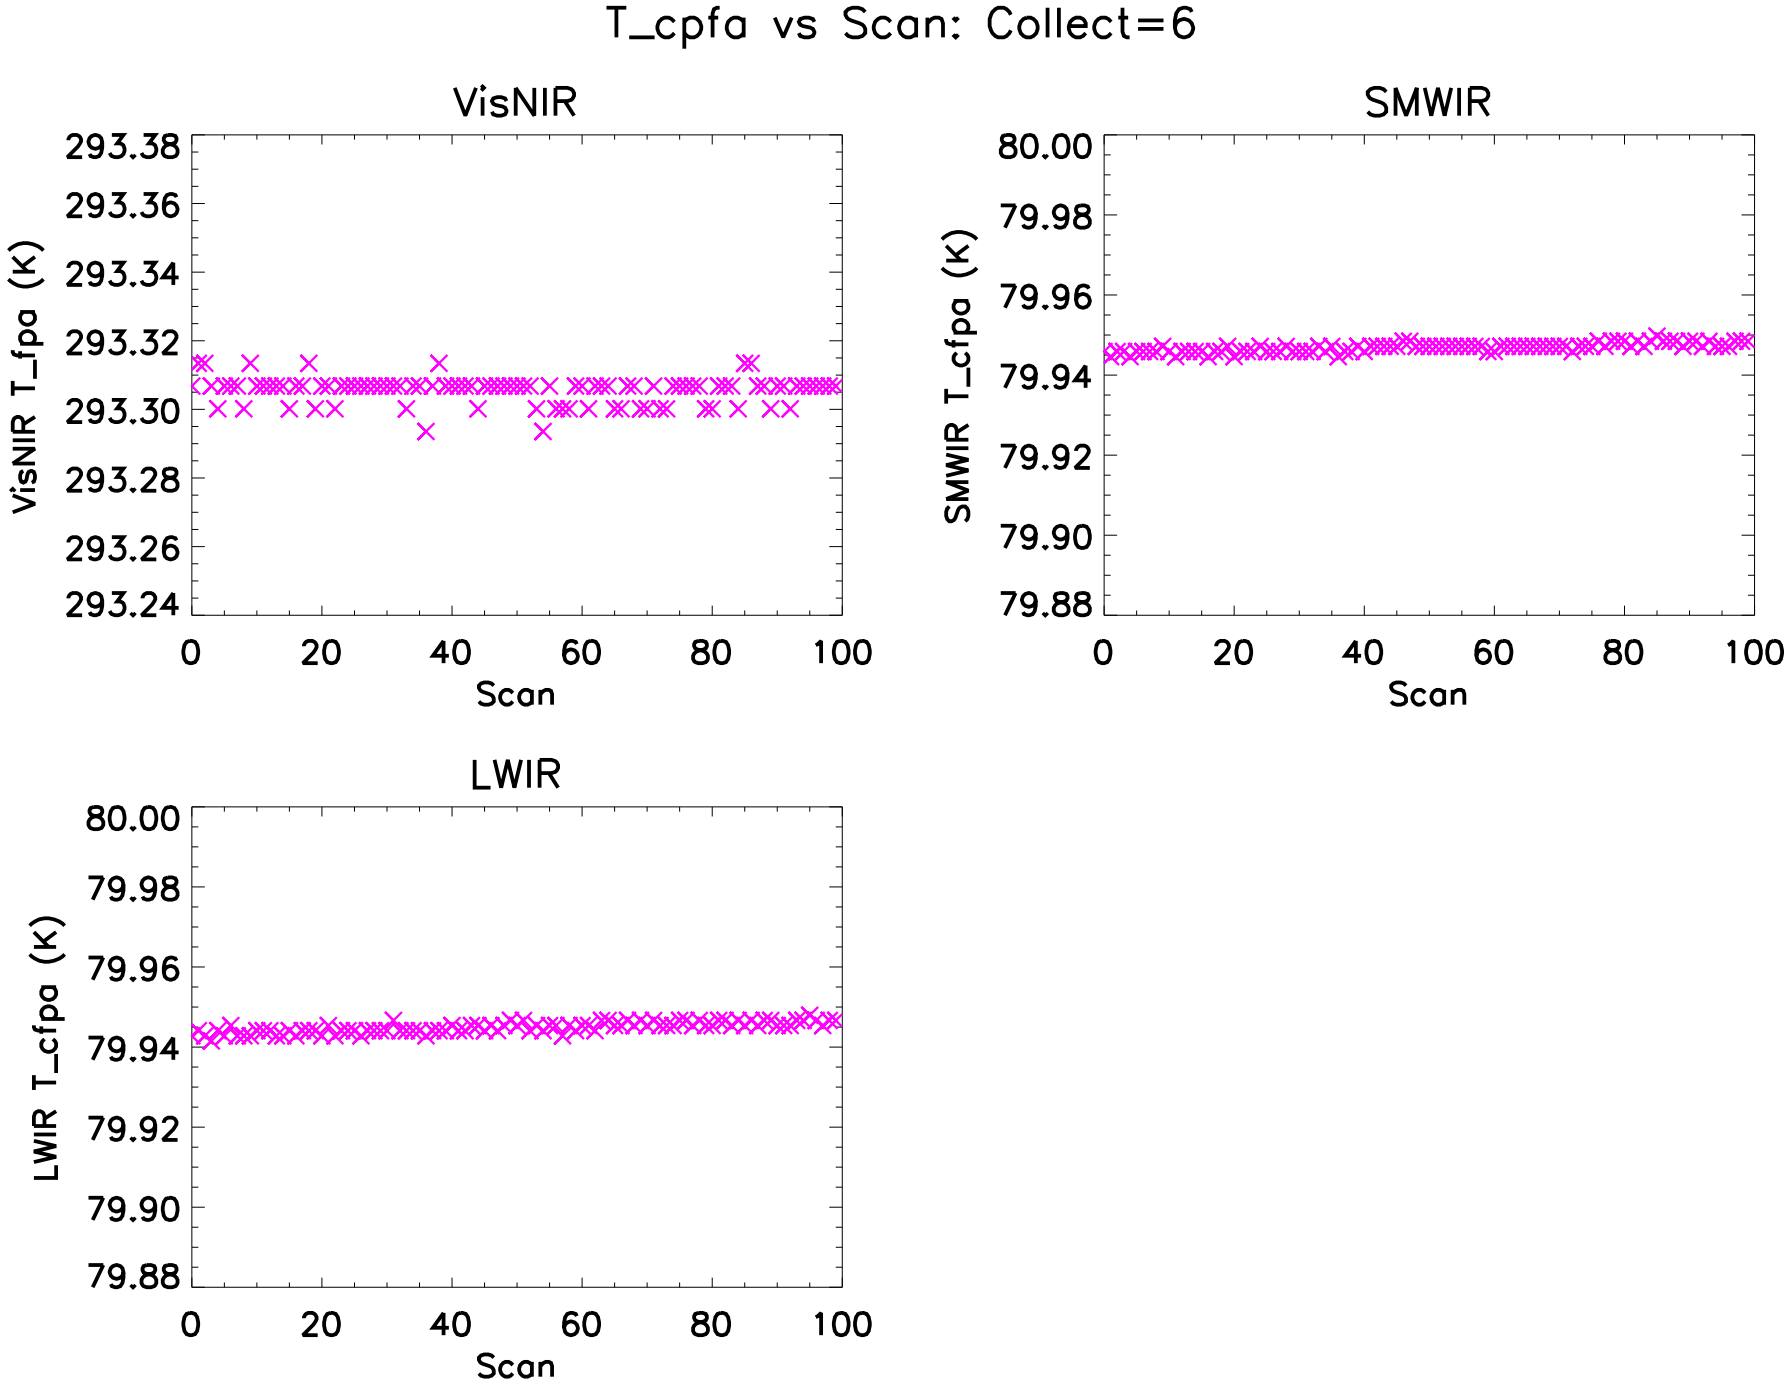
T_cpfa vs Scan: Collect=6
VisNIR
VisNIR T_fpa (K)
293.38
293.36
293.34
293.32
293.30
293.28
293.26
293.24
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
0
20
40
60
80
100
Scan

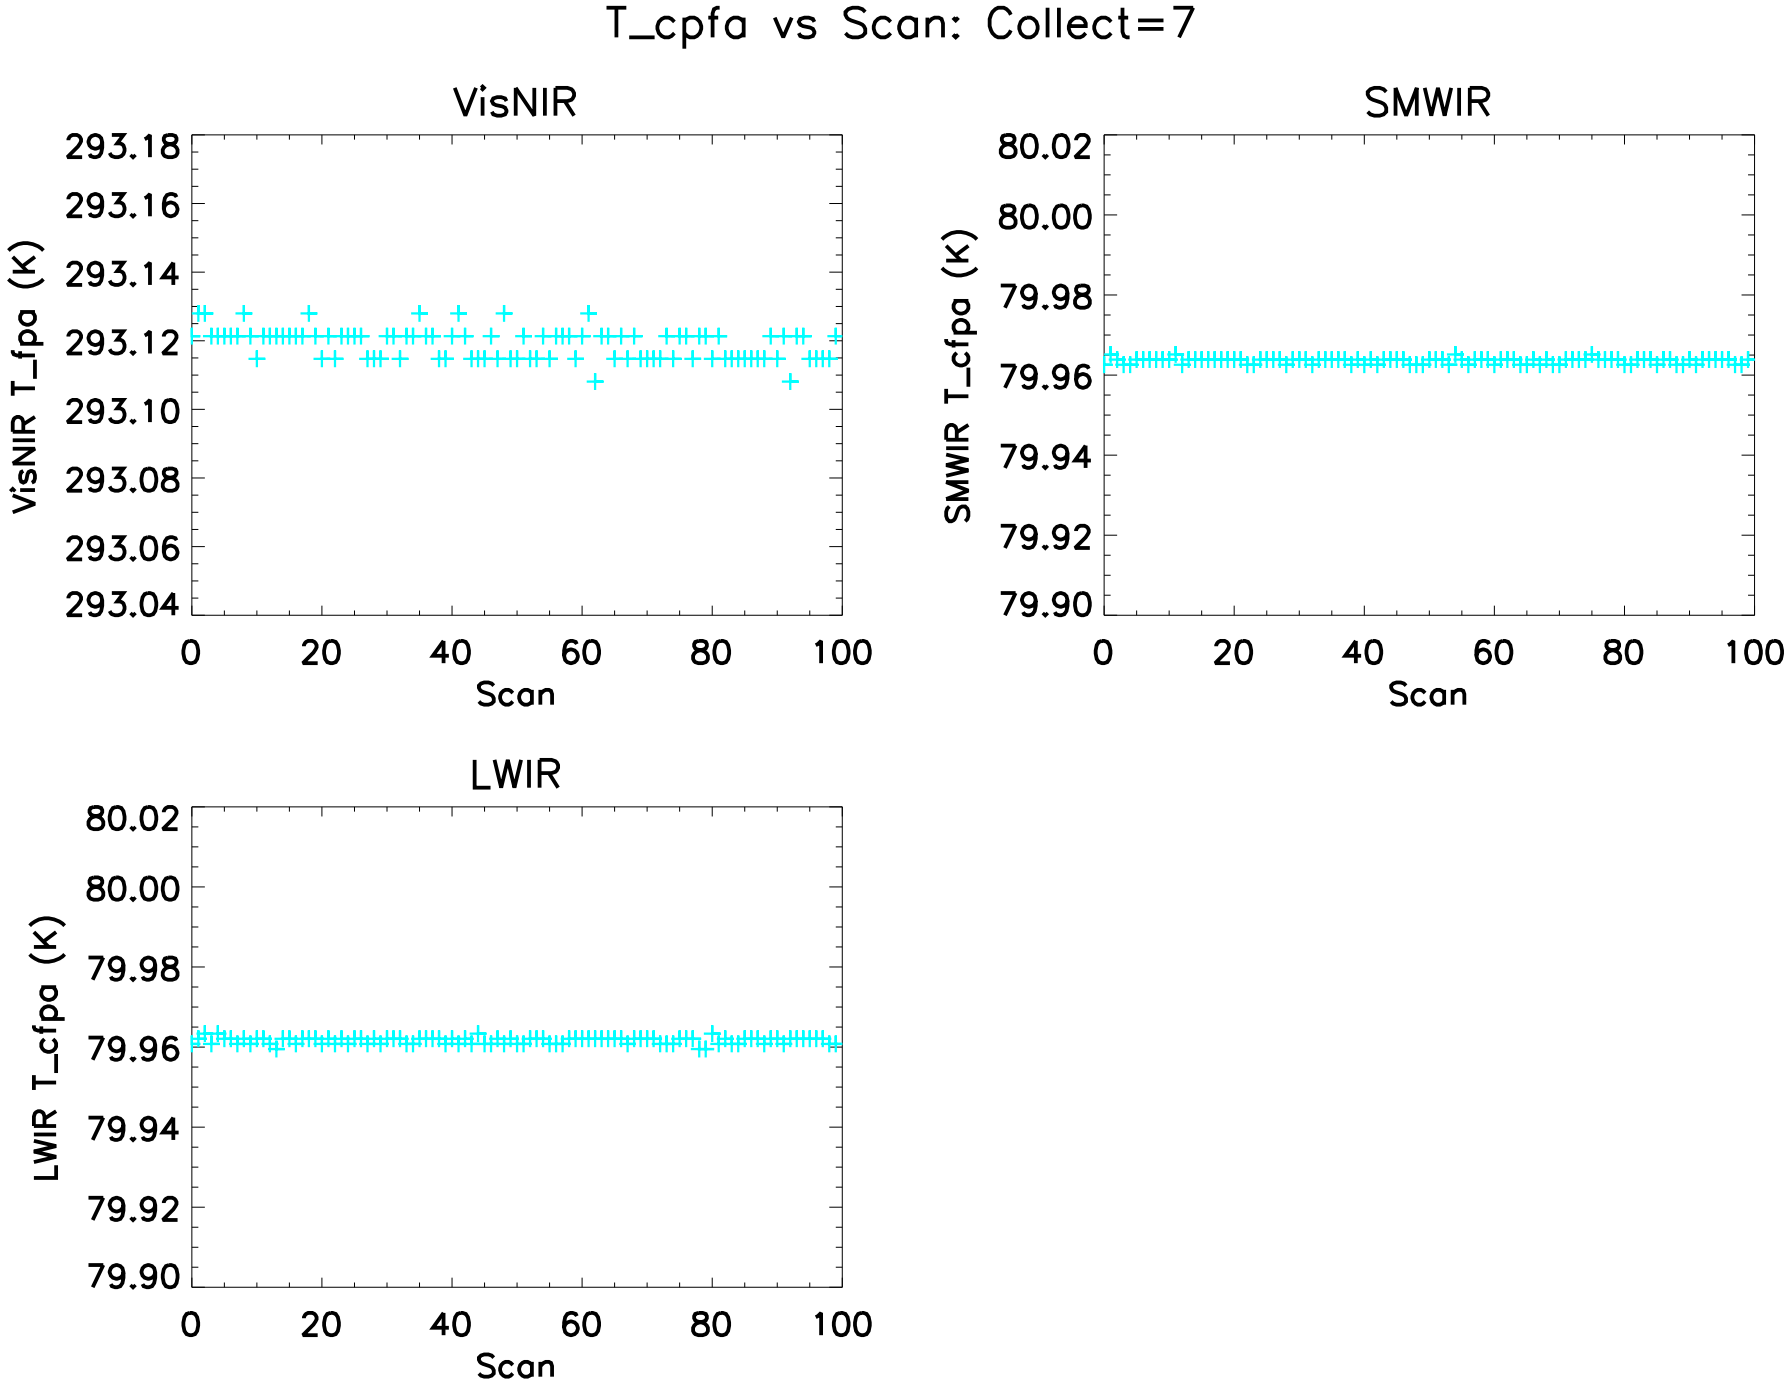
T_cpfa vs Scan: Collect=7
VisNIR
VisNIR T_fpa (K)
293.18
293.16
293.14
293.12
293.10
293.08
293.06
293.04
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
80.02
80.00
79.98
79.96
79.94
79.92
79.90
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
80.02
80.00
79.98
79.96
79.94
79.92
79.90
0
20
40
60
80
100
Scan

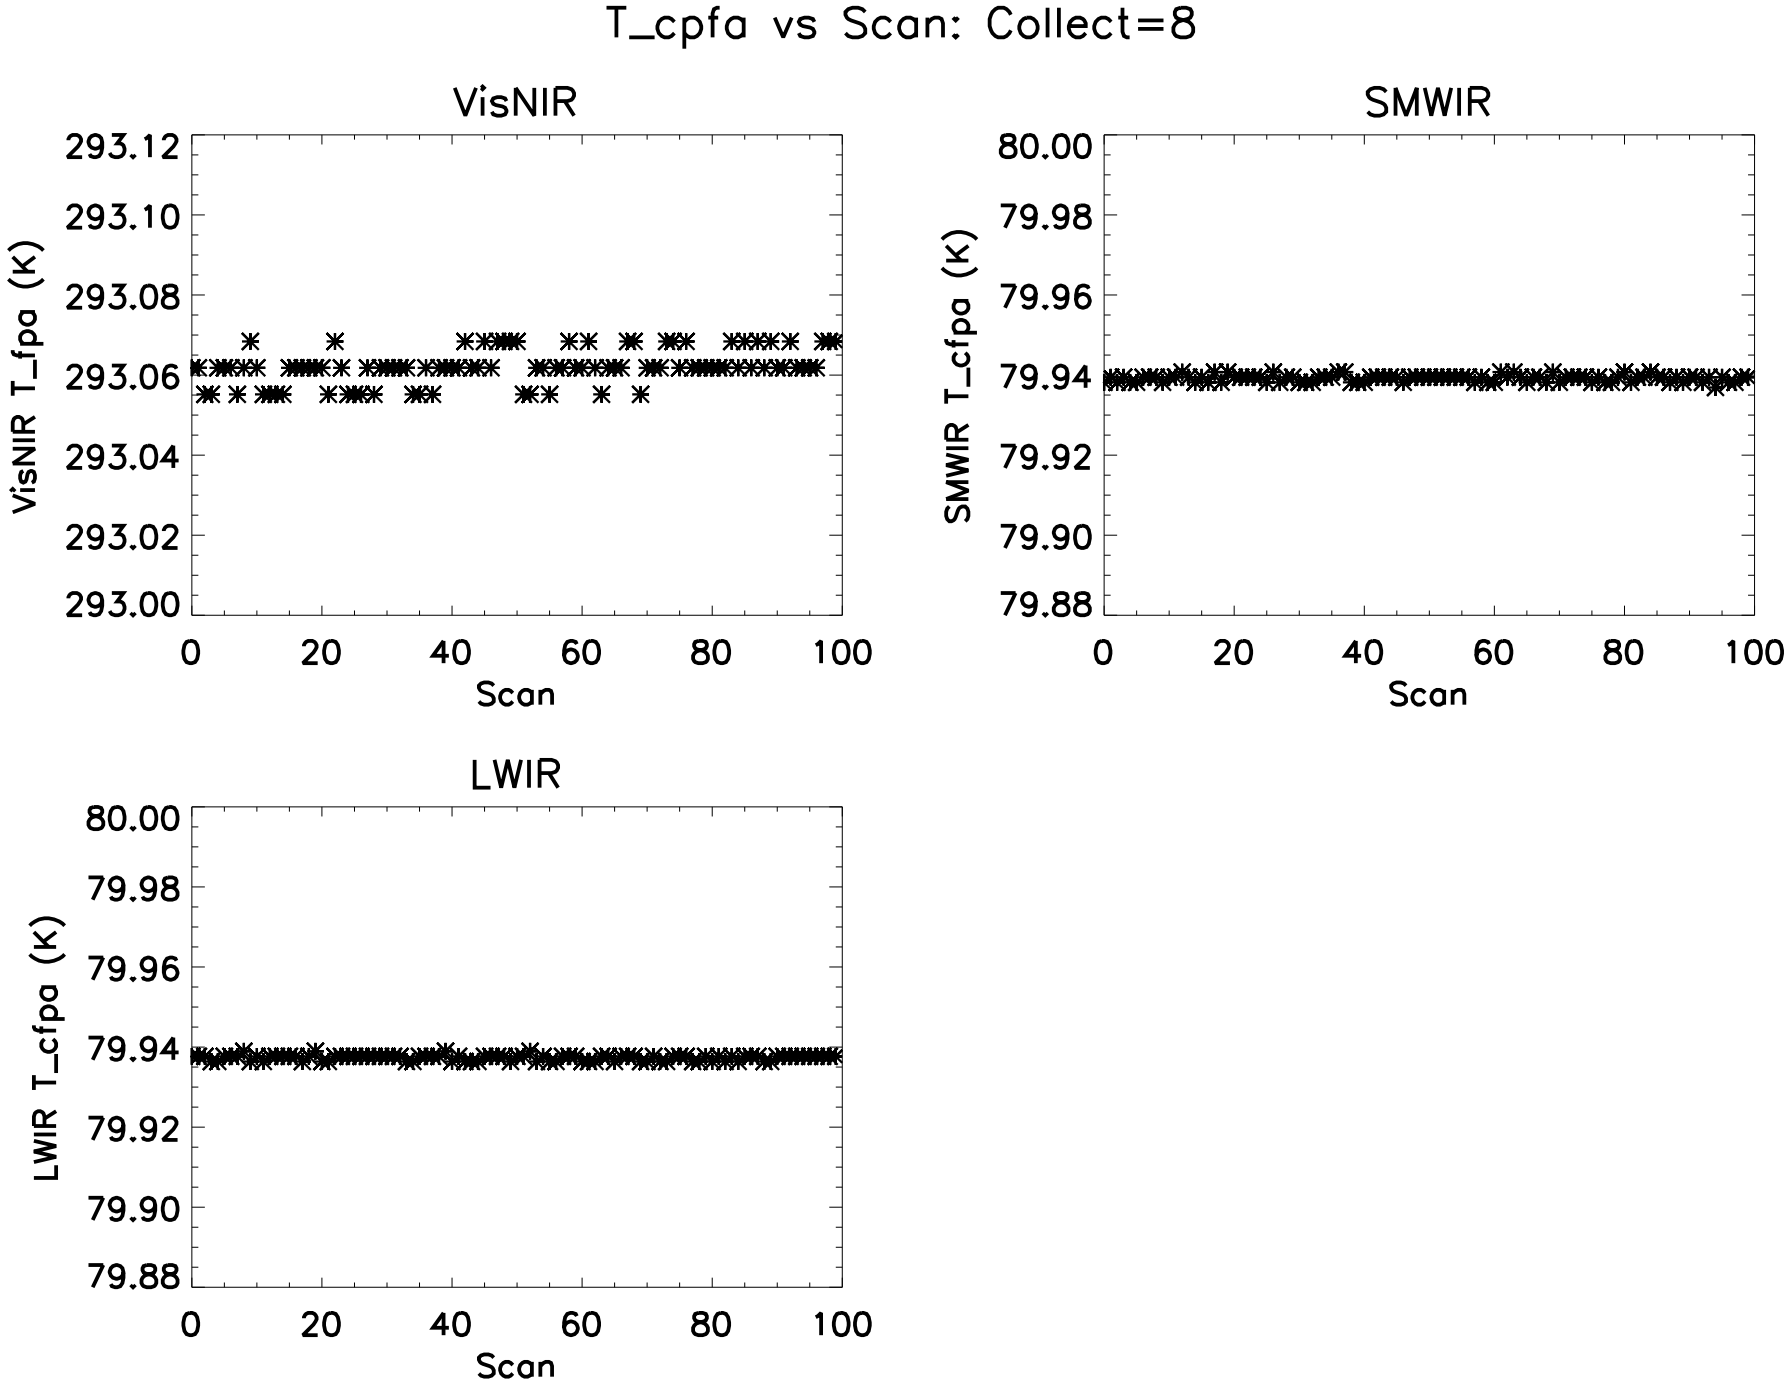
T_cpfa vs Scan: Collect=8
VisNIR
VisNIR T_fpa (K)
293.12
293.10
293.08
293.06
293.04
293.02
293.00
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
80.00
79.98
79.96
79.94
79.92
79.90
79.88
0
20
40
60
80
100
Scan

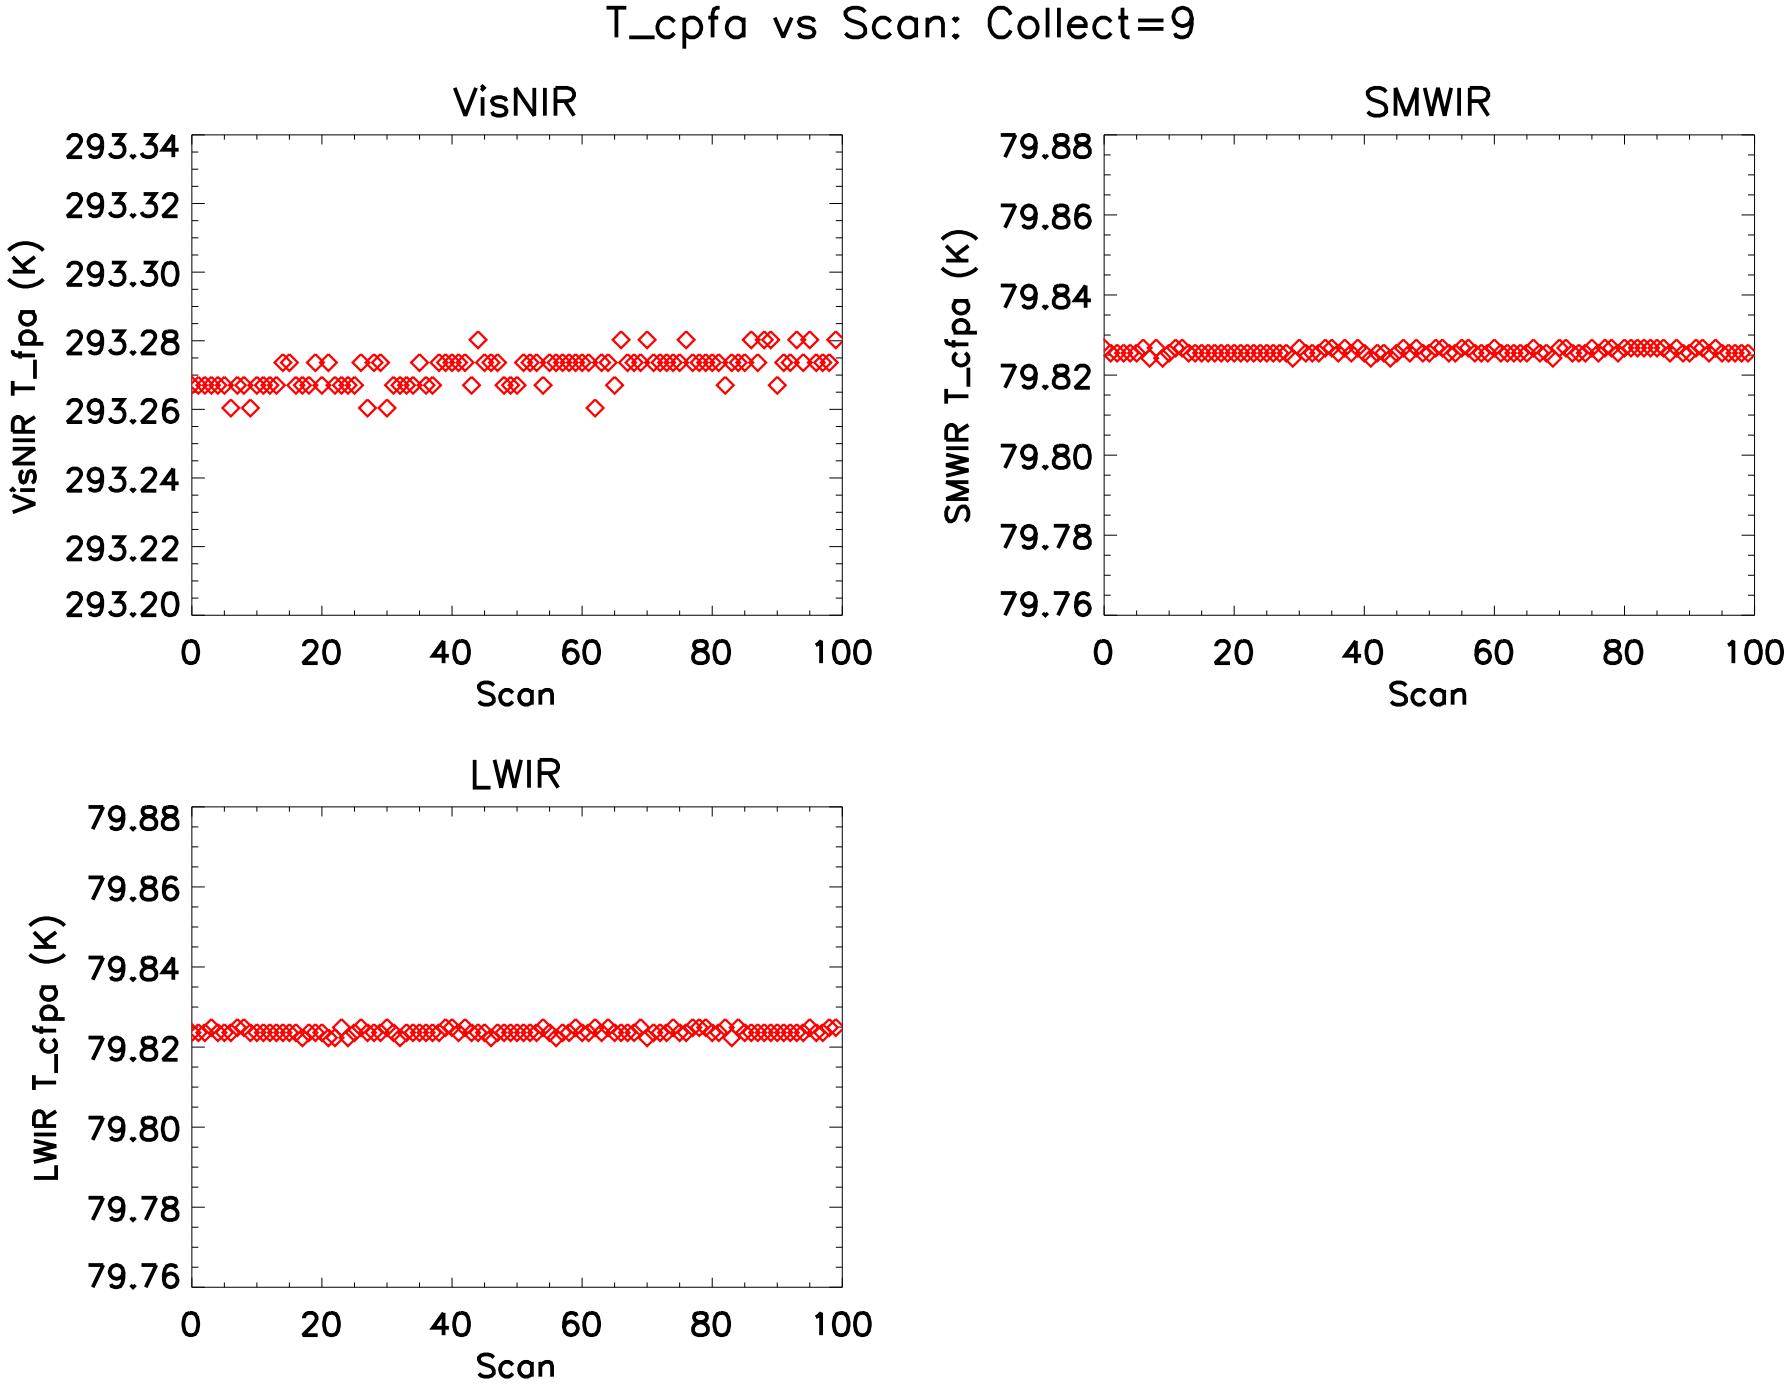
T_cpfa vs Scan: Collect=9
VisNIR
VisNIR T_fpa (K)
293.34
293.32
293.30
293.28
293.26
293.24
293.22
293.20
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan

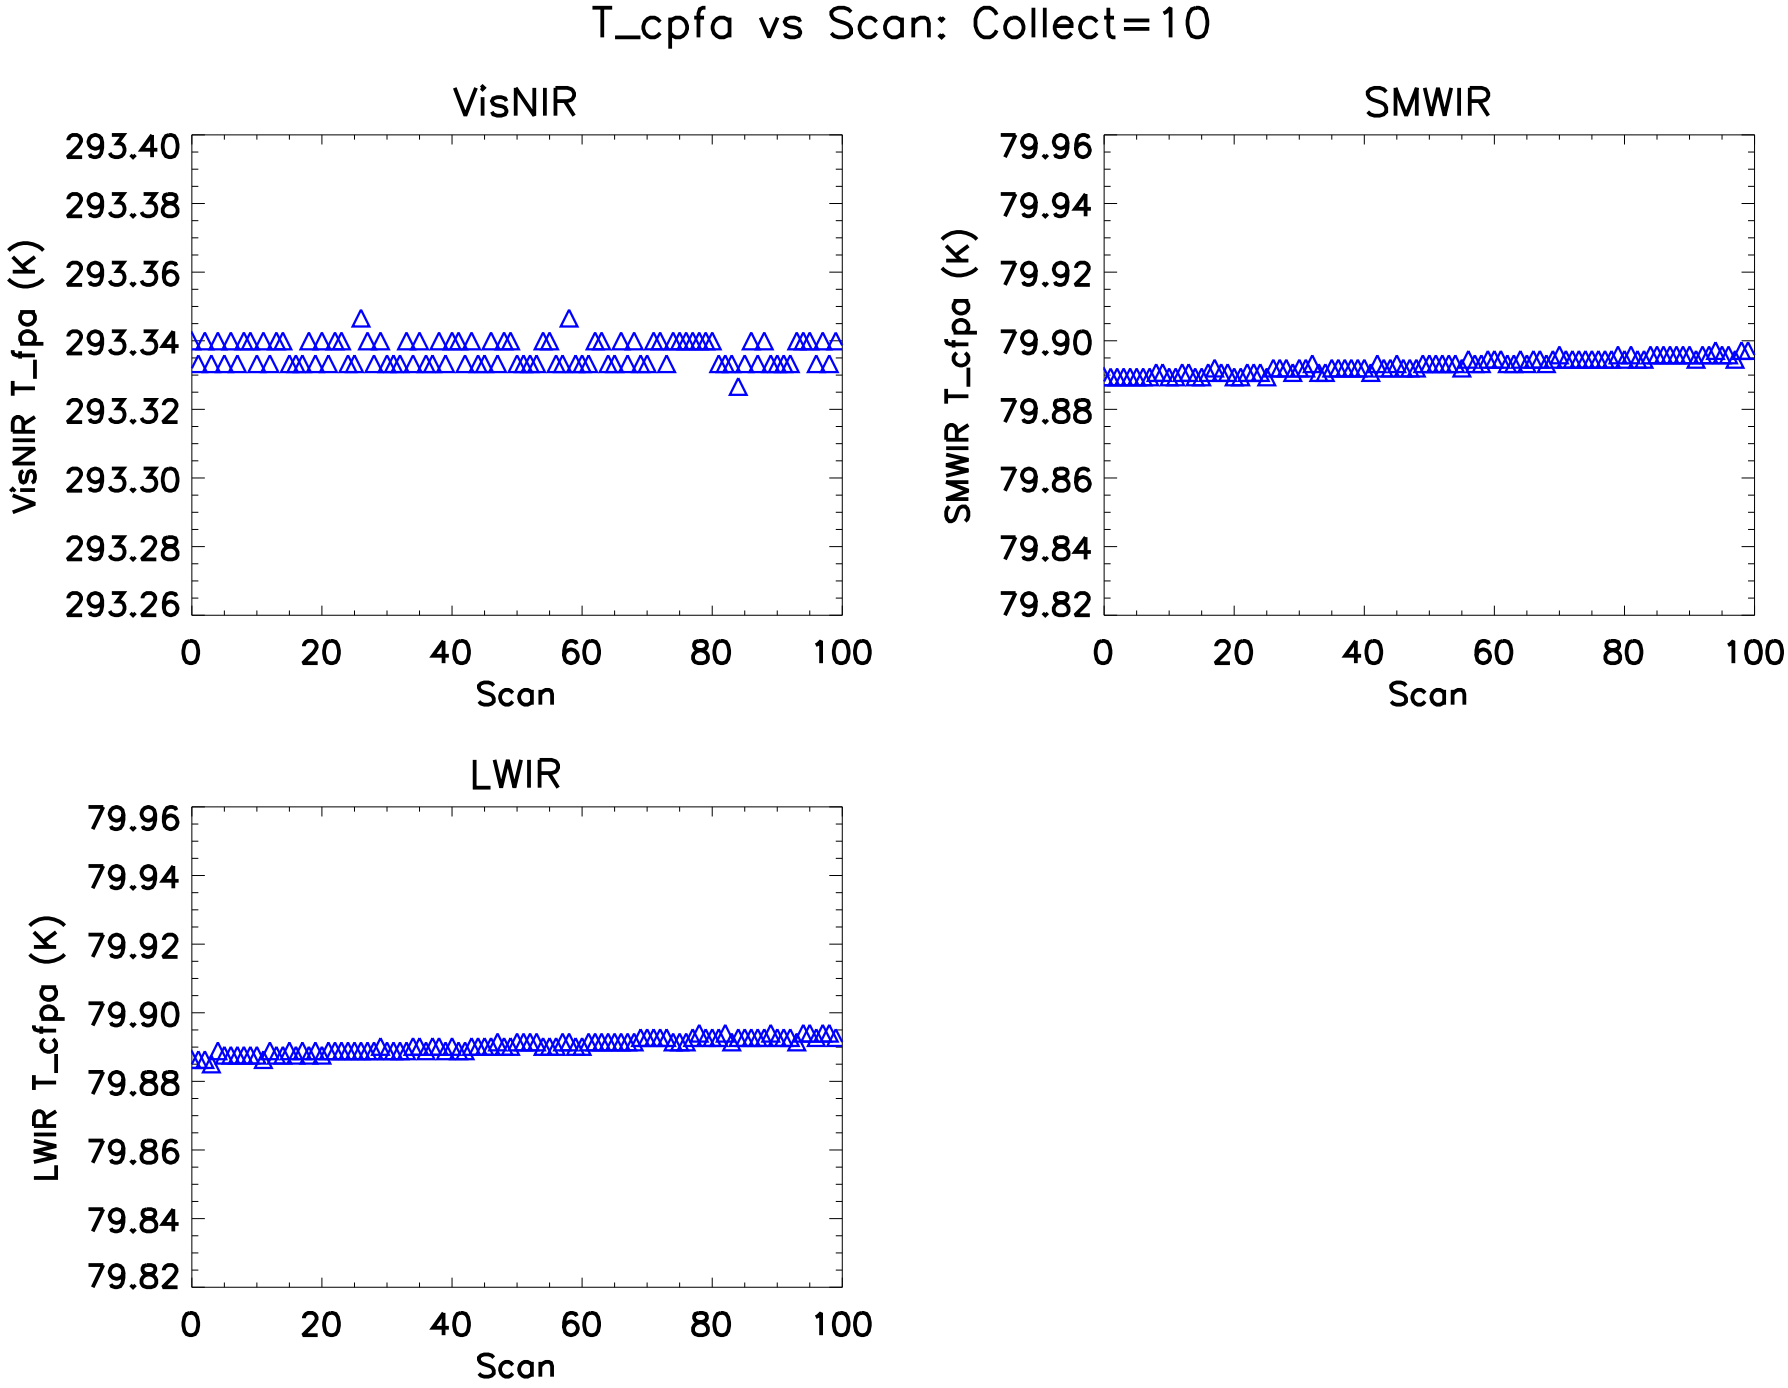
T_cpfa vs Scan: Collect=10
VisNIR
VisNIR T_fpa (K)
293.40
293.38
293.36
293.34
293.32
293.30
293.28
293.26
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
79.82
0
20
40
60
80
100
Scan

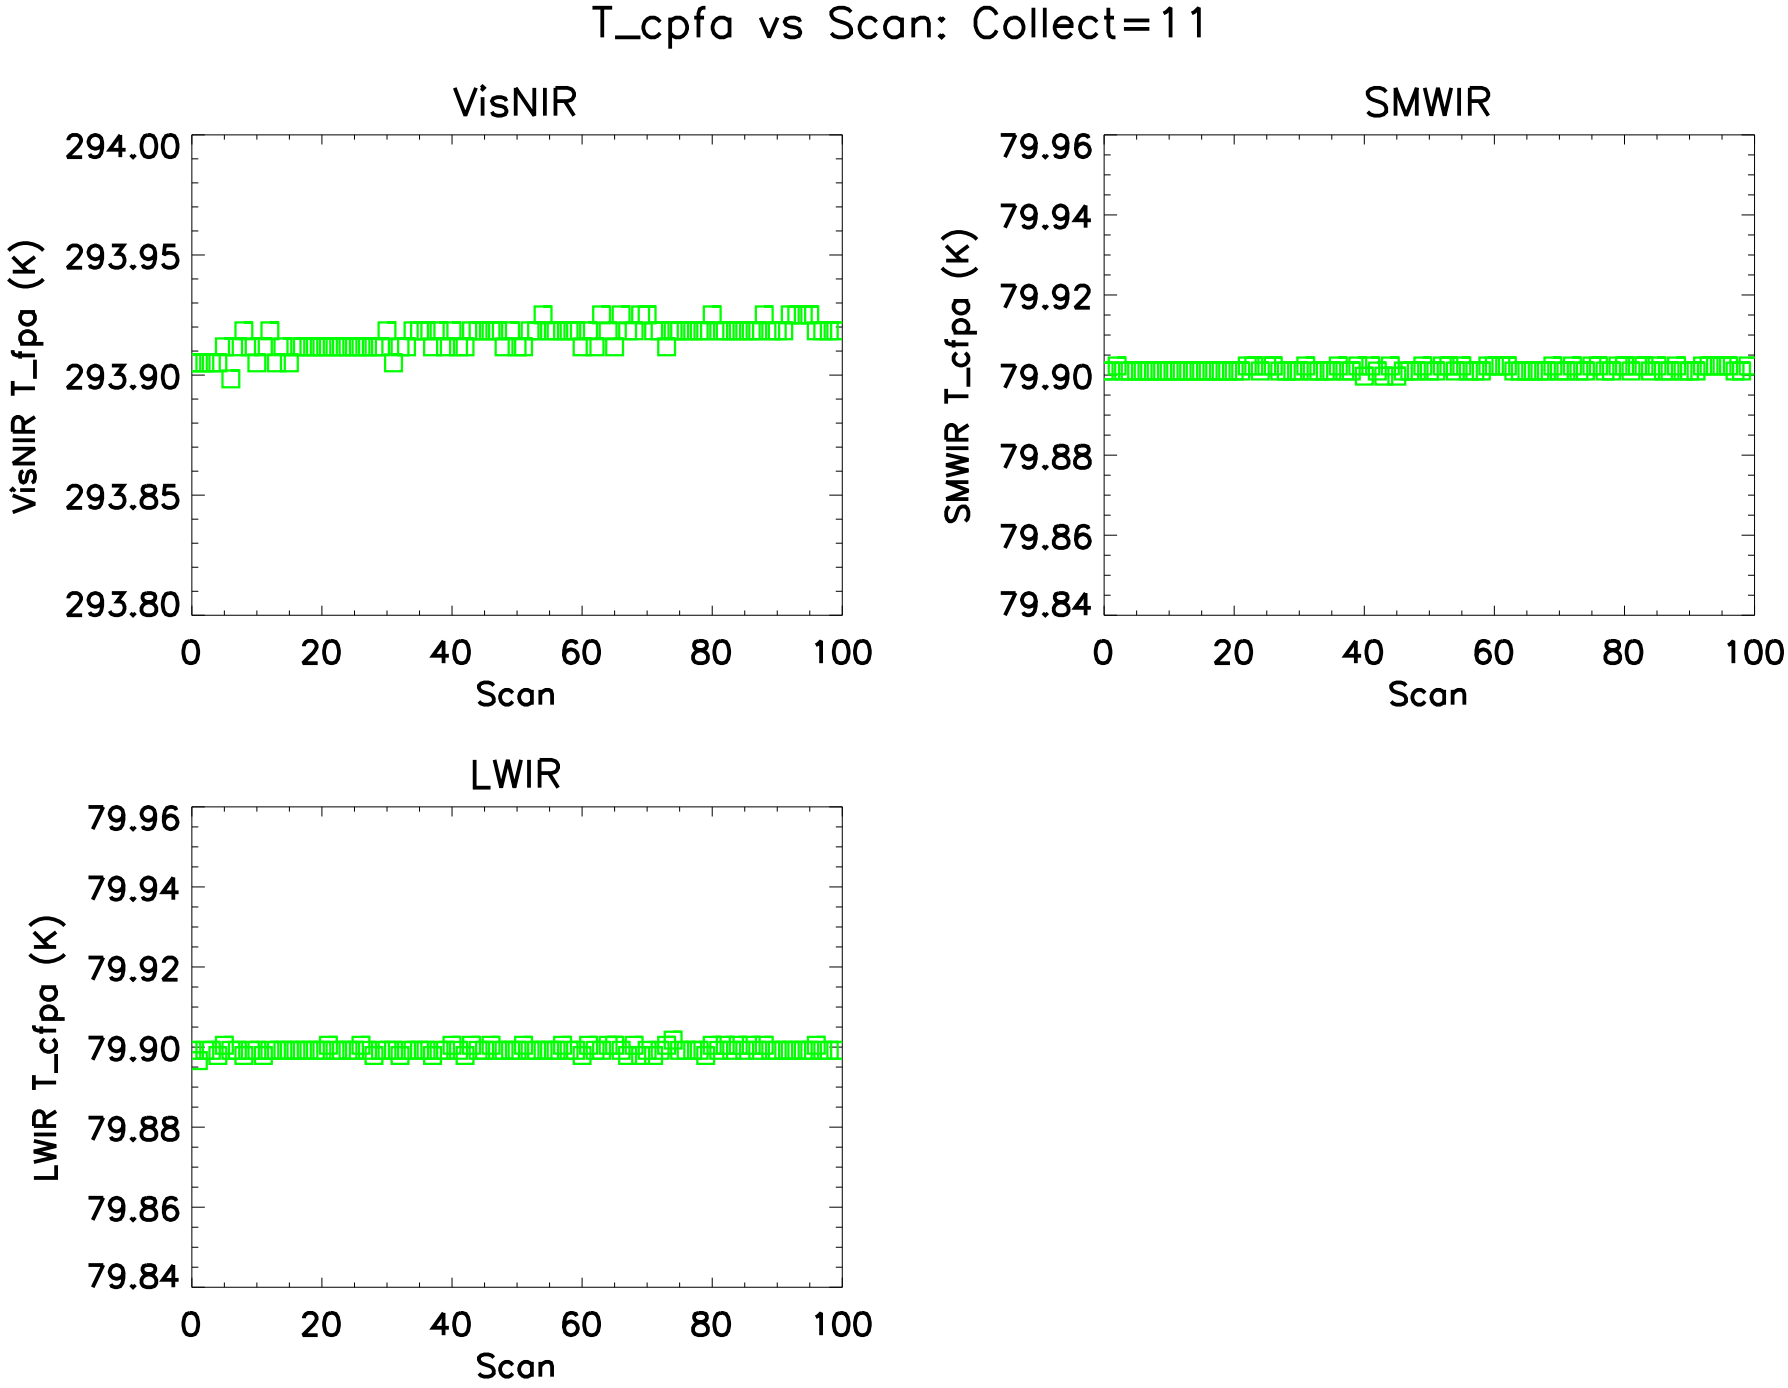
T_cpfa vs Scan: Collect=11
VisNIR
VisNIR T_fpa (K)
294.00
293.95
293.90
293.85
293.80
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.96
79.94
79.92
79.90
79.88
79.86
79.84
0
20
40
60
80
100
Scan

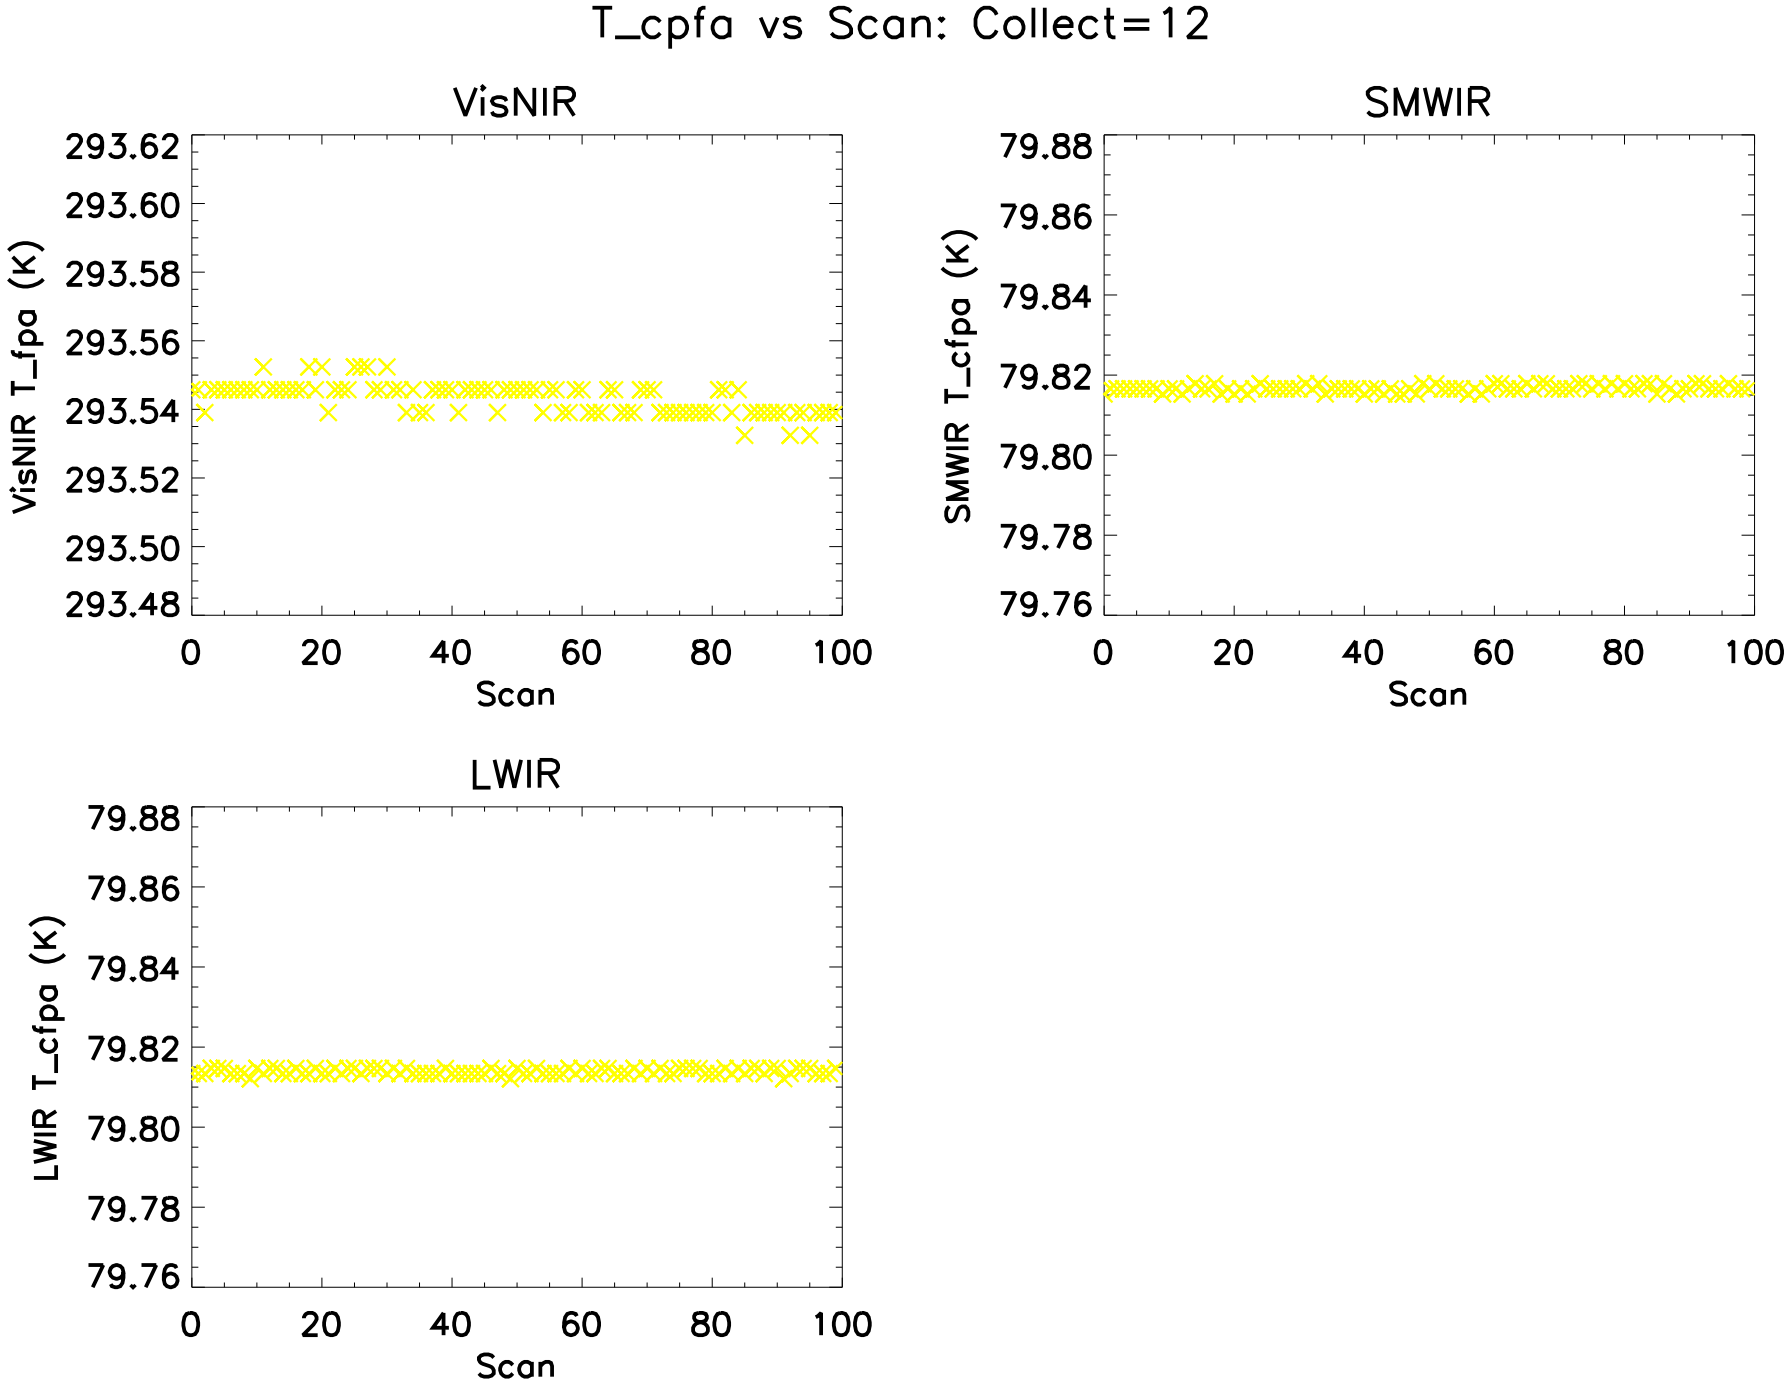
T_cpfa vs Scan: Collect=12
VisNIR
VisNIR T_fpa (K)
293.62
293.60
293.58
293.56
293.54
293.52
293.50
293.48
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan

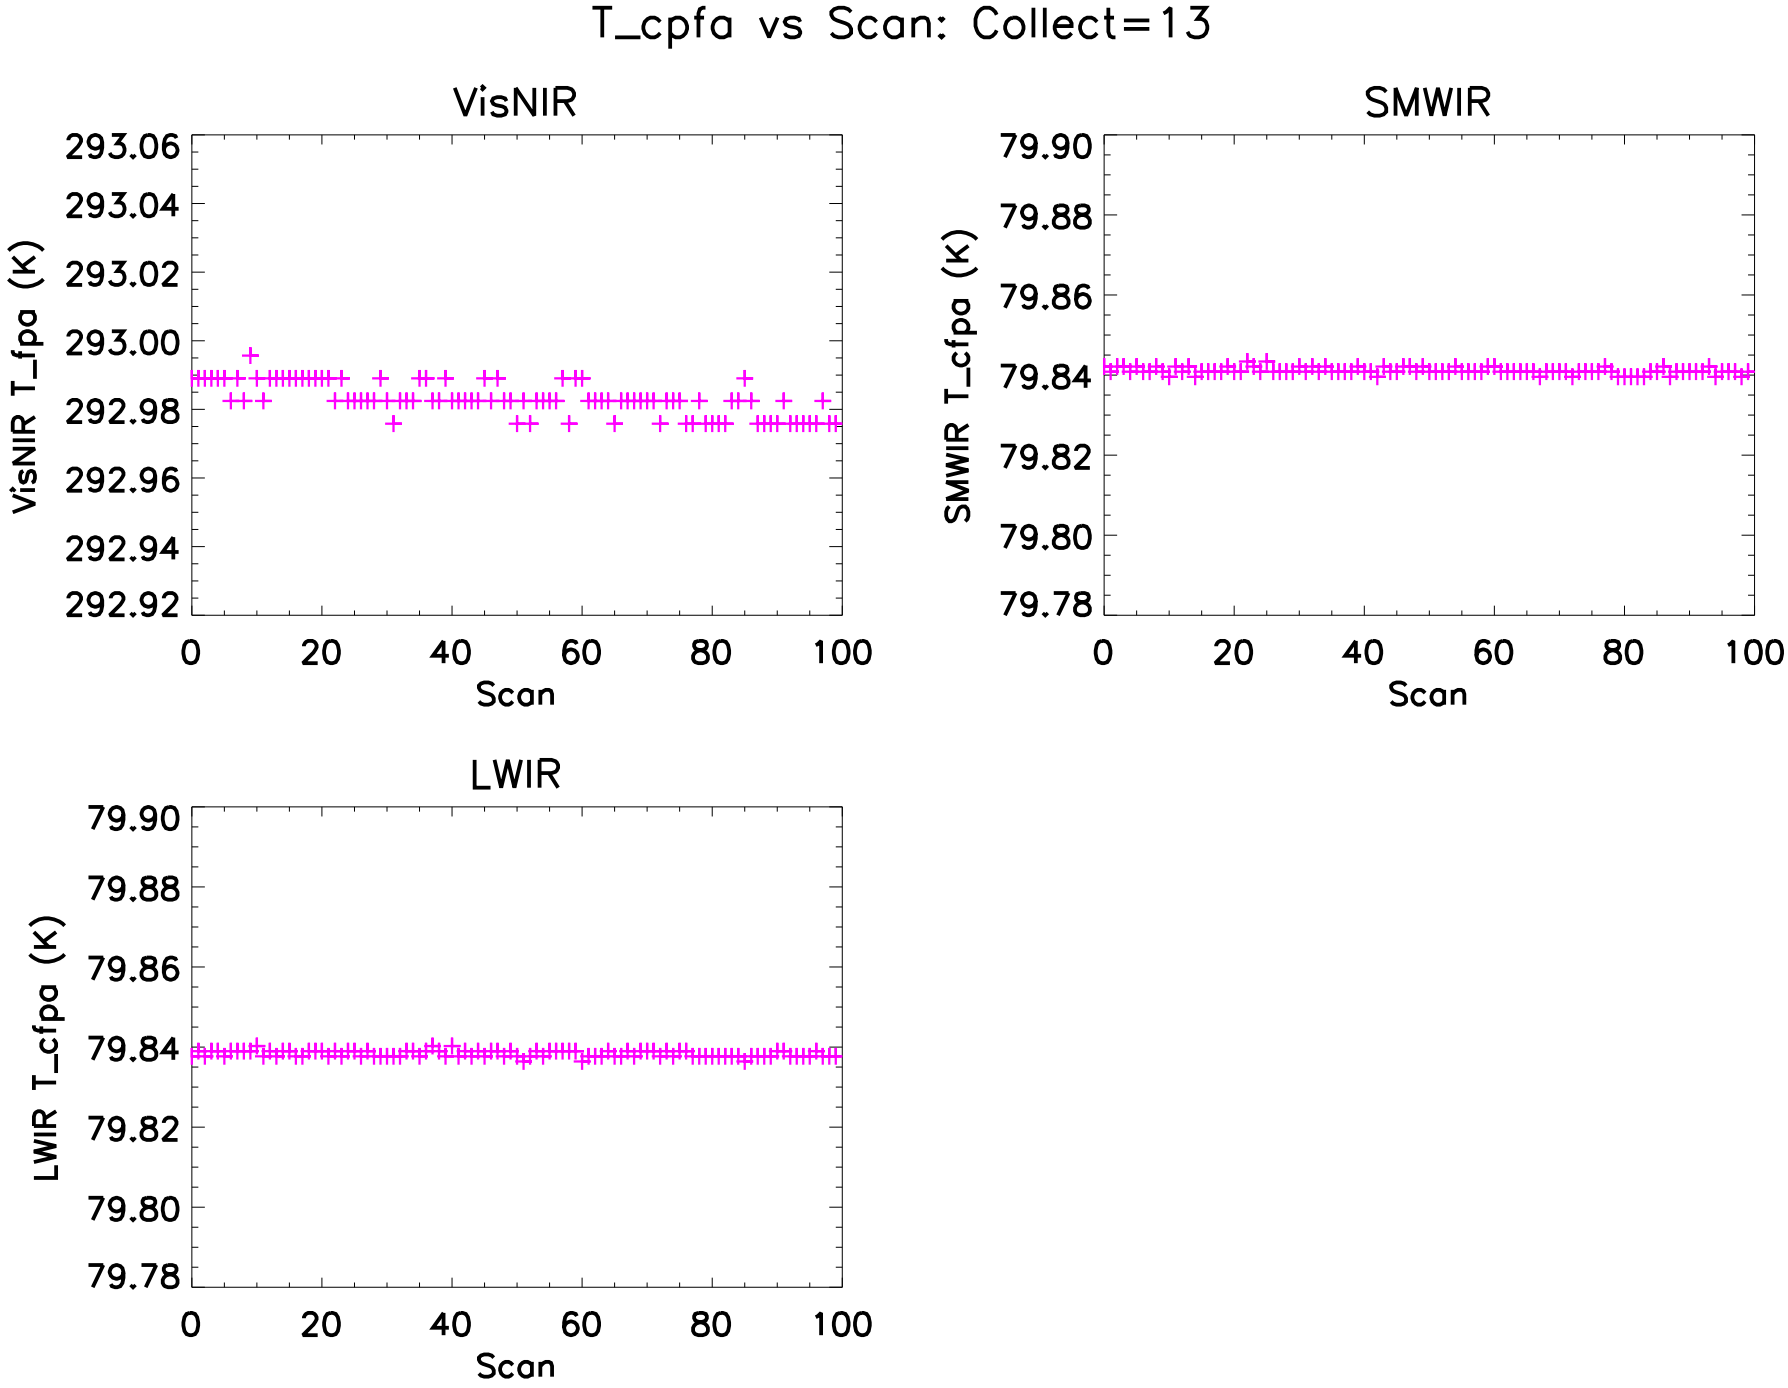
T_cpfa vs Scan: Collect=13
VisNIR
VisNIR T_fpa (K)
293.06
293.04
293.02
293.00
292.98
292.96
292.94
292.92
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.90
79.88
79.86
79.84
79.82
79.80
79.78
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.90
79.88
79.86
79.84
79.82
79.80
79.78
0
20
40
60
80
100
Scan

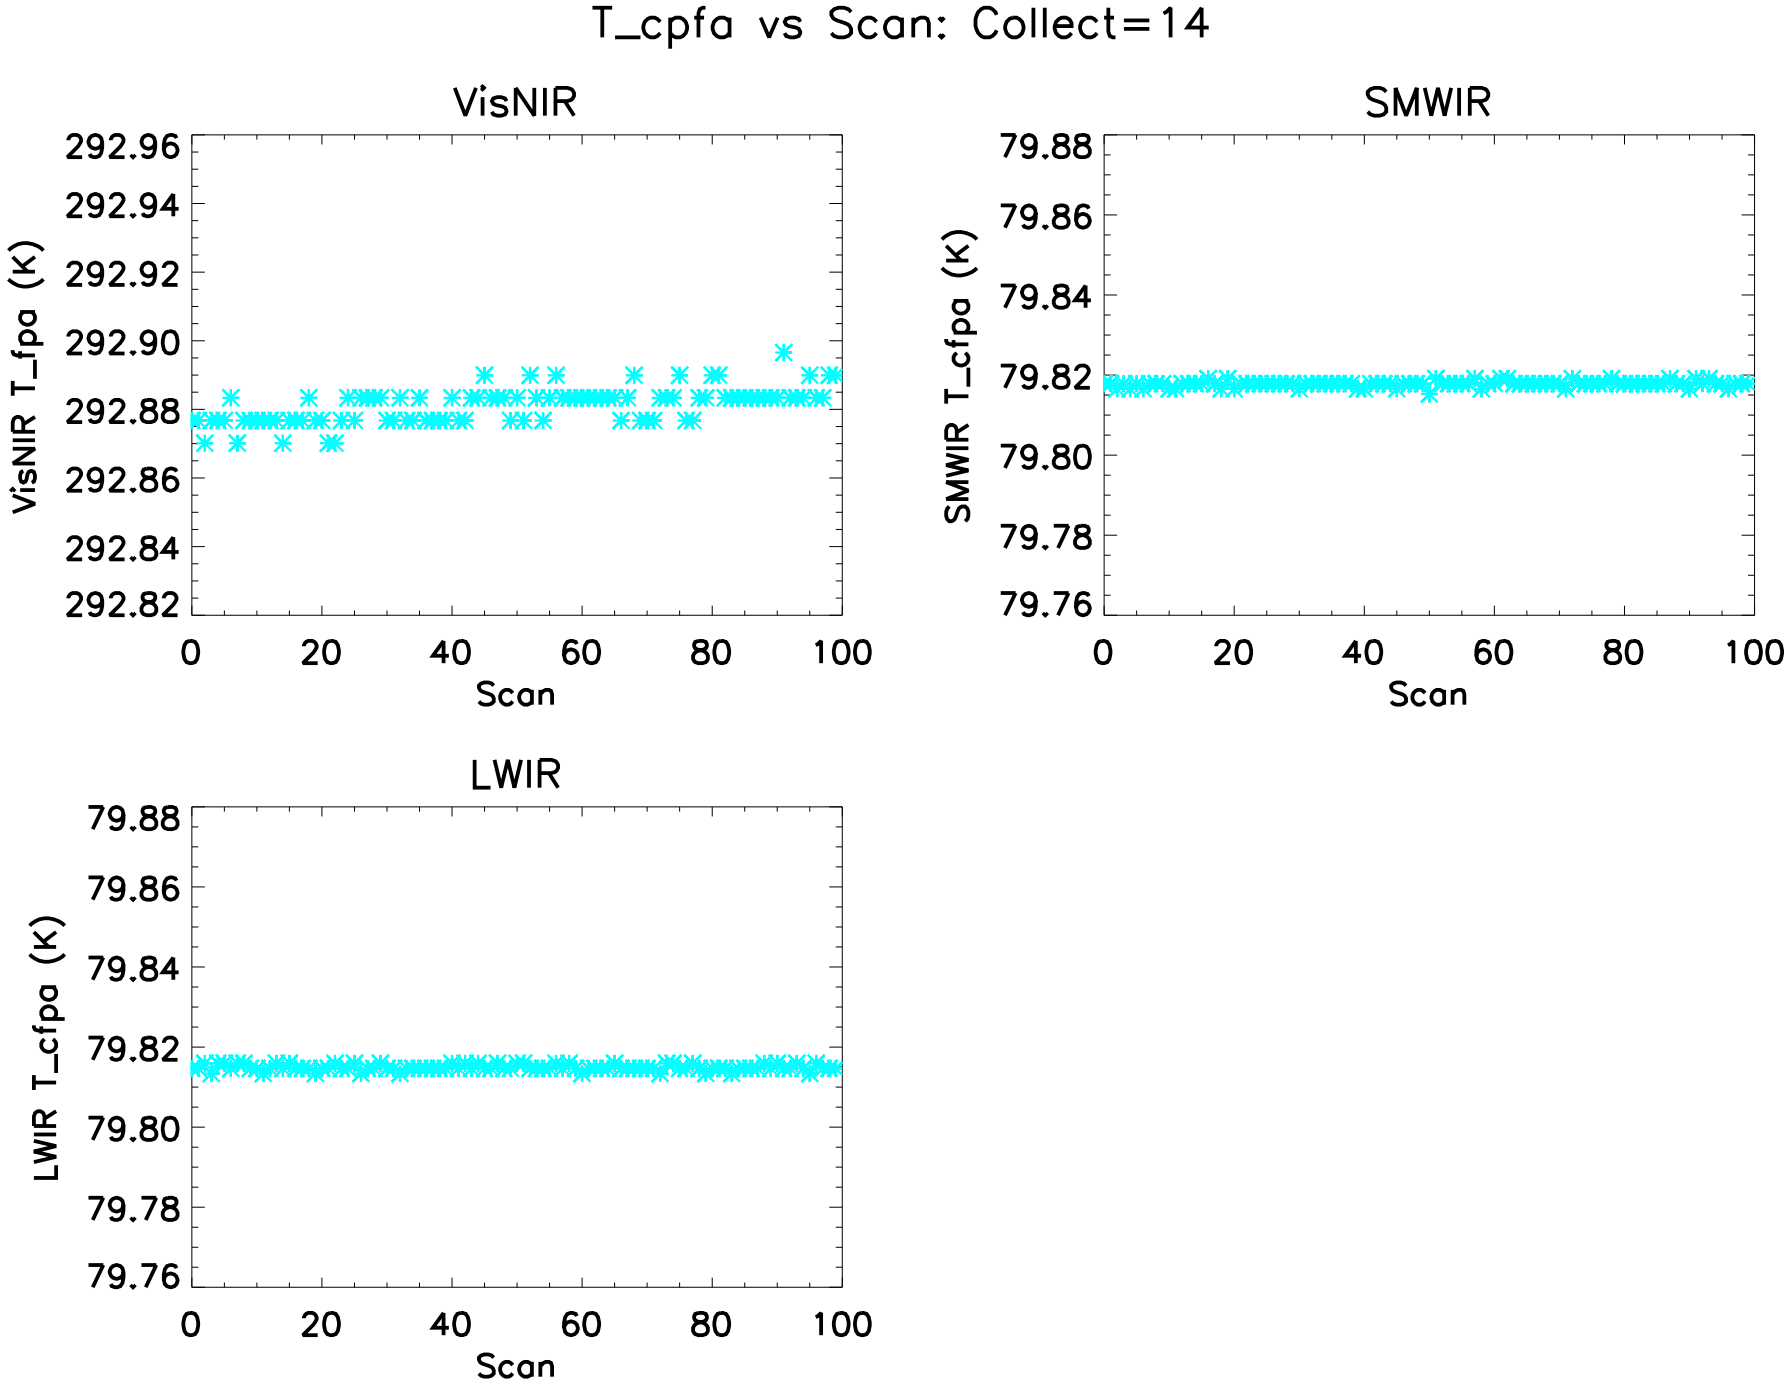
T_cpfa vs Scan: Collect=14
VisNIR
VisNIR T_fpa (K)
292.96
292.94
292.92
292.90
292.88
292.86
292.84
292.82
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.88
79.86
79.84
79.82
79.80
79.78
79.76
0
20
40
60
80
100
Scan

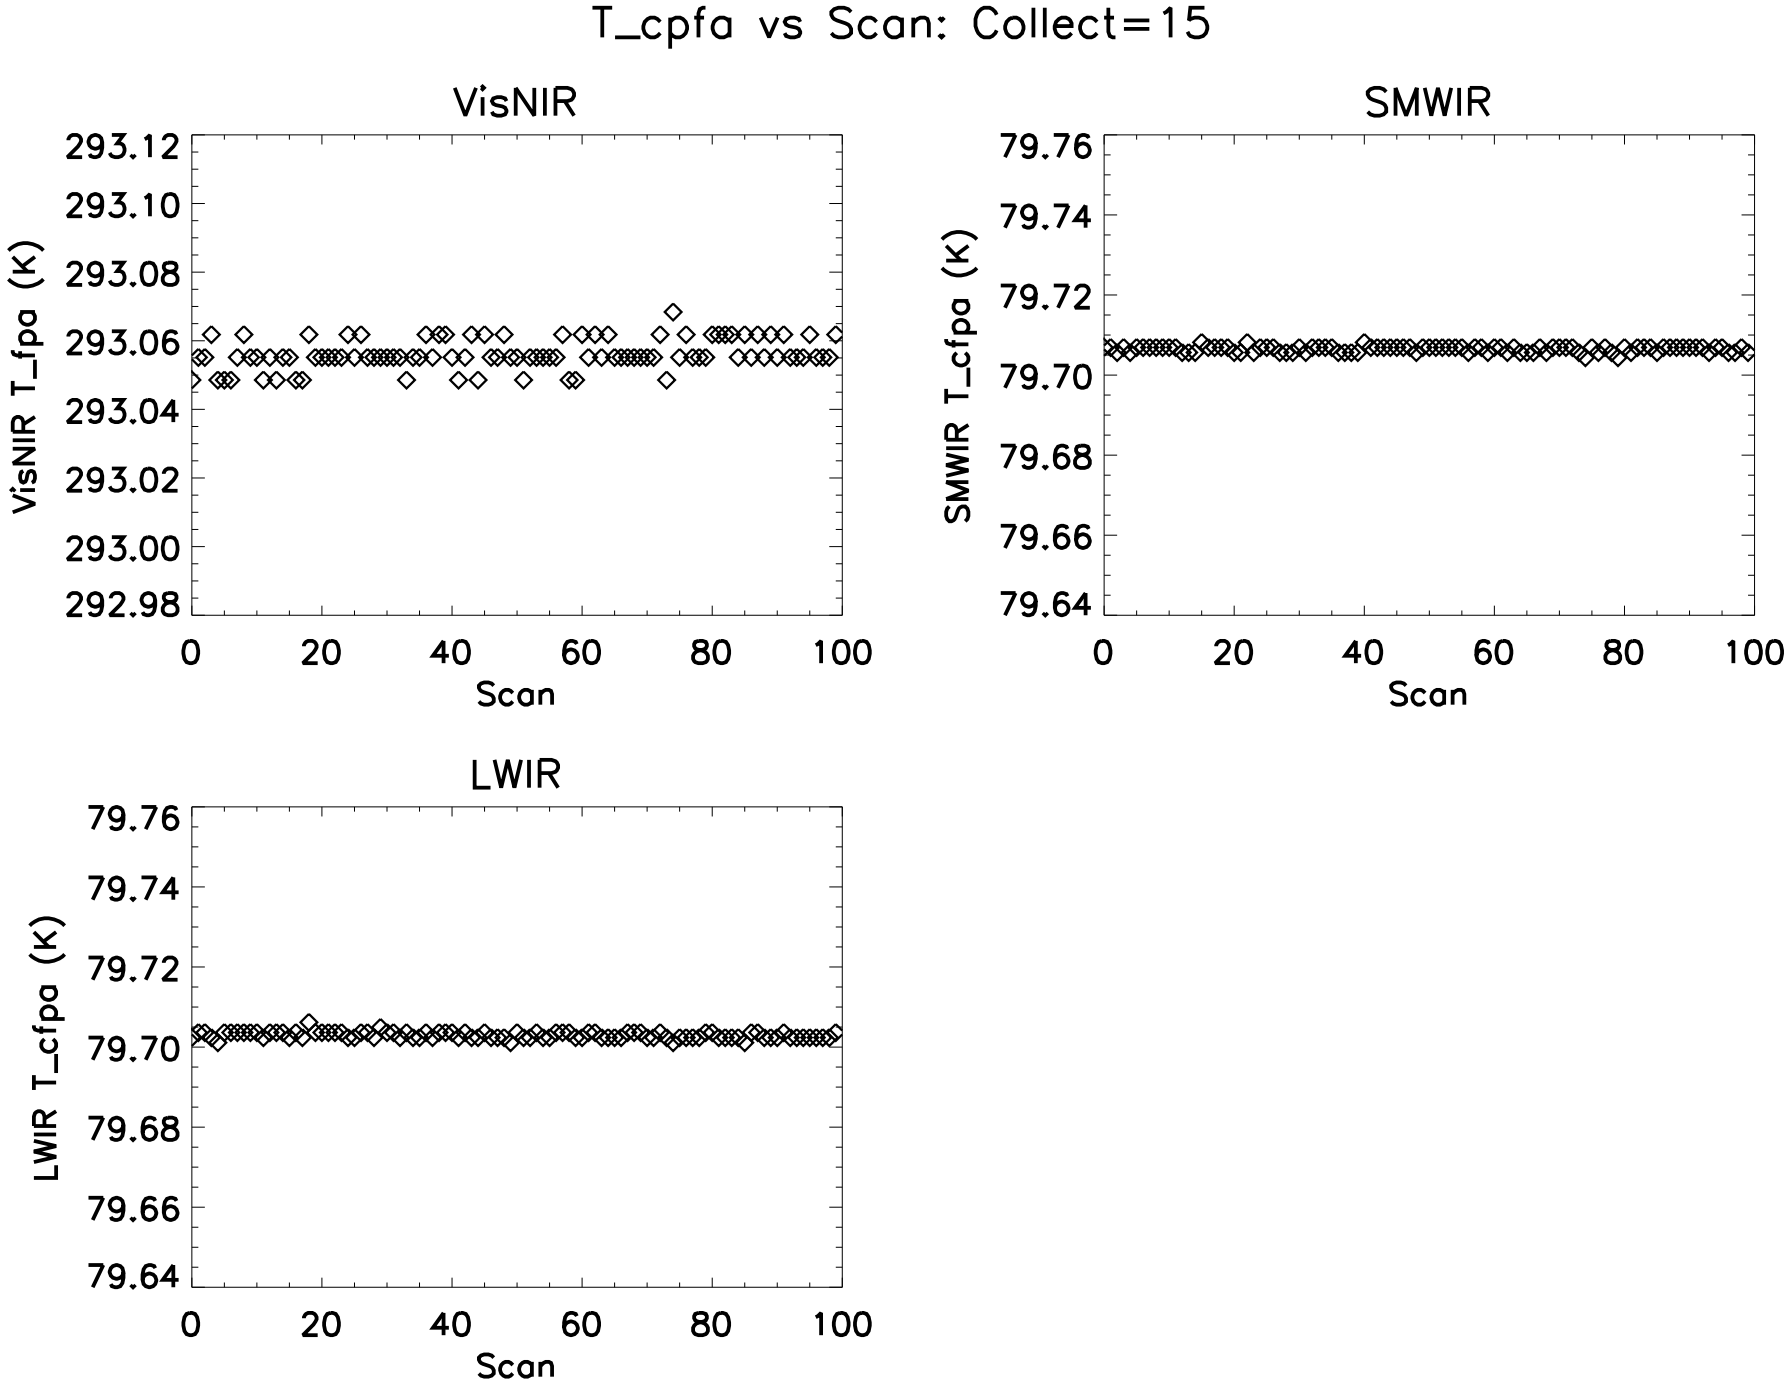
T_cpfa vs Scan: Collect=15
VisNIR
VisNIR T_fpa (K)
293.12
293.10
293.08
293.06
293.04
293.02
293.00
292.98
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_cfpa (K)
79.76
79.74
79.72
79.70
79.68
79.66
79.64
0
20
40
60
80
100
Scan
LWIR
LWIR T_cfpa (K)
79.76
79.74
79.72
79.70
79.68
79.66
79.64
0
20
40
60
80
100
Scan

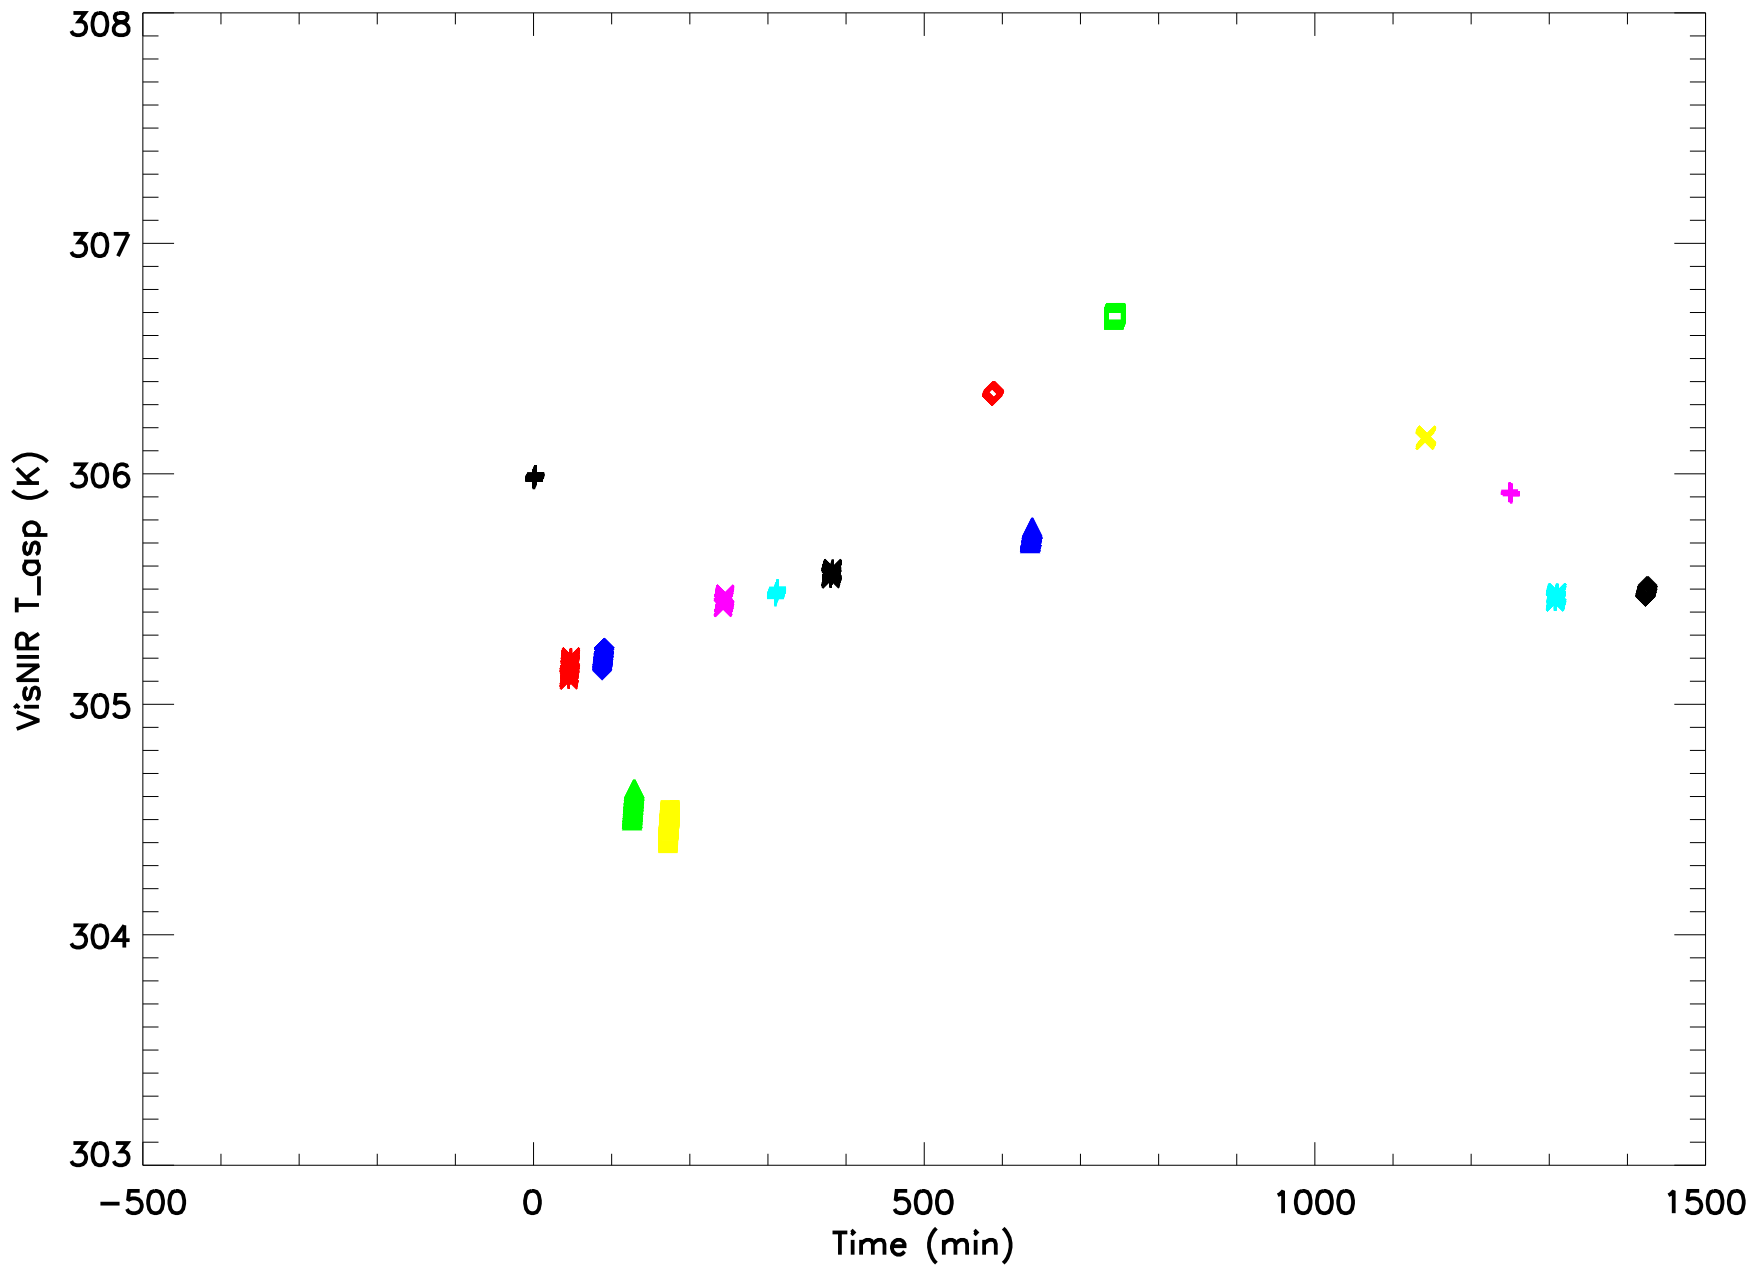
VisNIR T_asp vs Time
VisNIR T_asp (K)
308
307
306
305
304
303
−500
0
500
1000
1500
Time (min)

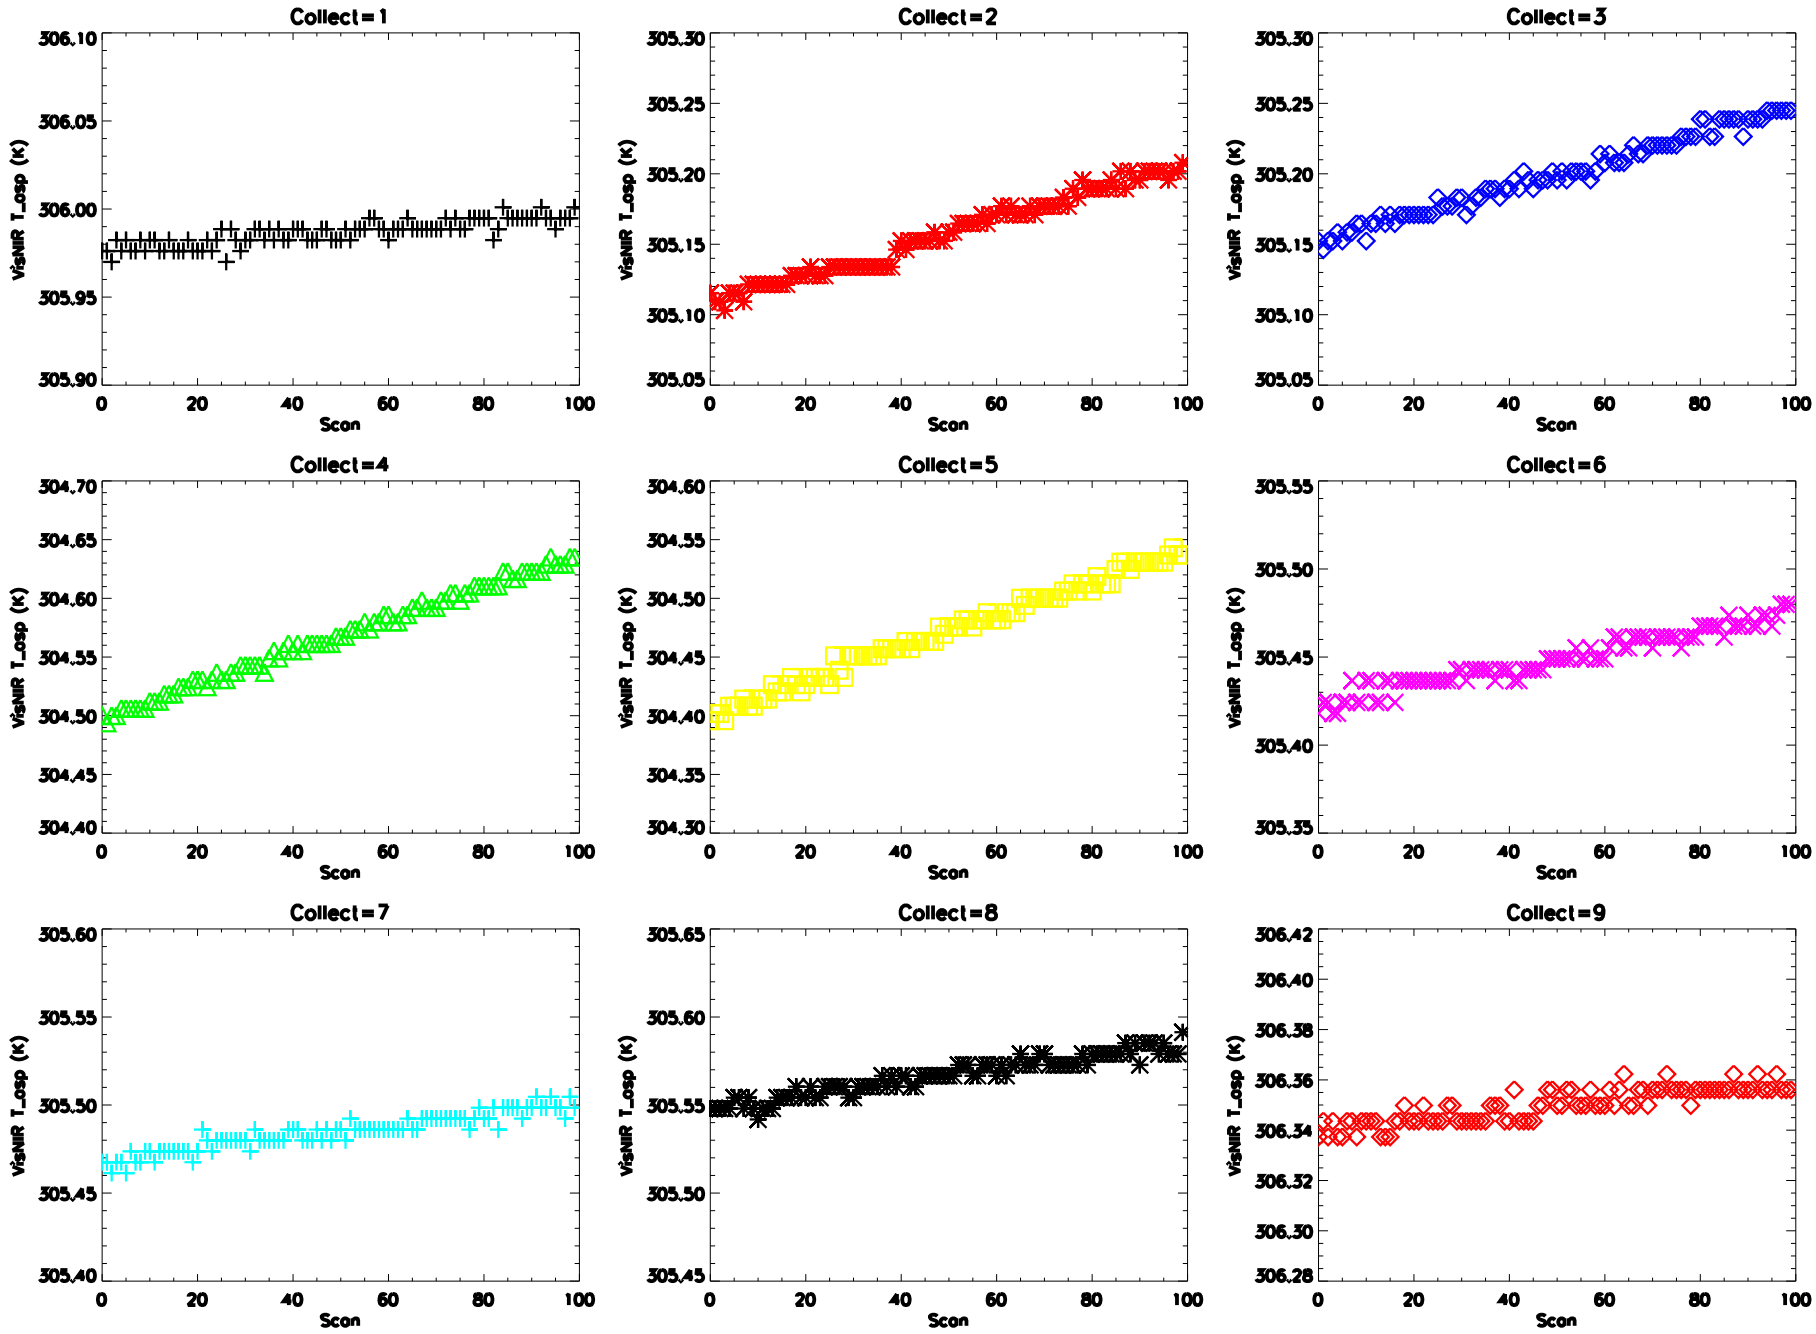
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
VisNIR T_osp (K)
Scan

VisNIR T_asp vs Scan

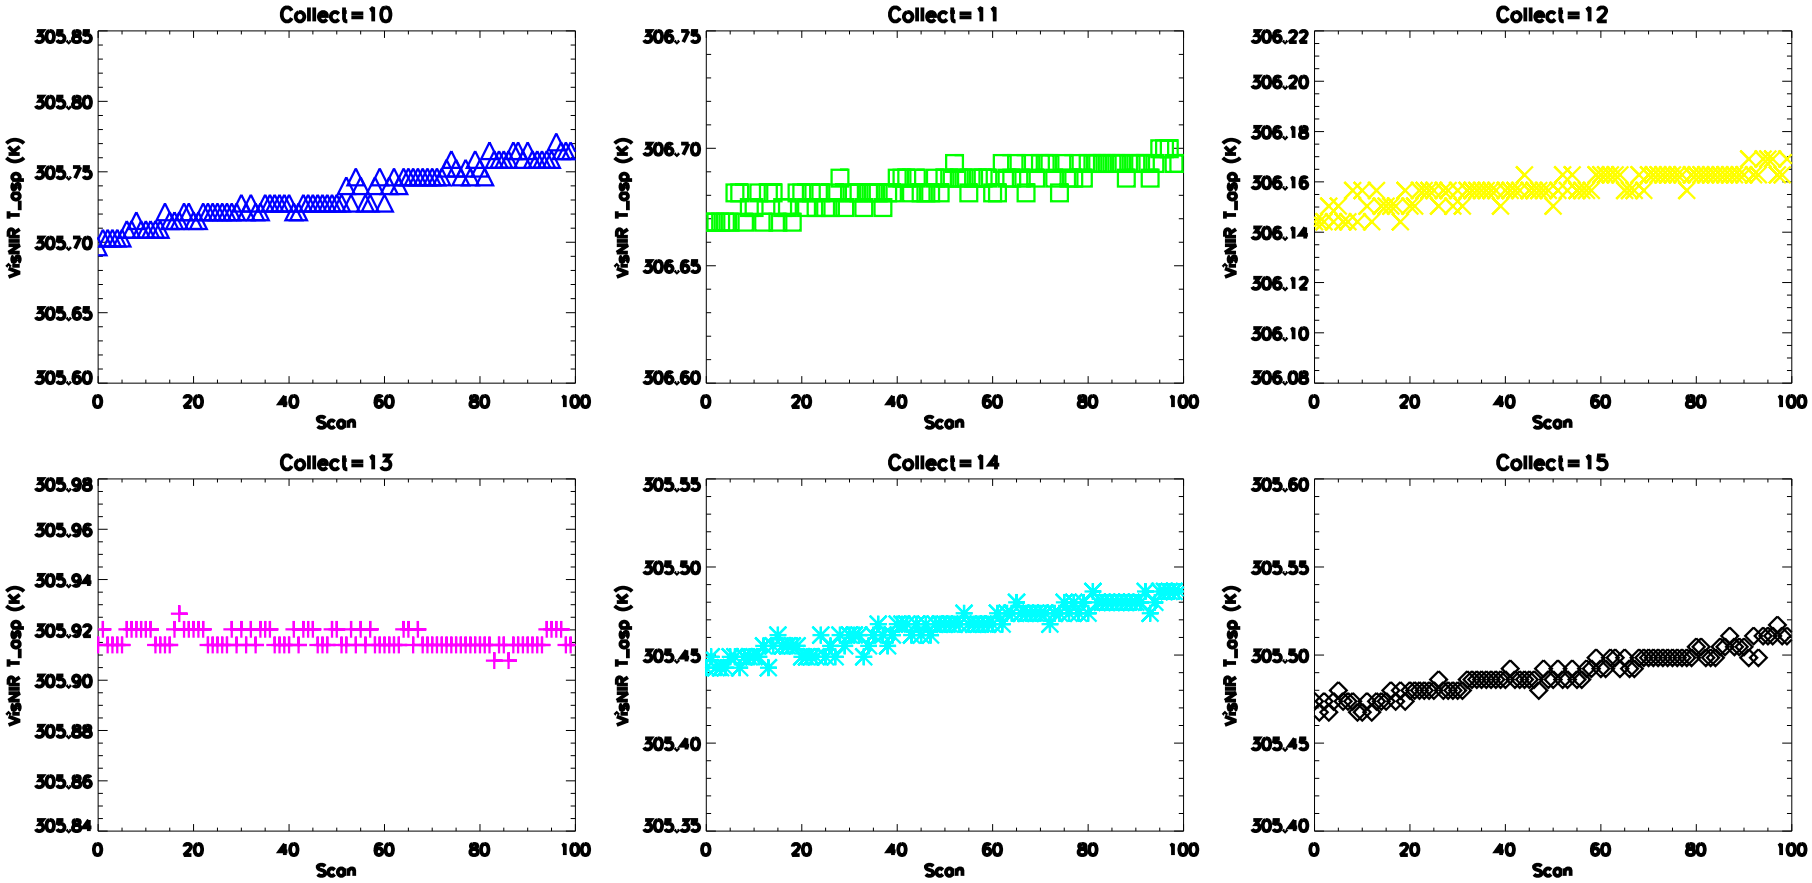

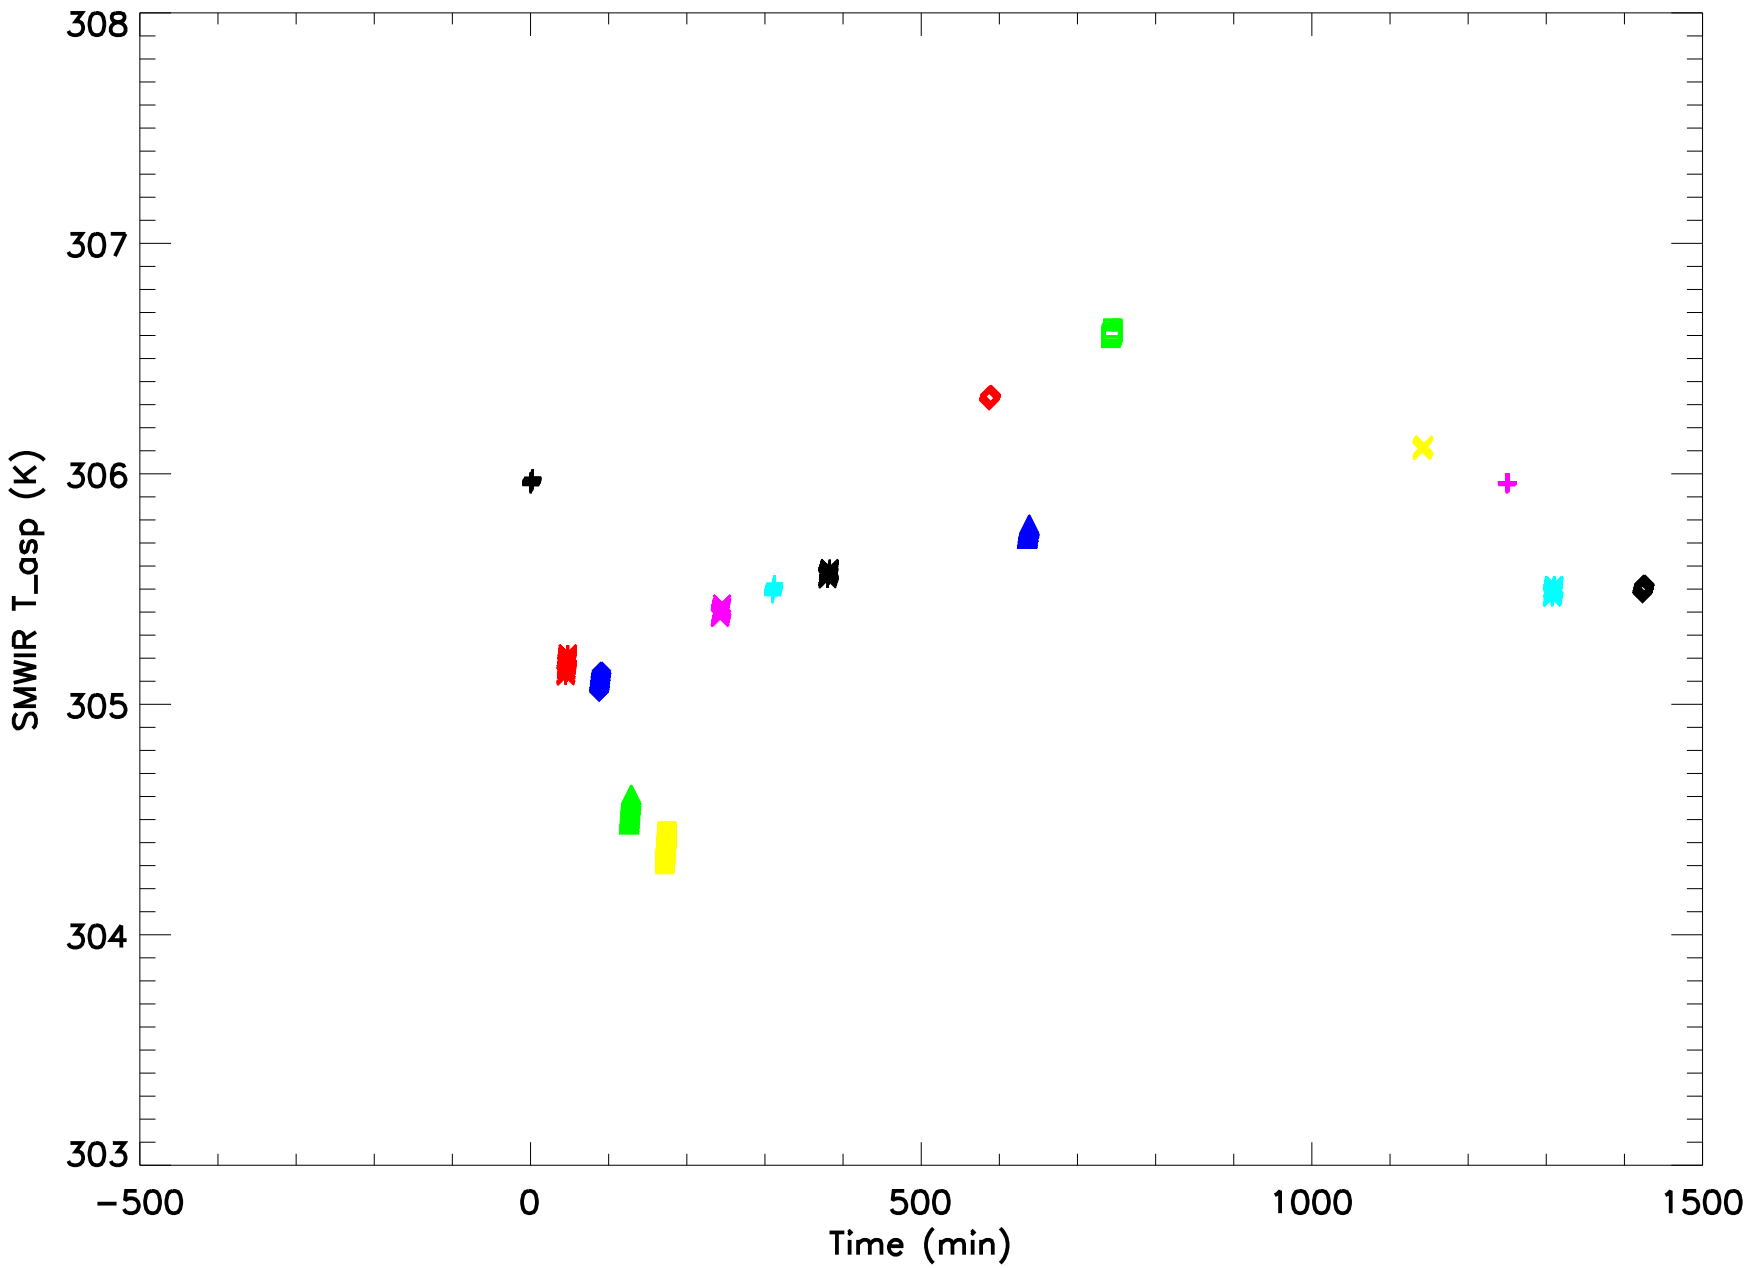
SMWIR T_asp vs Time
SMWIR T_asp (K)
308
307
306
305
304
303
−500
0
500
1000
1500
Time (min)

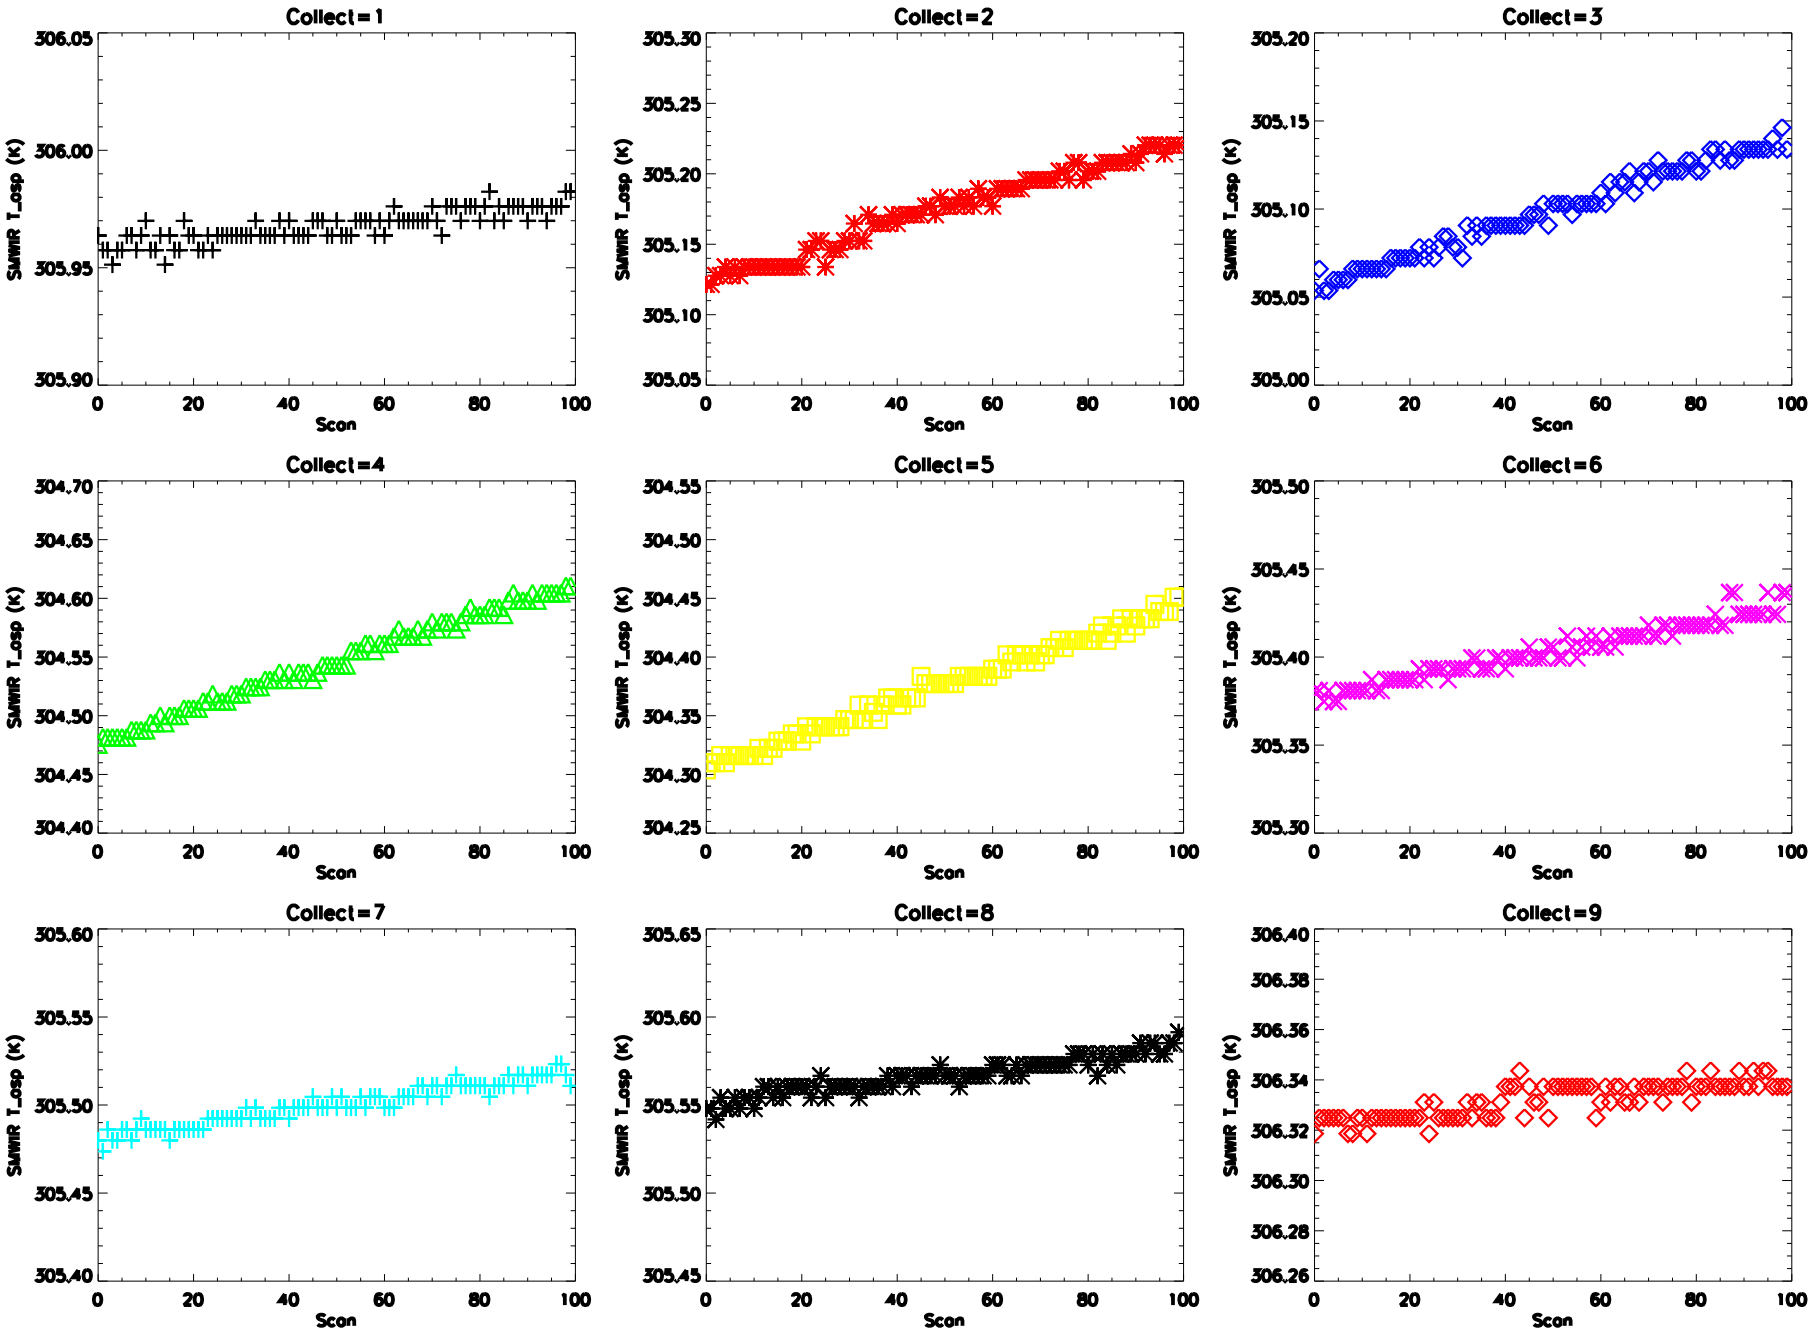
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
SWWR T_osp (K)
Scan

SMWIR T_asp vs Scan

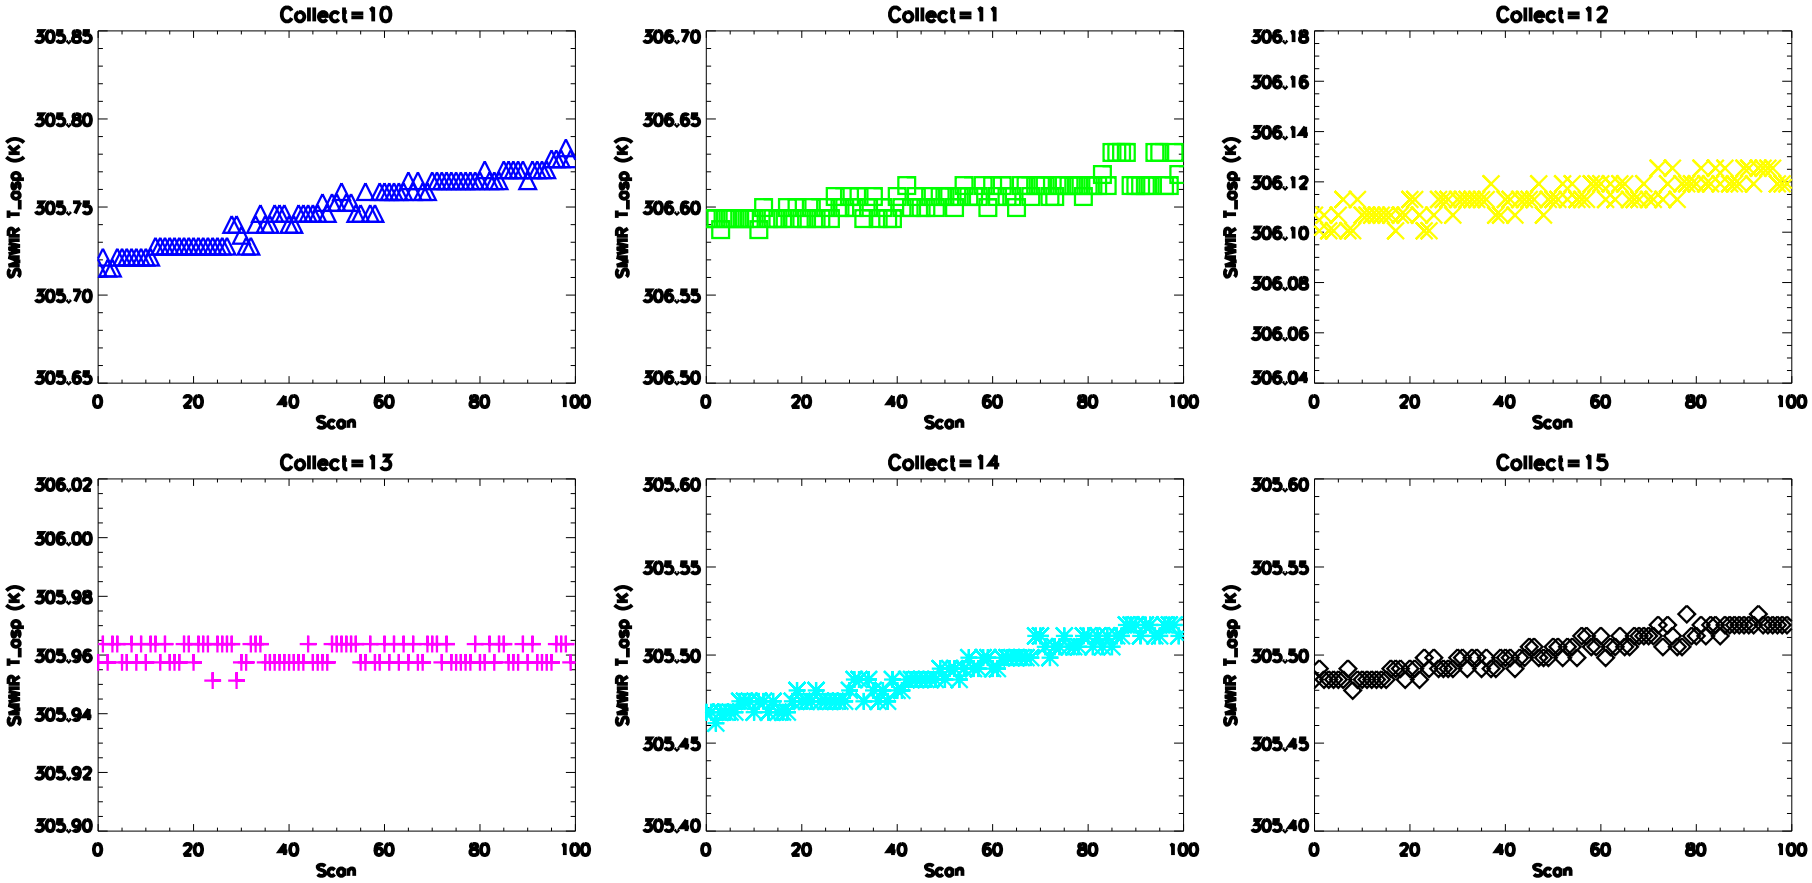

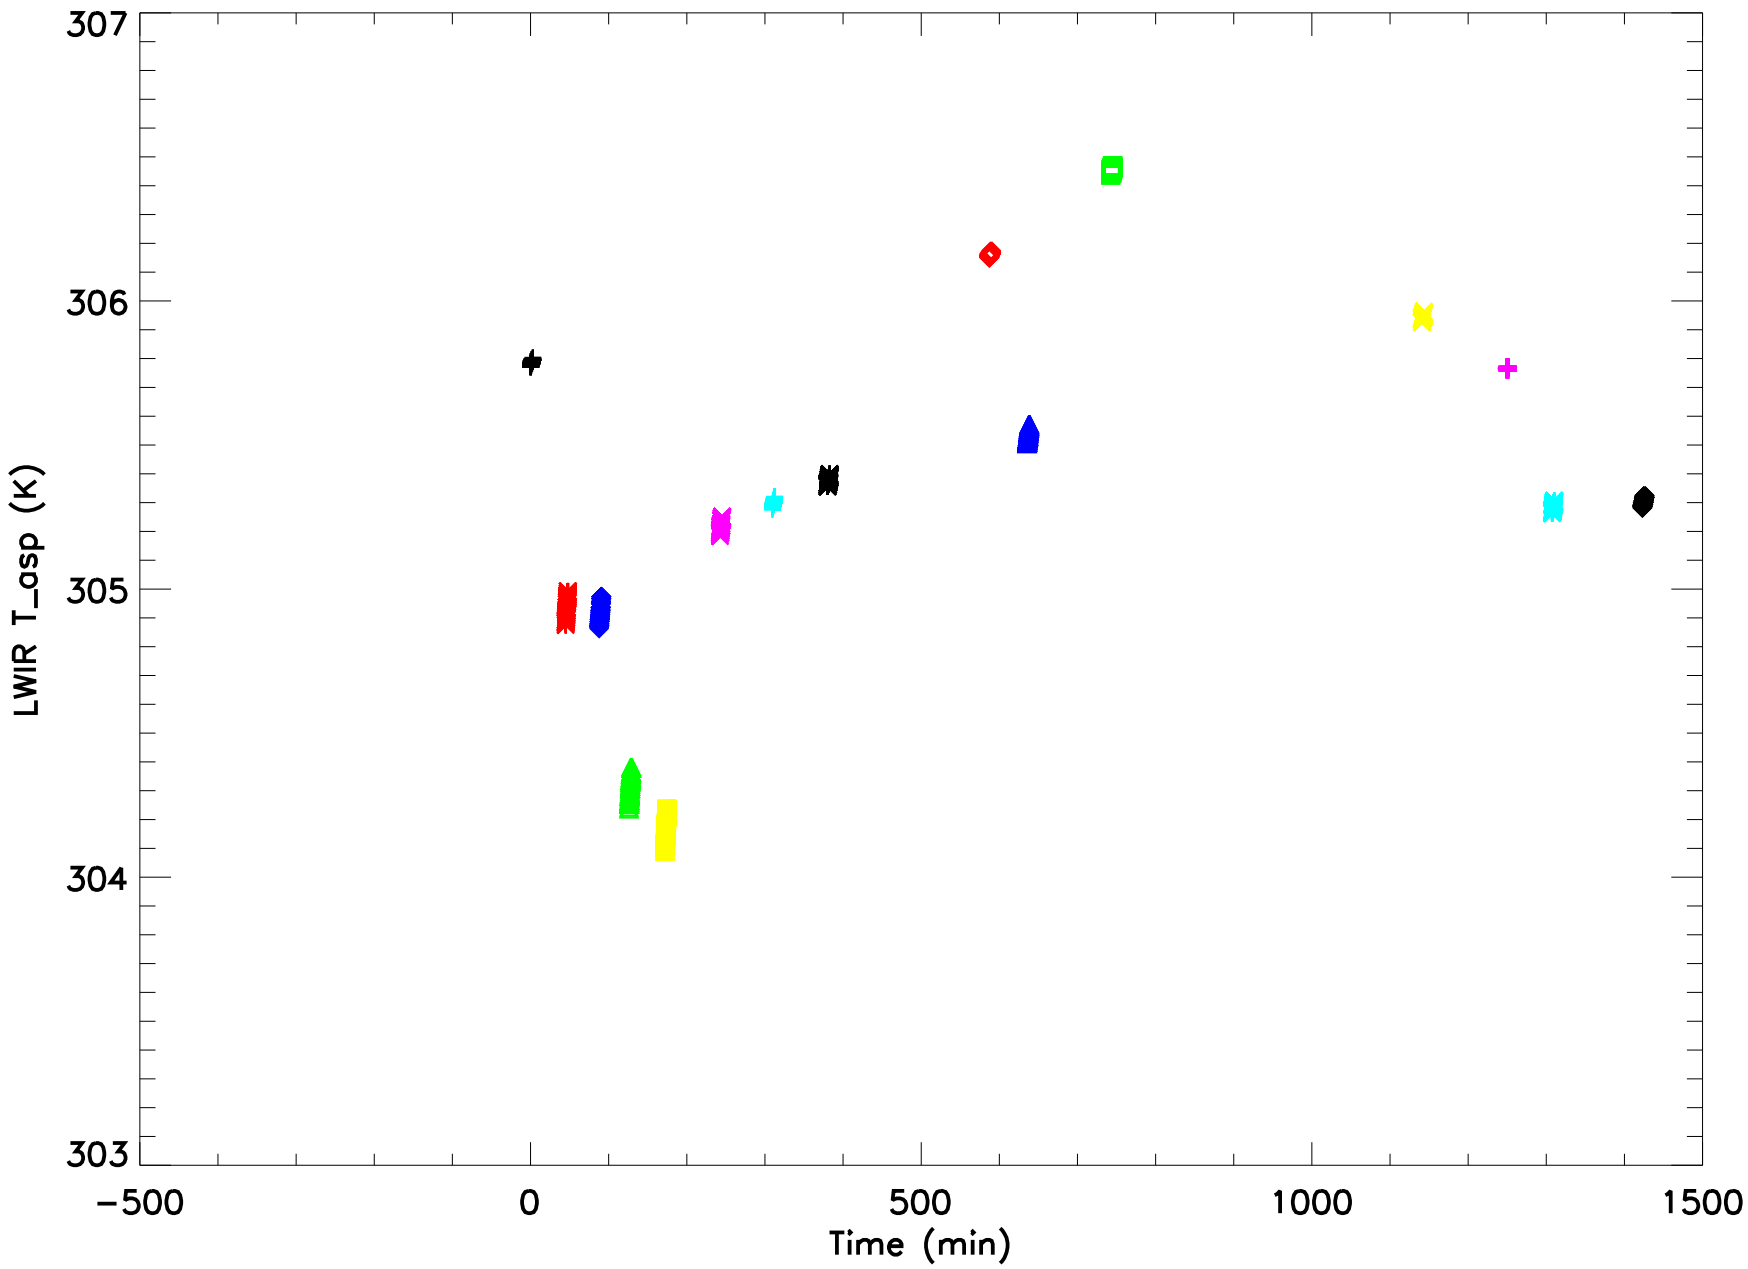
LWIR T_asp vs Time
LWIR T_asp (K)
307
306
305
304
303
−500
0
500
1000
1500
Time (min)

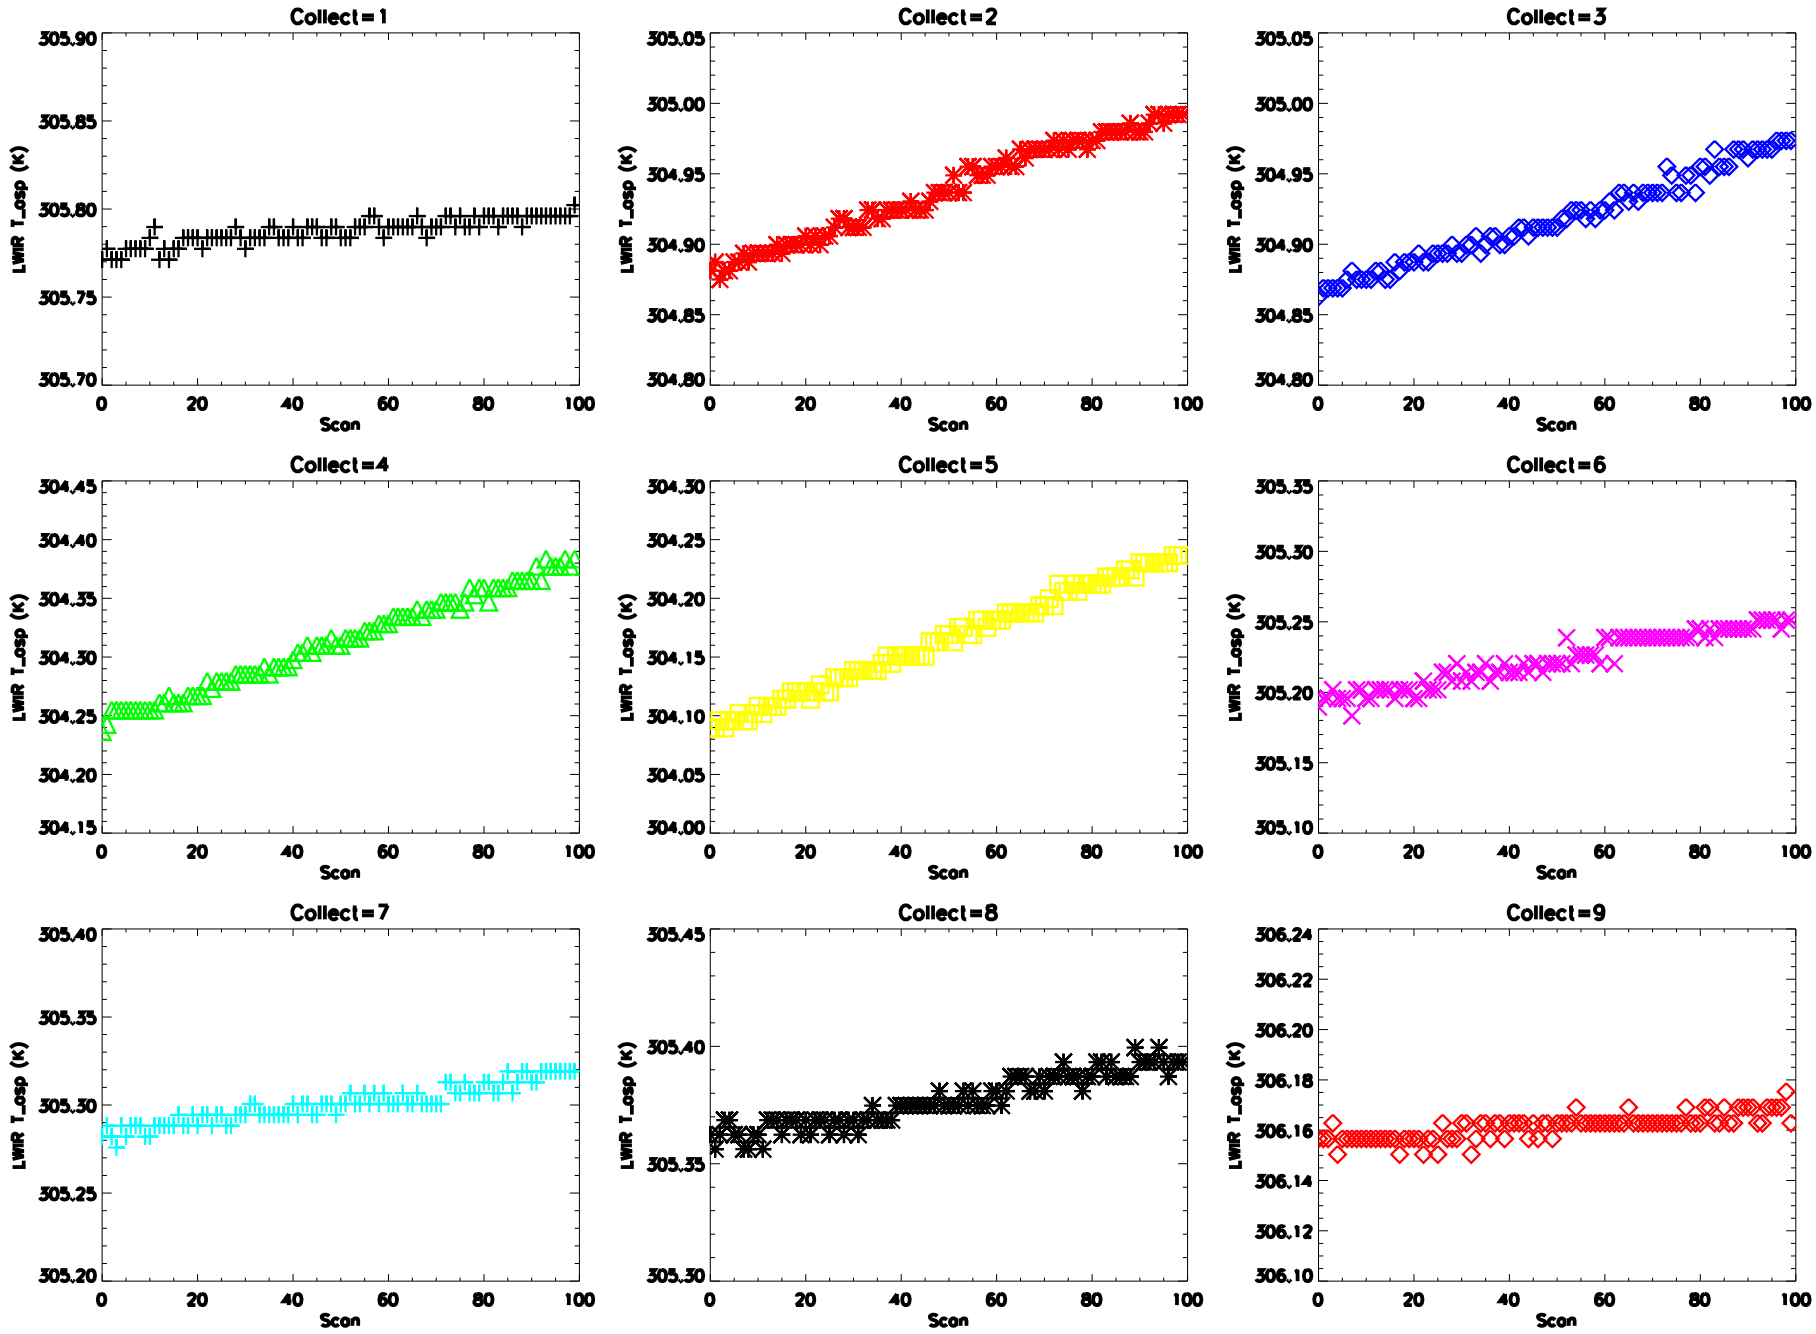
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
LWIR T_osp (K)
Scan

LWIR T_asp vs Scan

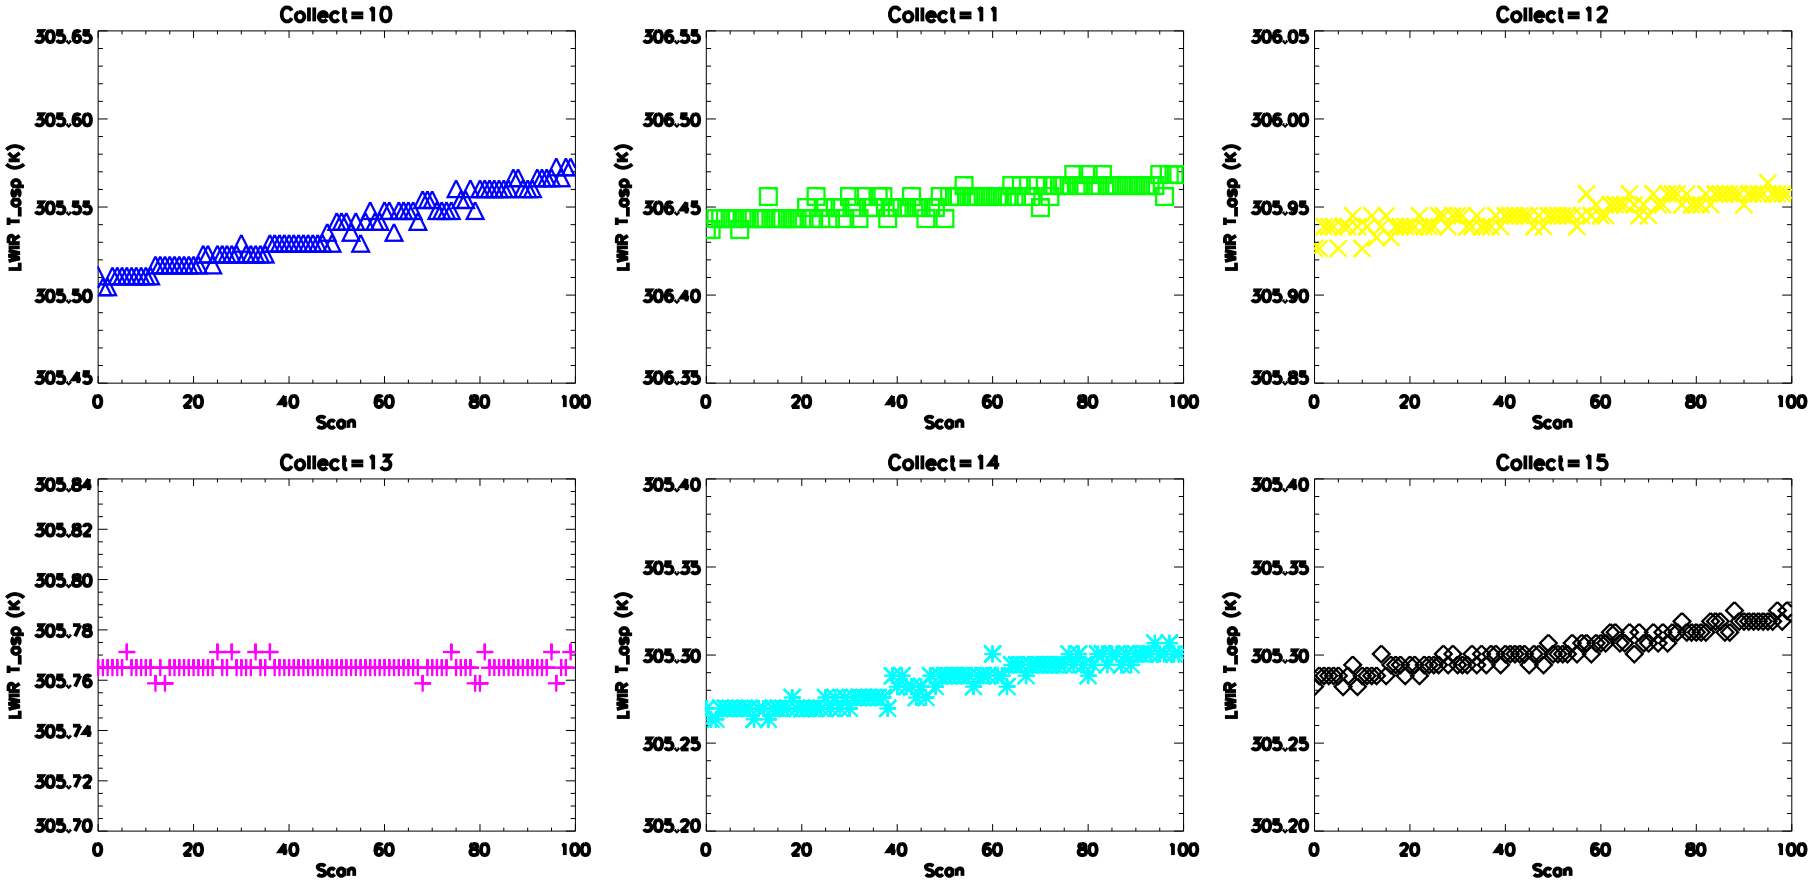

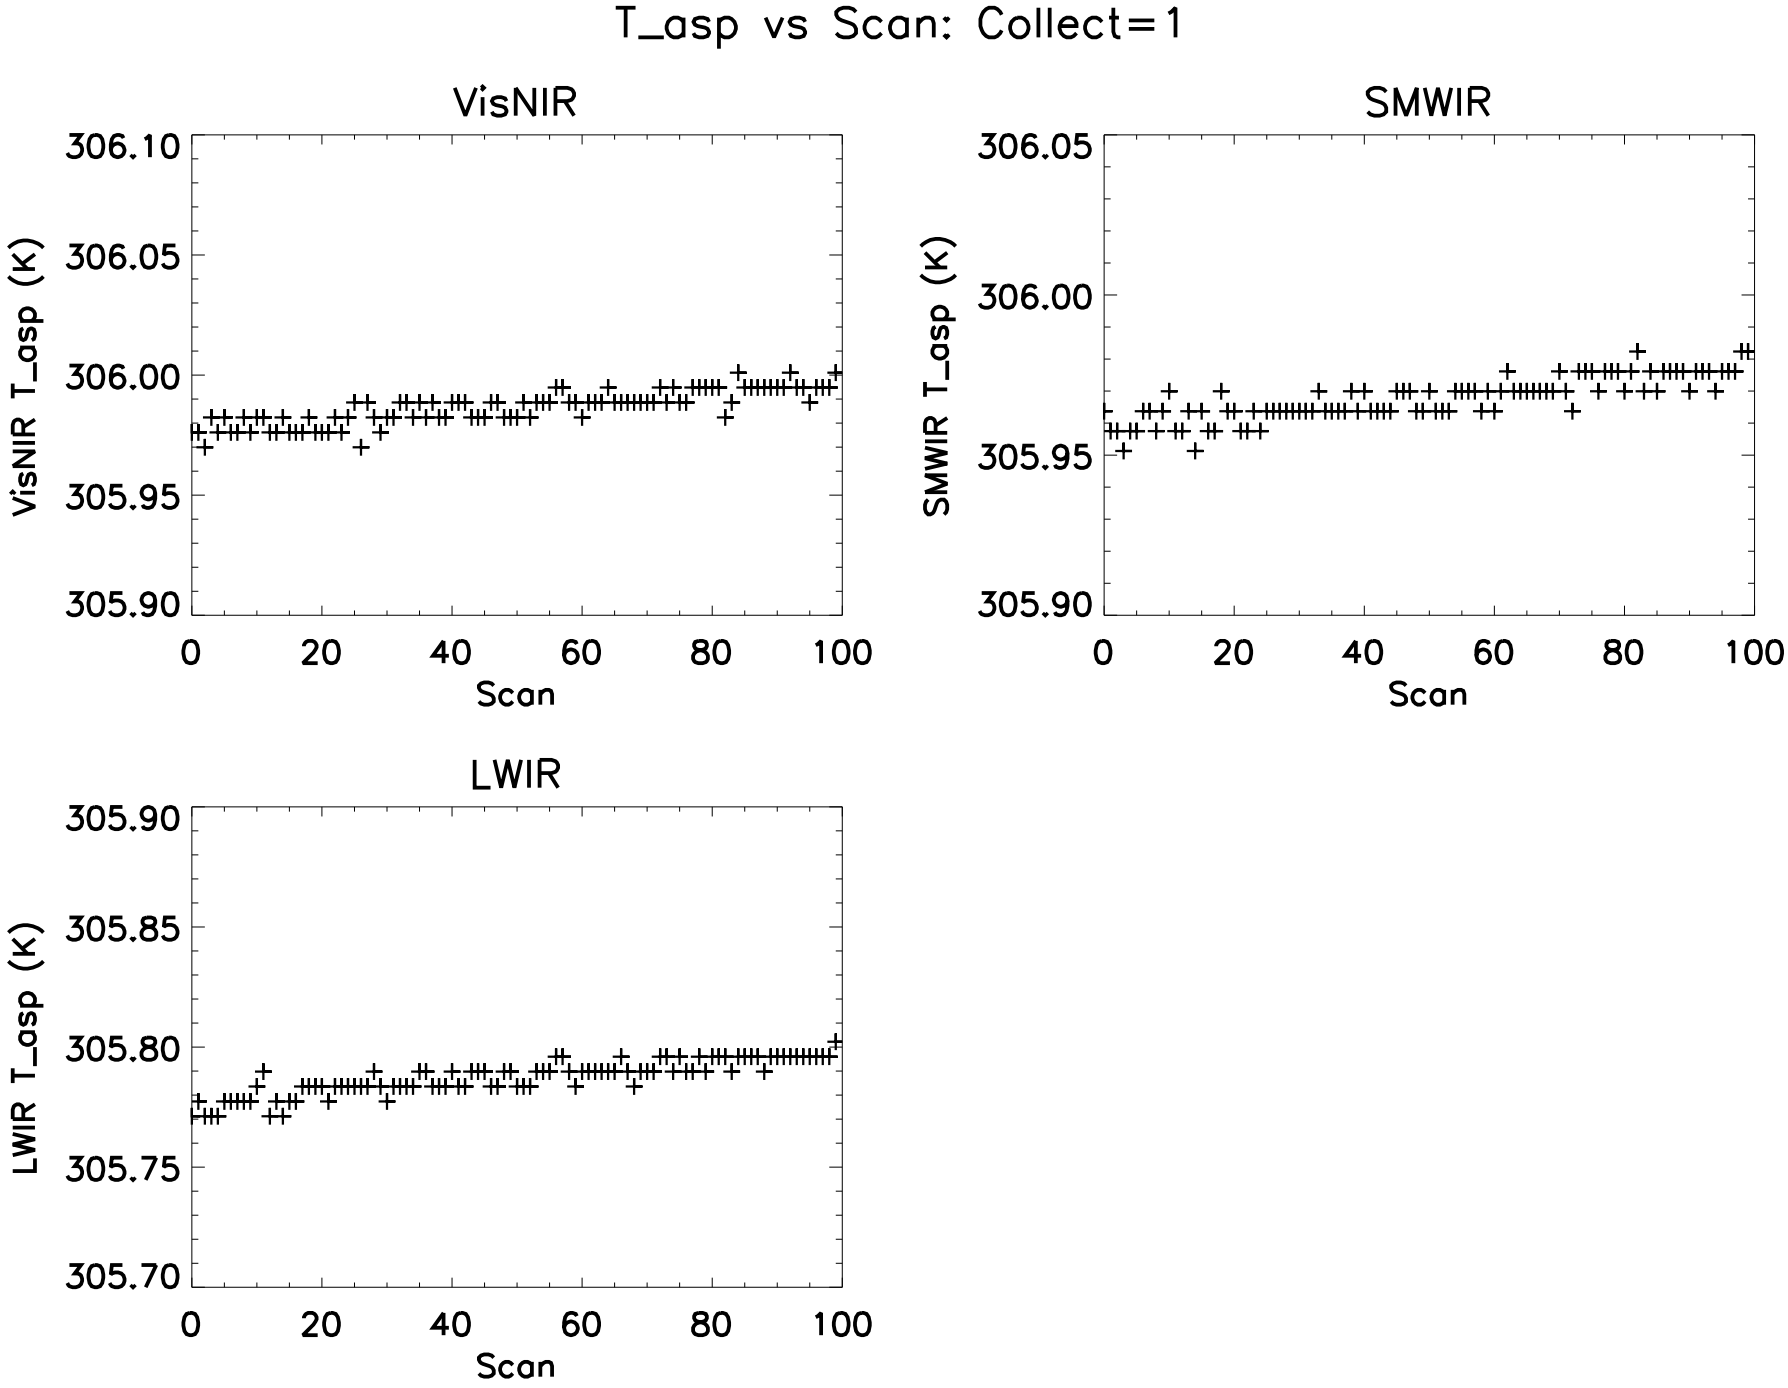
T_asp vs Scan: Collect=1
VisNIR
VisNIR T_asp (K)
306.10
306.05
306.00
305.95
305.90
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
306.05
306.00
305.95
305.90
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.90
305.85
305.80
305.75
305.70
0
20
40
60
80
100
Scan

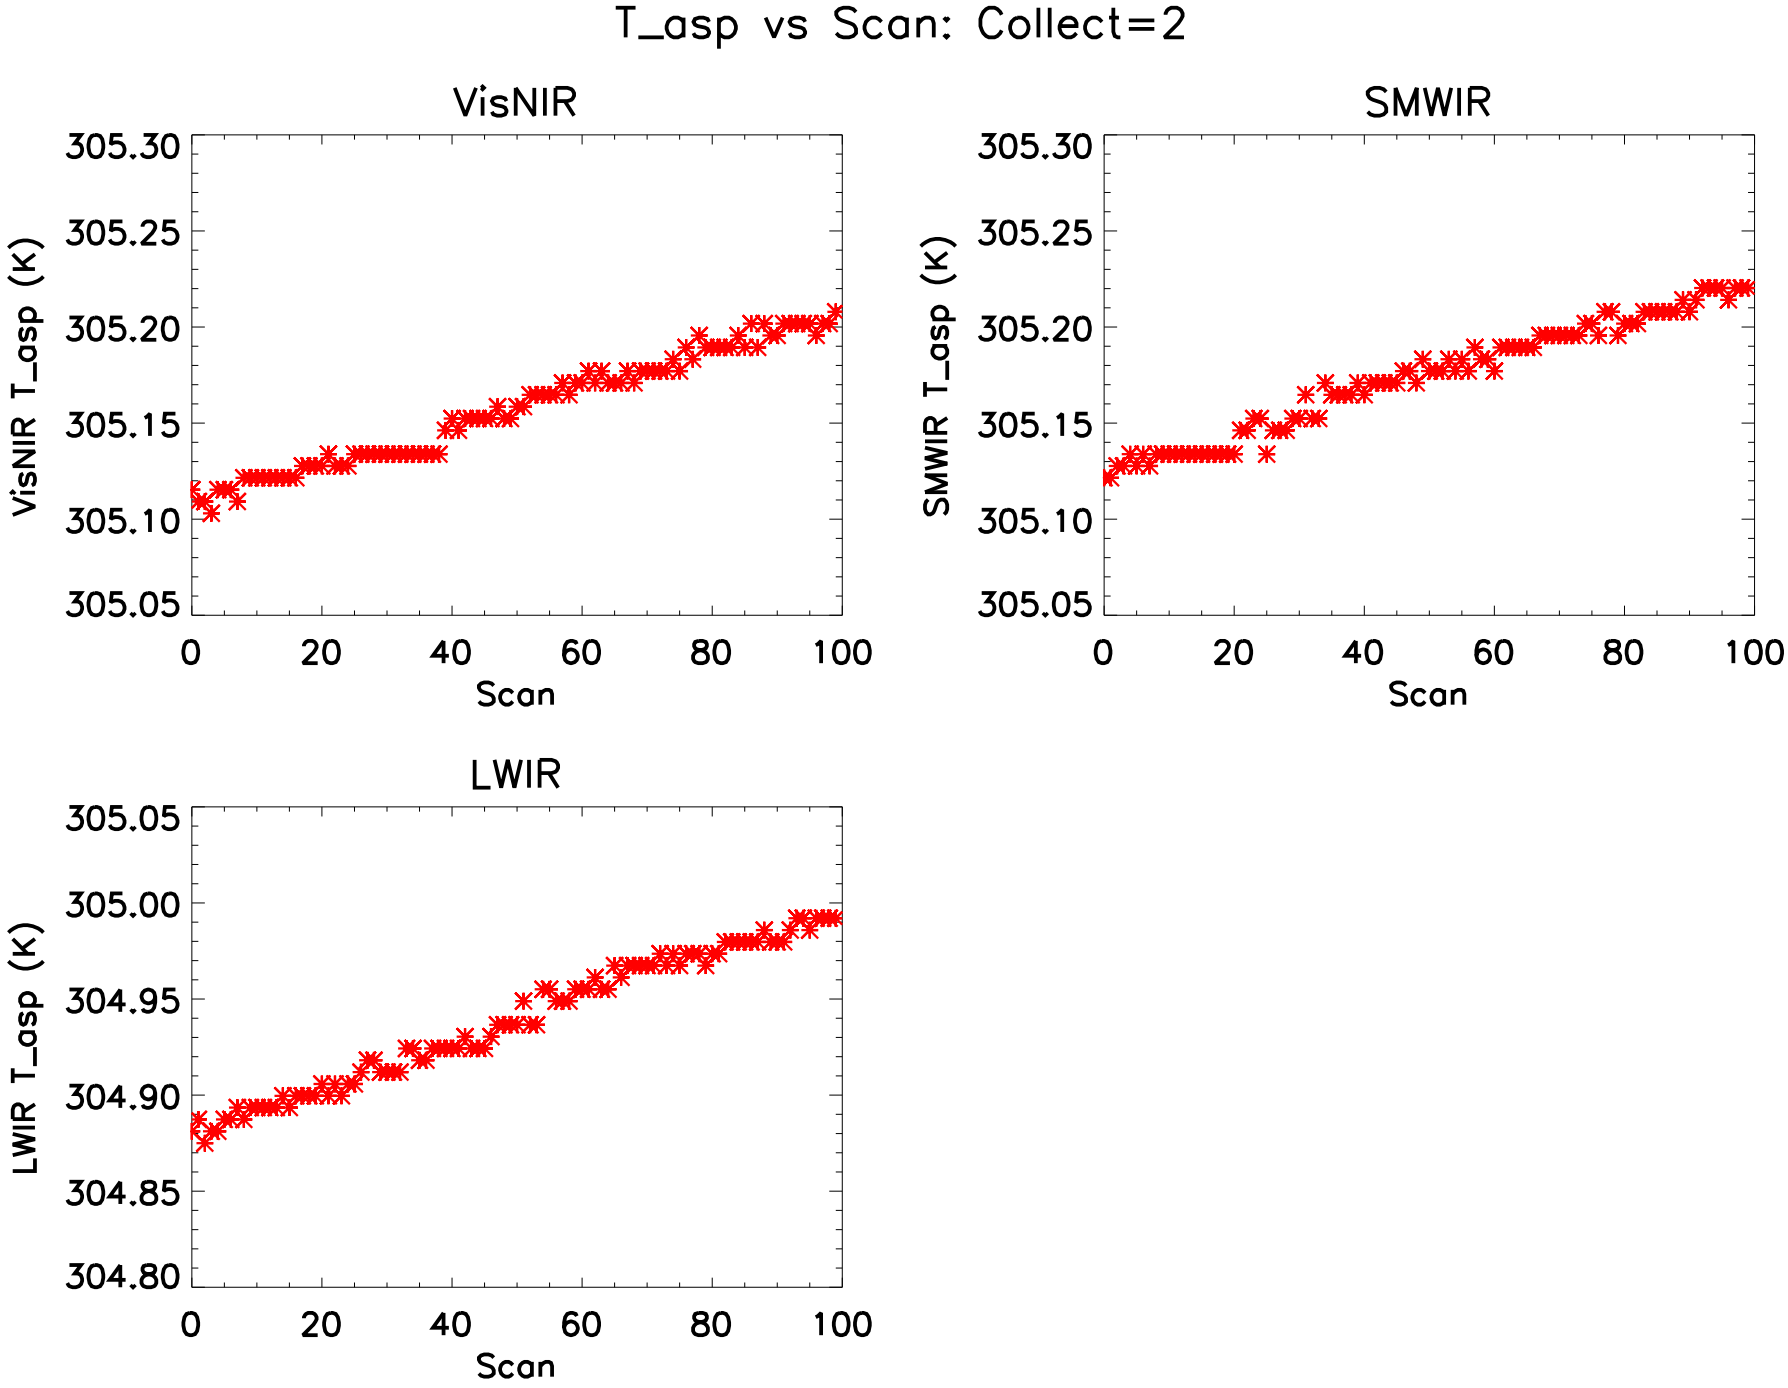
T_asp vs Scan: Collect=2
VisNIR
VisNIR T_asp (K)
305.30
305.25
305.20
305.15
305.10
305.05
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.30
305.25
305.20
305.15
305.10
305.05
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.05
305.00
304.95
304.90
304.85
304.80
0
20
40
60
80
100
Scan

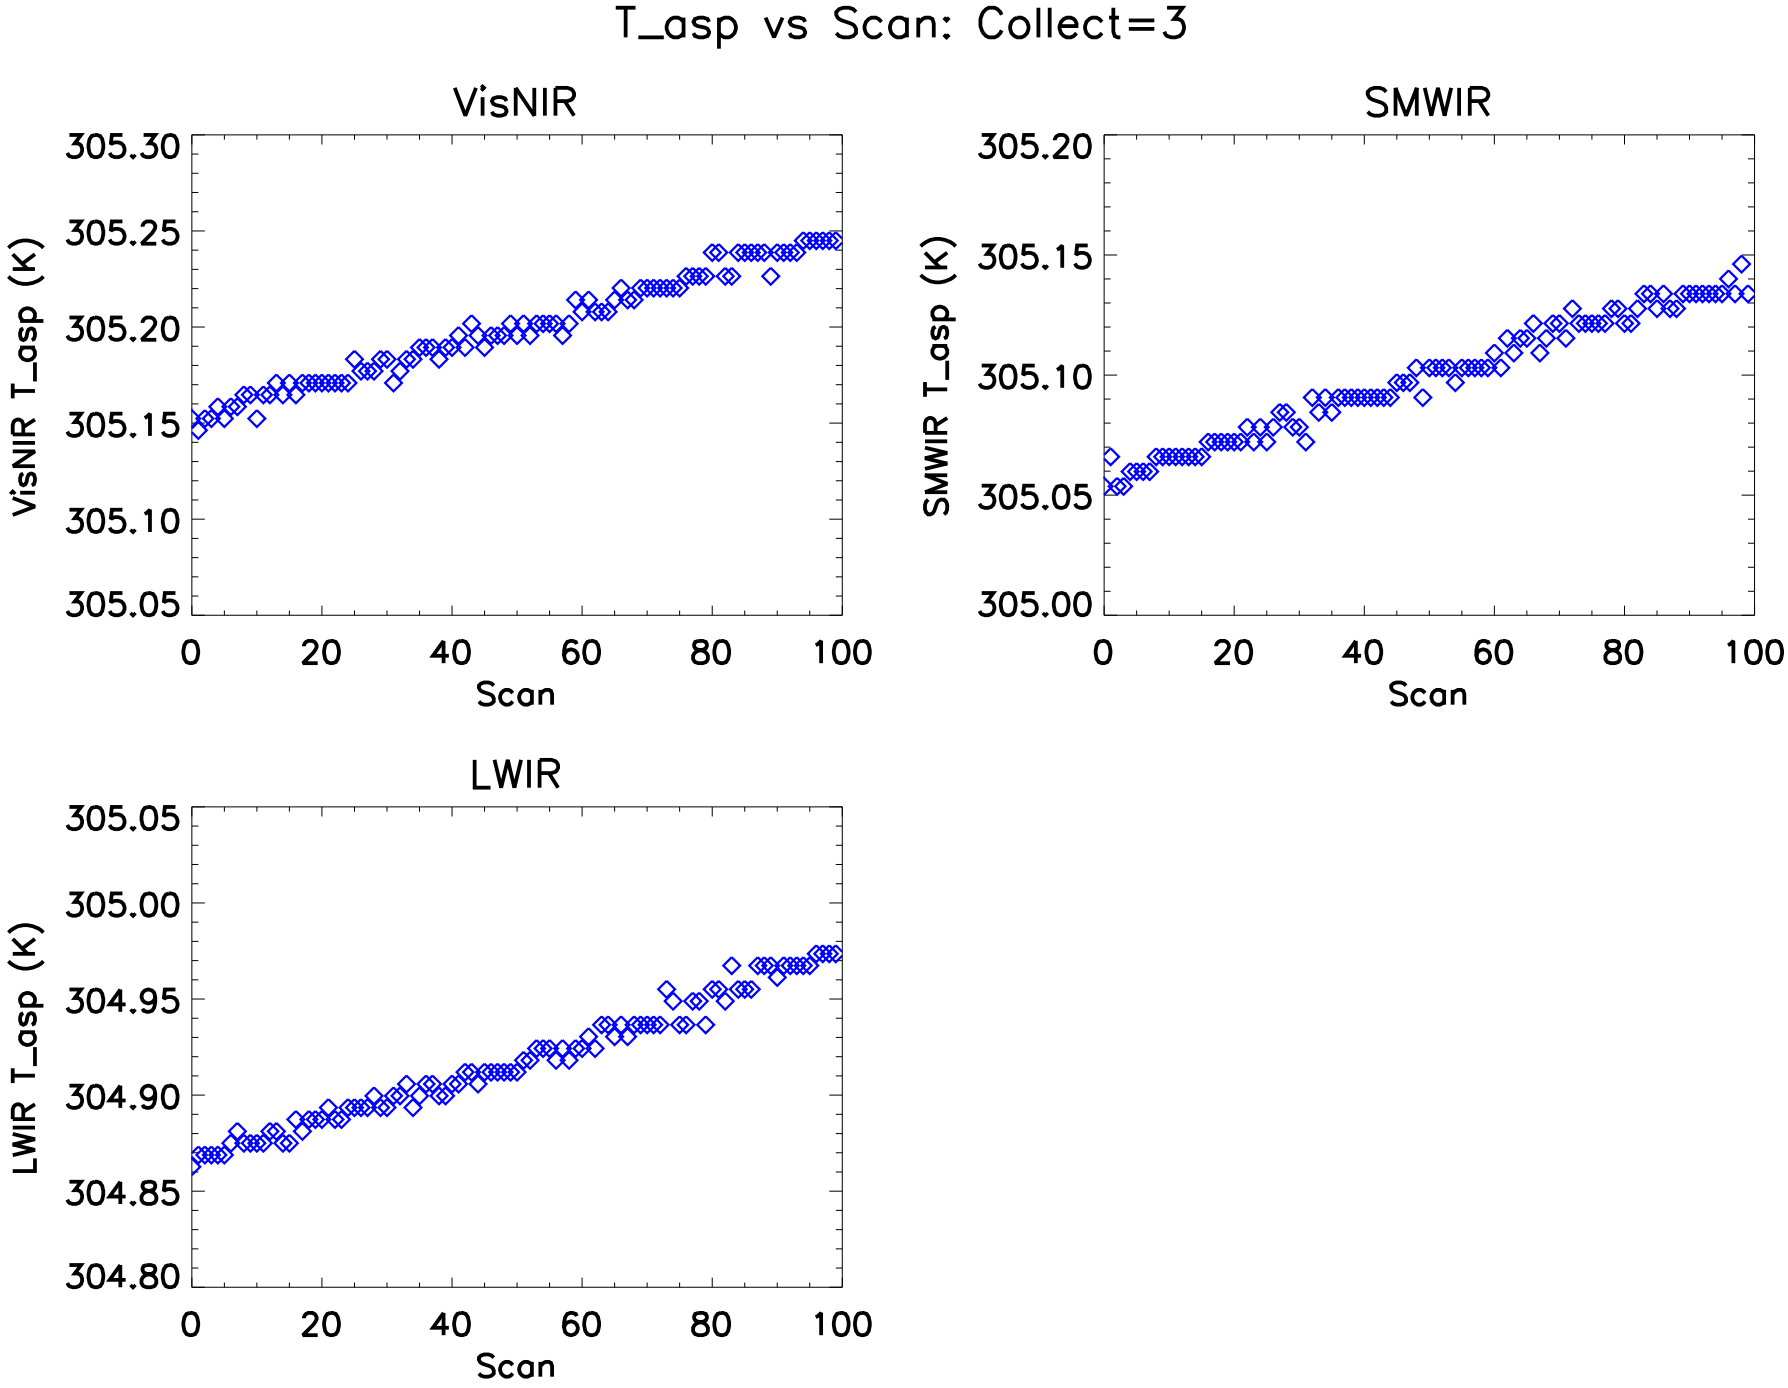
T_asp vs Scan: Collect=3
VisNIR
VisNIR T_asp (K)
305.30
305.25
305.20
305.15
305.10
305.05
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.20
305.15
305.10
305.05
305.00
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.05
305.00
304.95
304.90
304.85
304.80
0
20
40
60
80
100
Scan

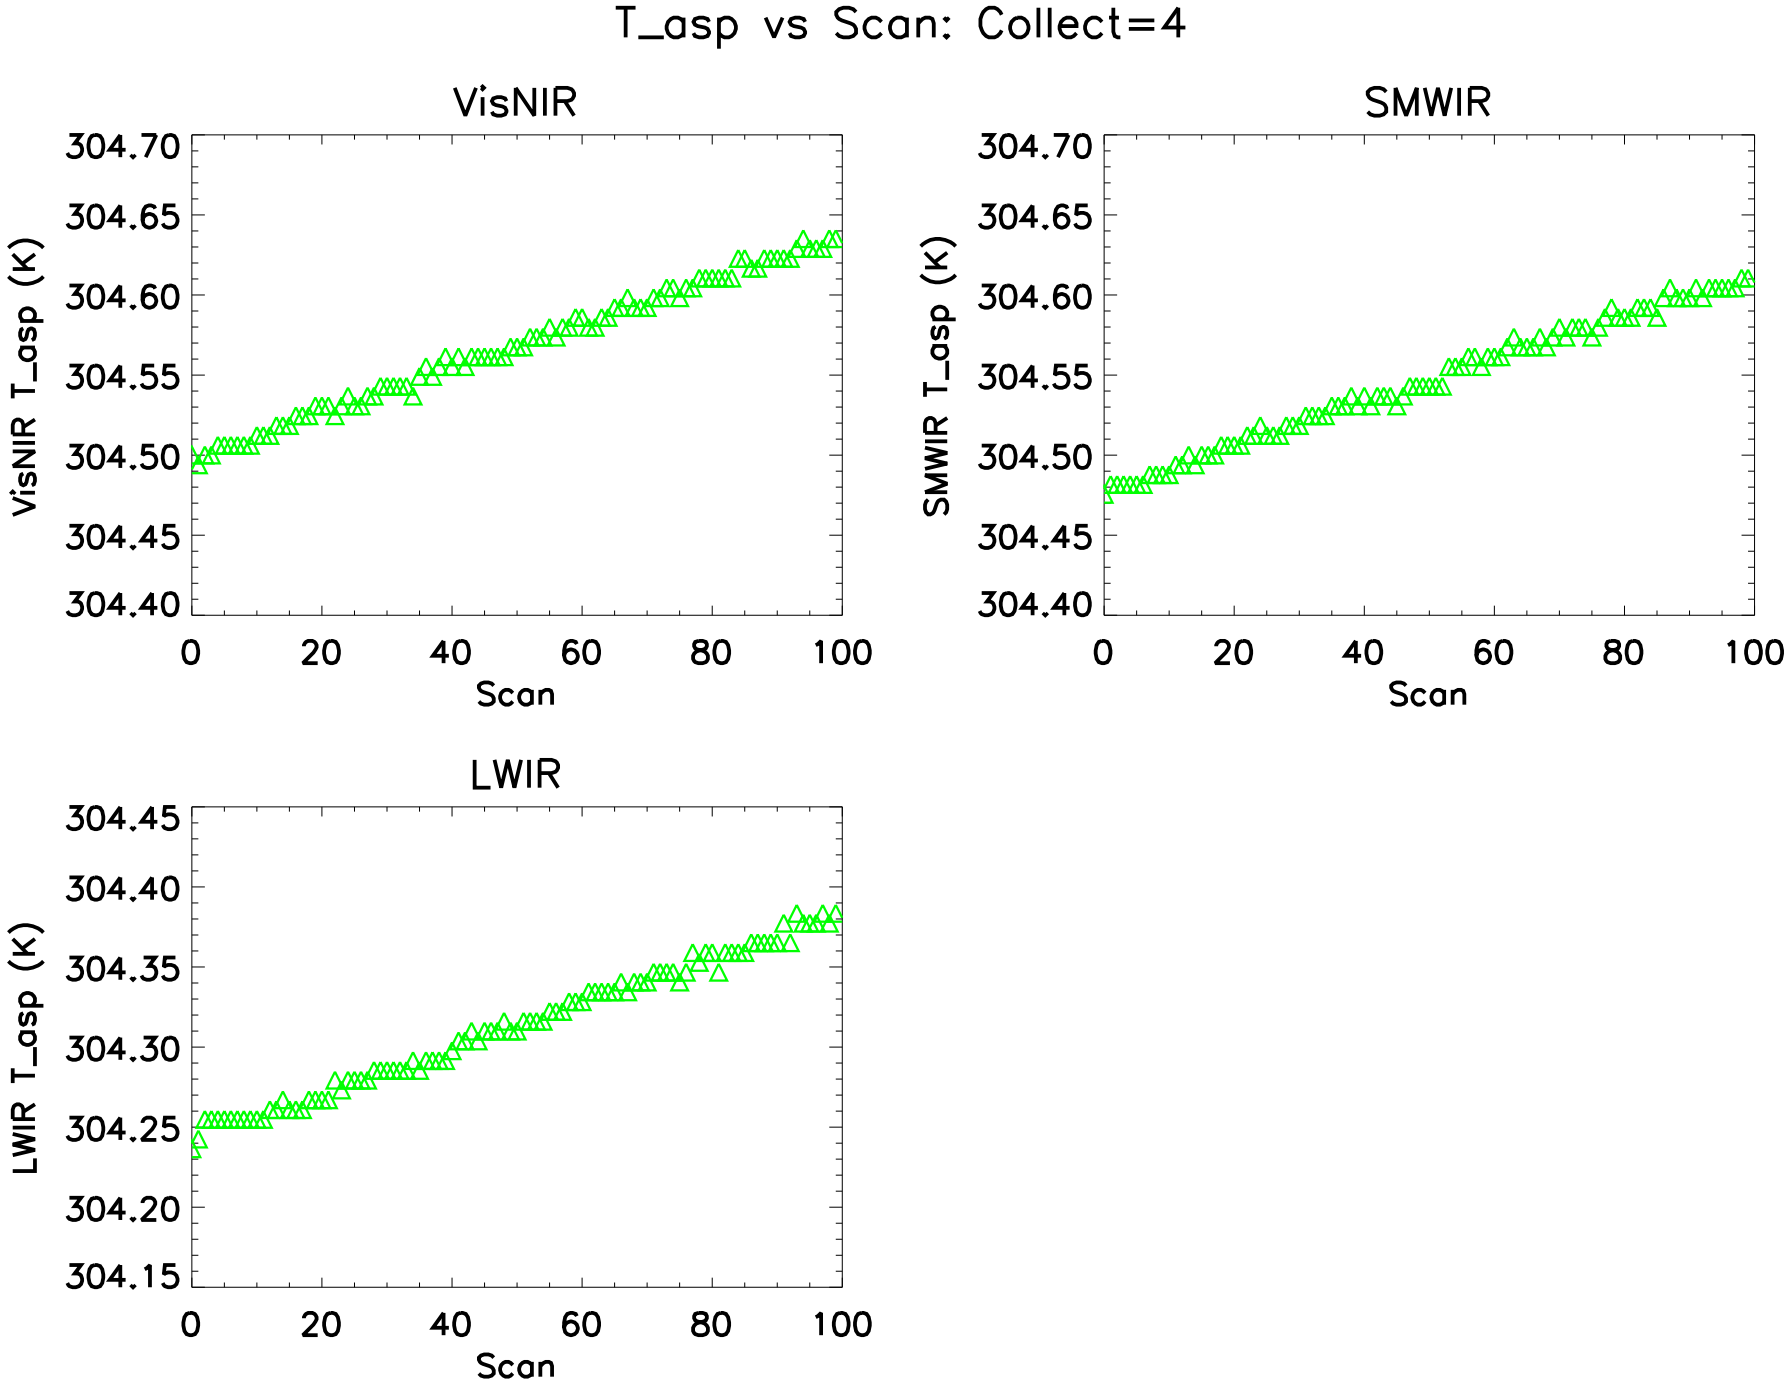
T_asp vs Scan: Collect=4
VisNIR
VisNIR T_asp (K)
304.70
304.65
304.60
304.55
304.50
304.45
304.40
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
304.70
304.65
304.60
304.55
304.50
304.45
304.40
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
304.45
304.40
304.35
304.30
304.25
304.20
304.15
0
20
40
60
80
100
Scan

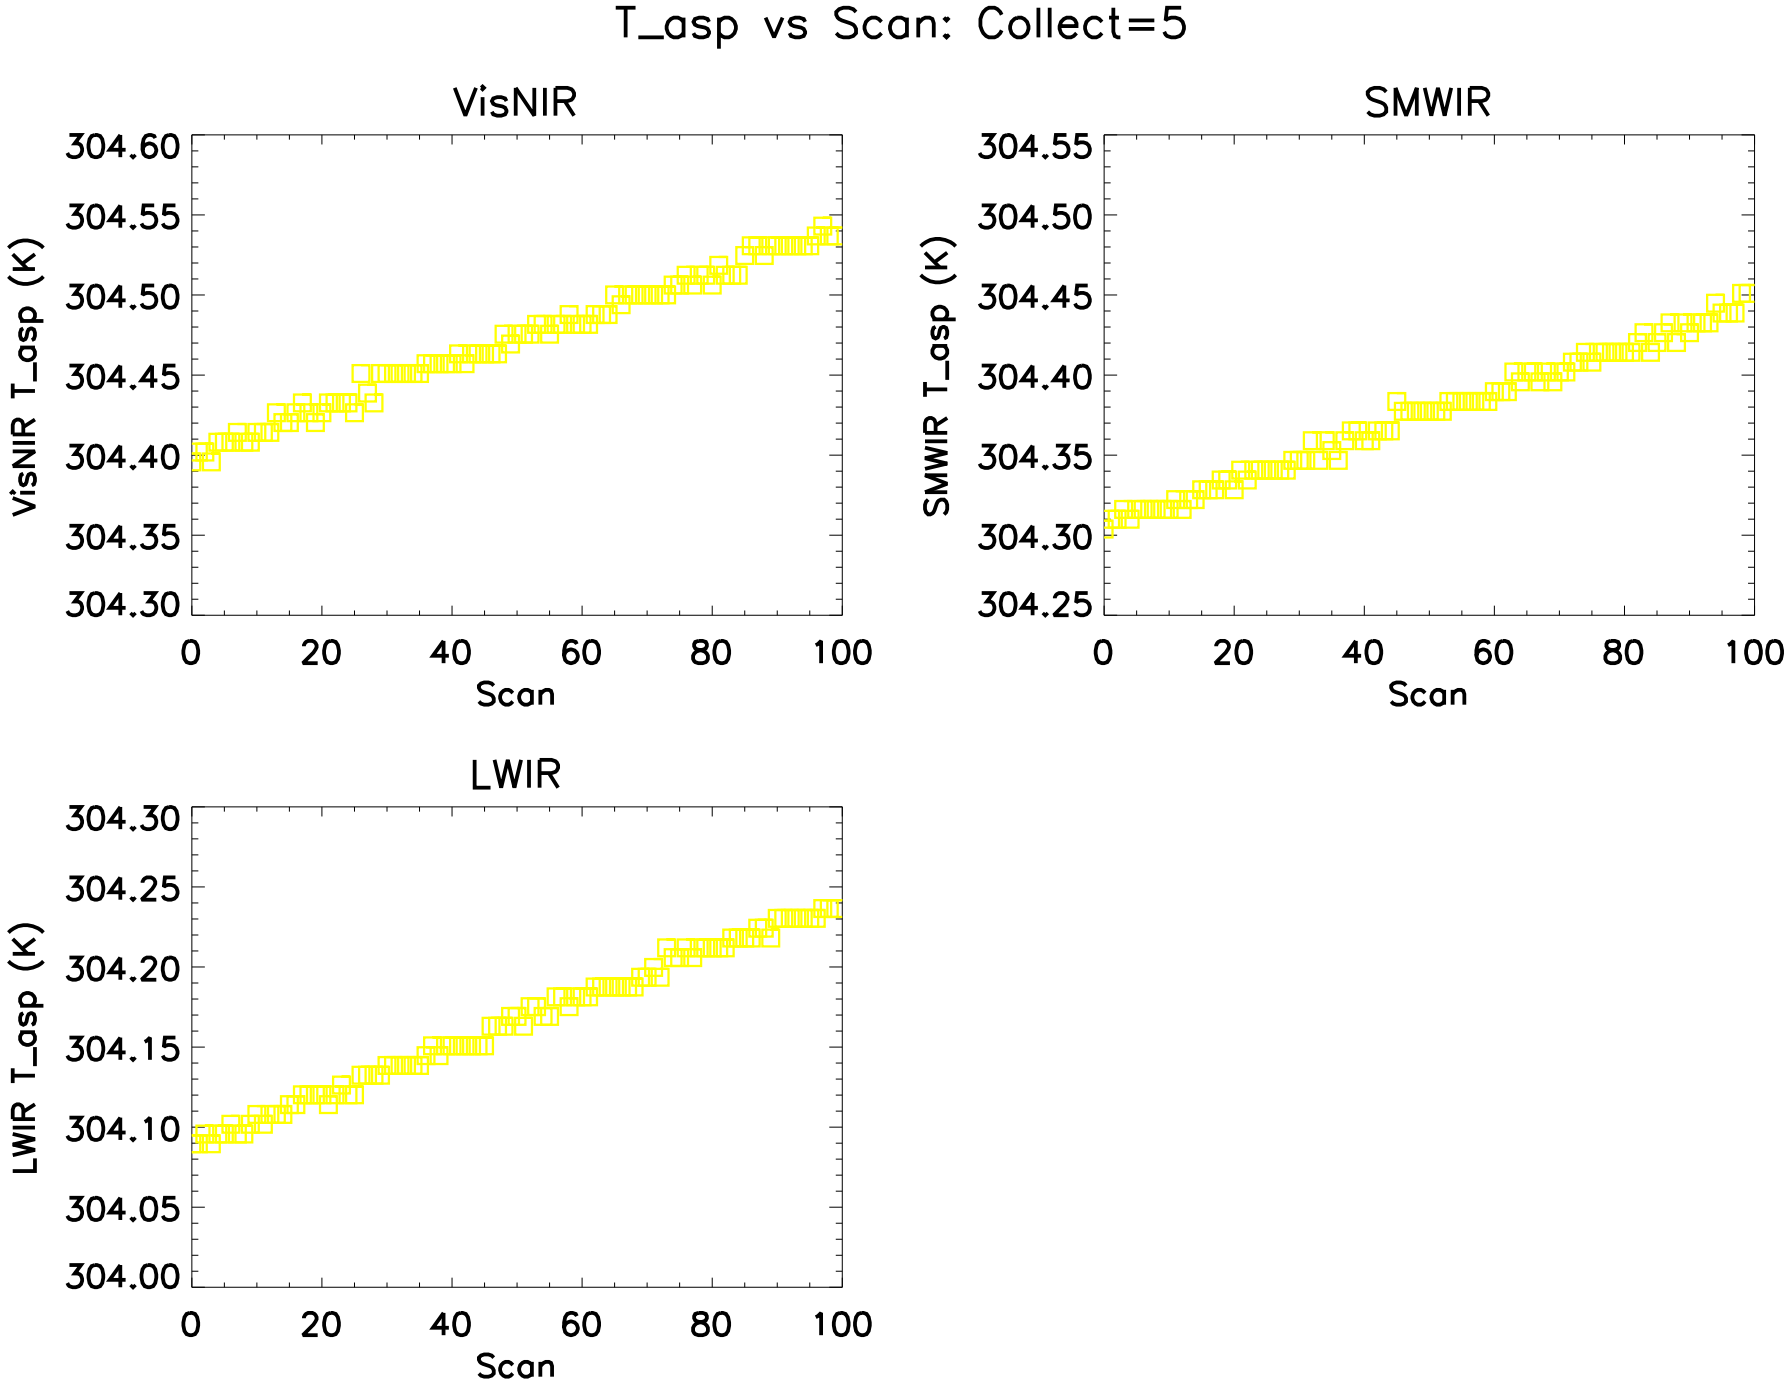
T_asp vs Scan: Collect=5
VisNIR
VisNIR T_asp (K)
304.60
304.55
304.50
304.45
304.40
304.35
304.30
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
304.55
304.50
304.45
304.40
304.35
304.30
304.25
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
304.30
304.25
304.20
304.15
304.10
304.05
304.00
0
20
40
60
80
100
Scan

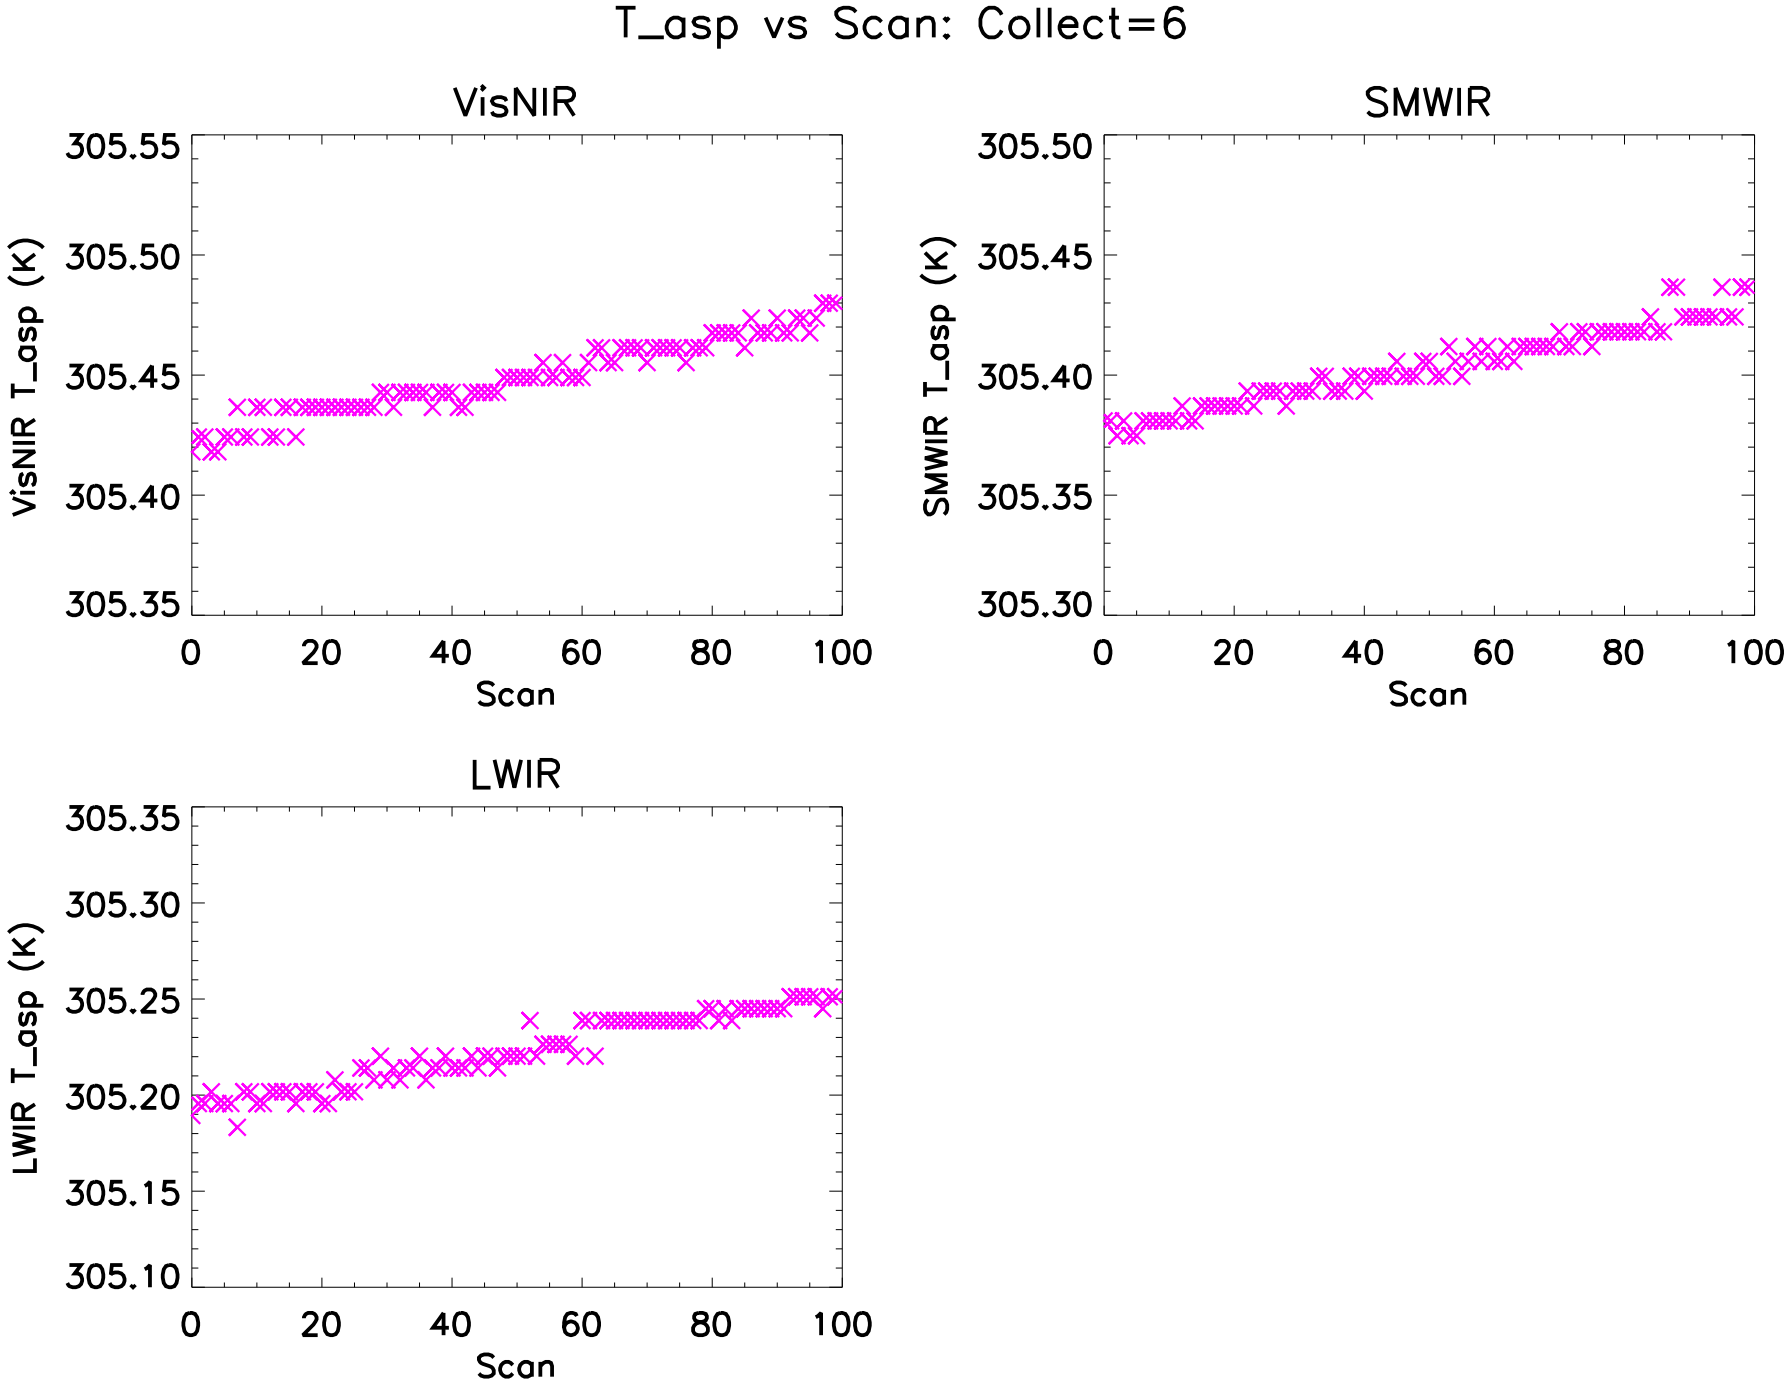
T_asp vs Scan: Collect=6
VisNIR
VisNIR T_asp (K)
305.55
305.50
305.45
305.40
305.35
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.50
305.45
305.40
305.35
305.30
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.35
305.30
305.25
305.20
305.15
305.10
0
20
40
60
80
100
Scan

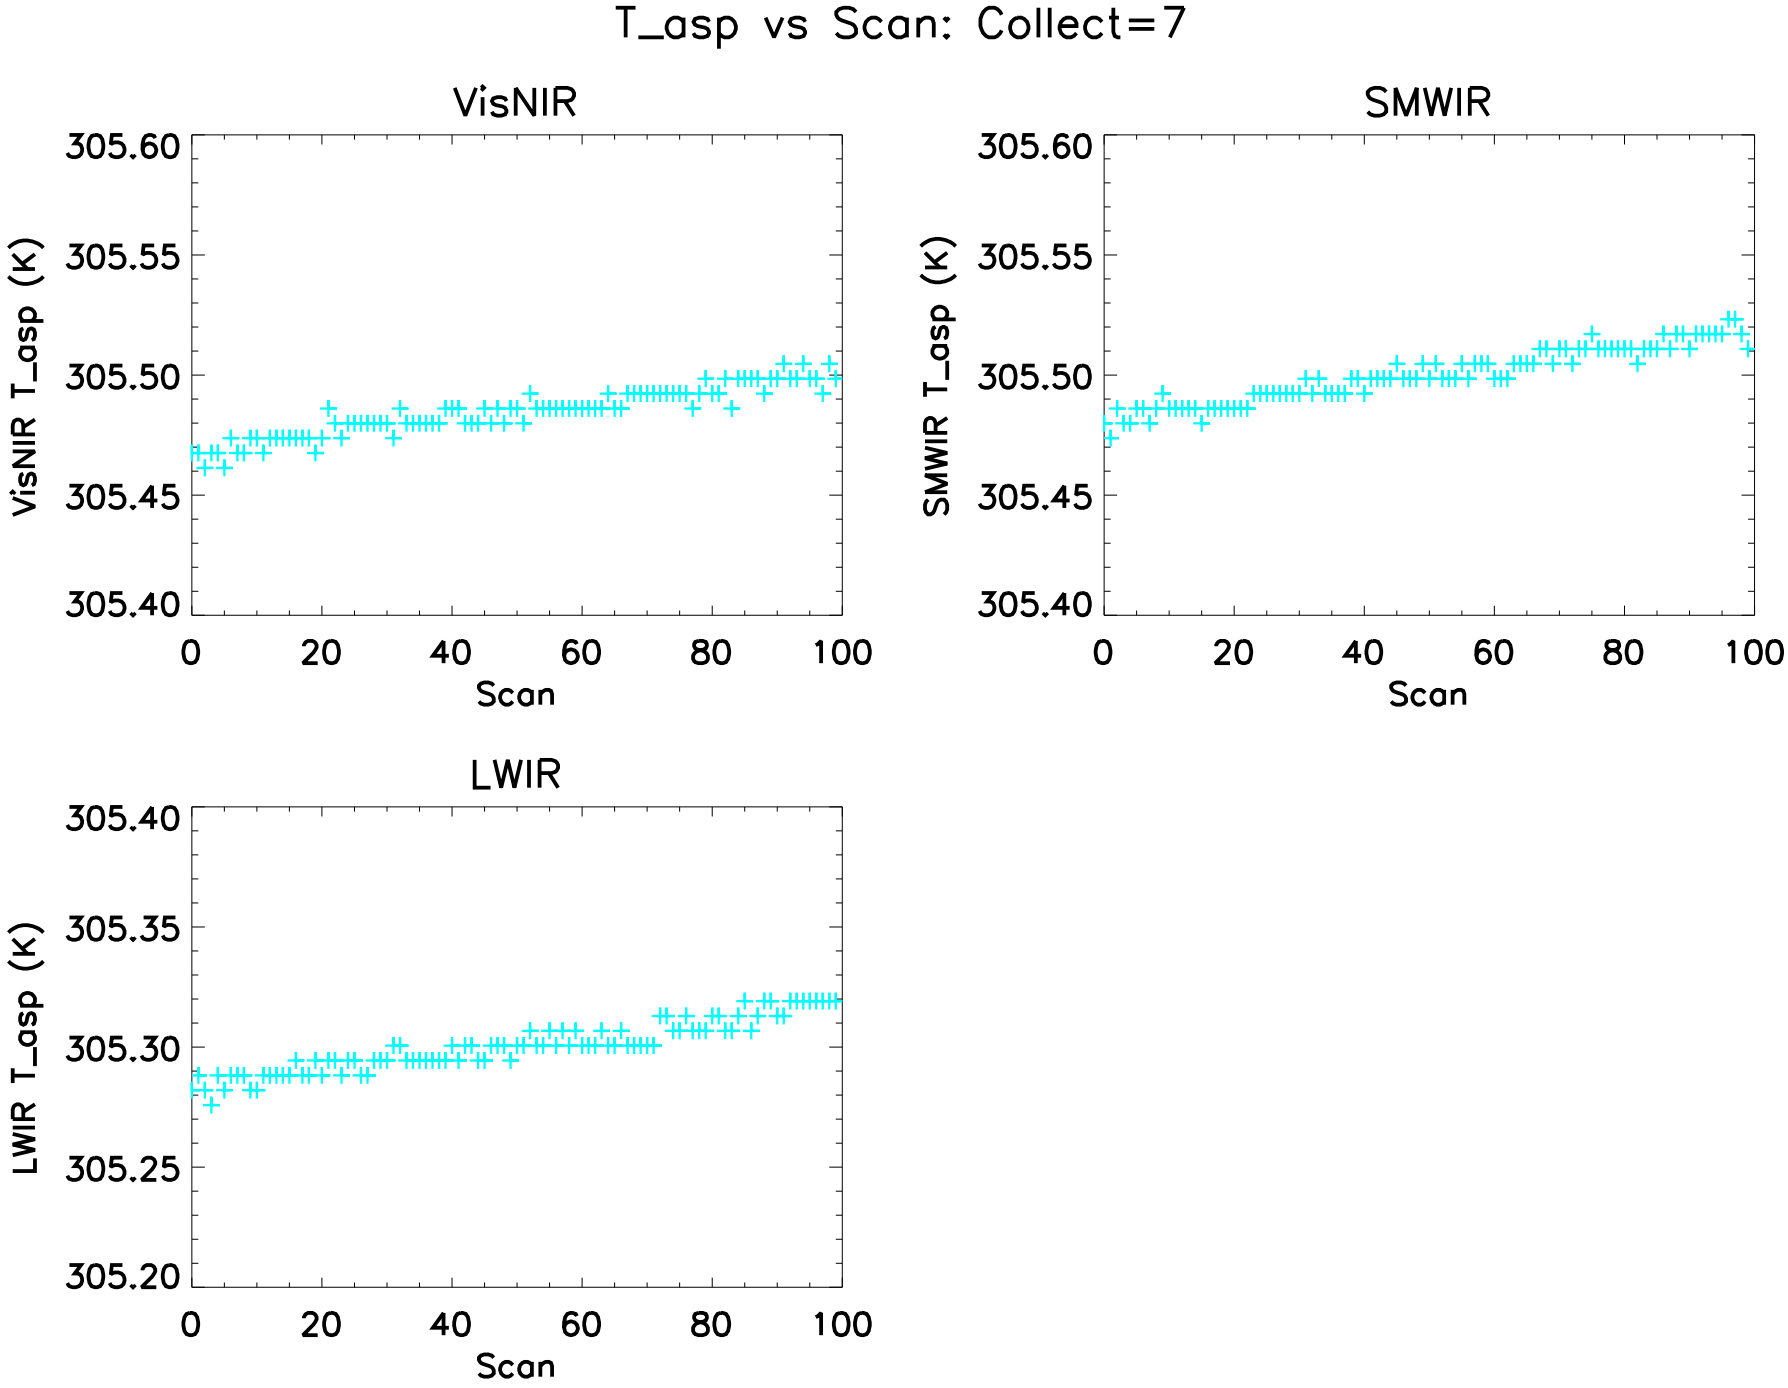
T_asp vs Scan: Collect=7
VisNIR
VisNIR T_asp (K)
305.60
305.55
305.50
305.45
305.40
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.60
305.55
305.50
305.45
305.40
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.40
305.35
305.30
305.25
305.20
0
20
40
60
80
100
Scan

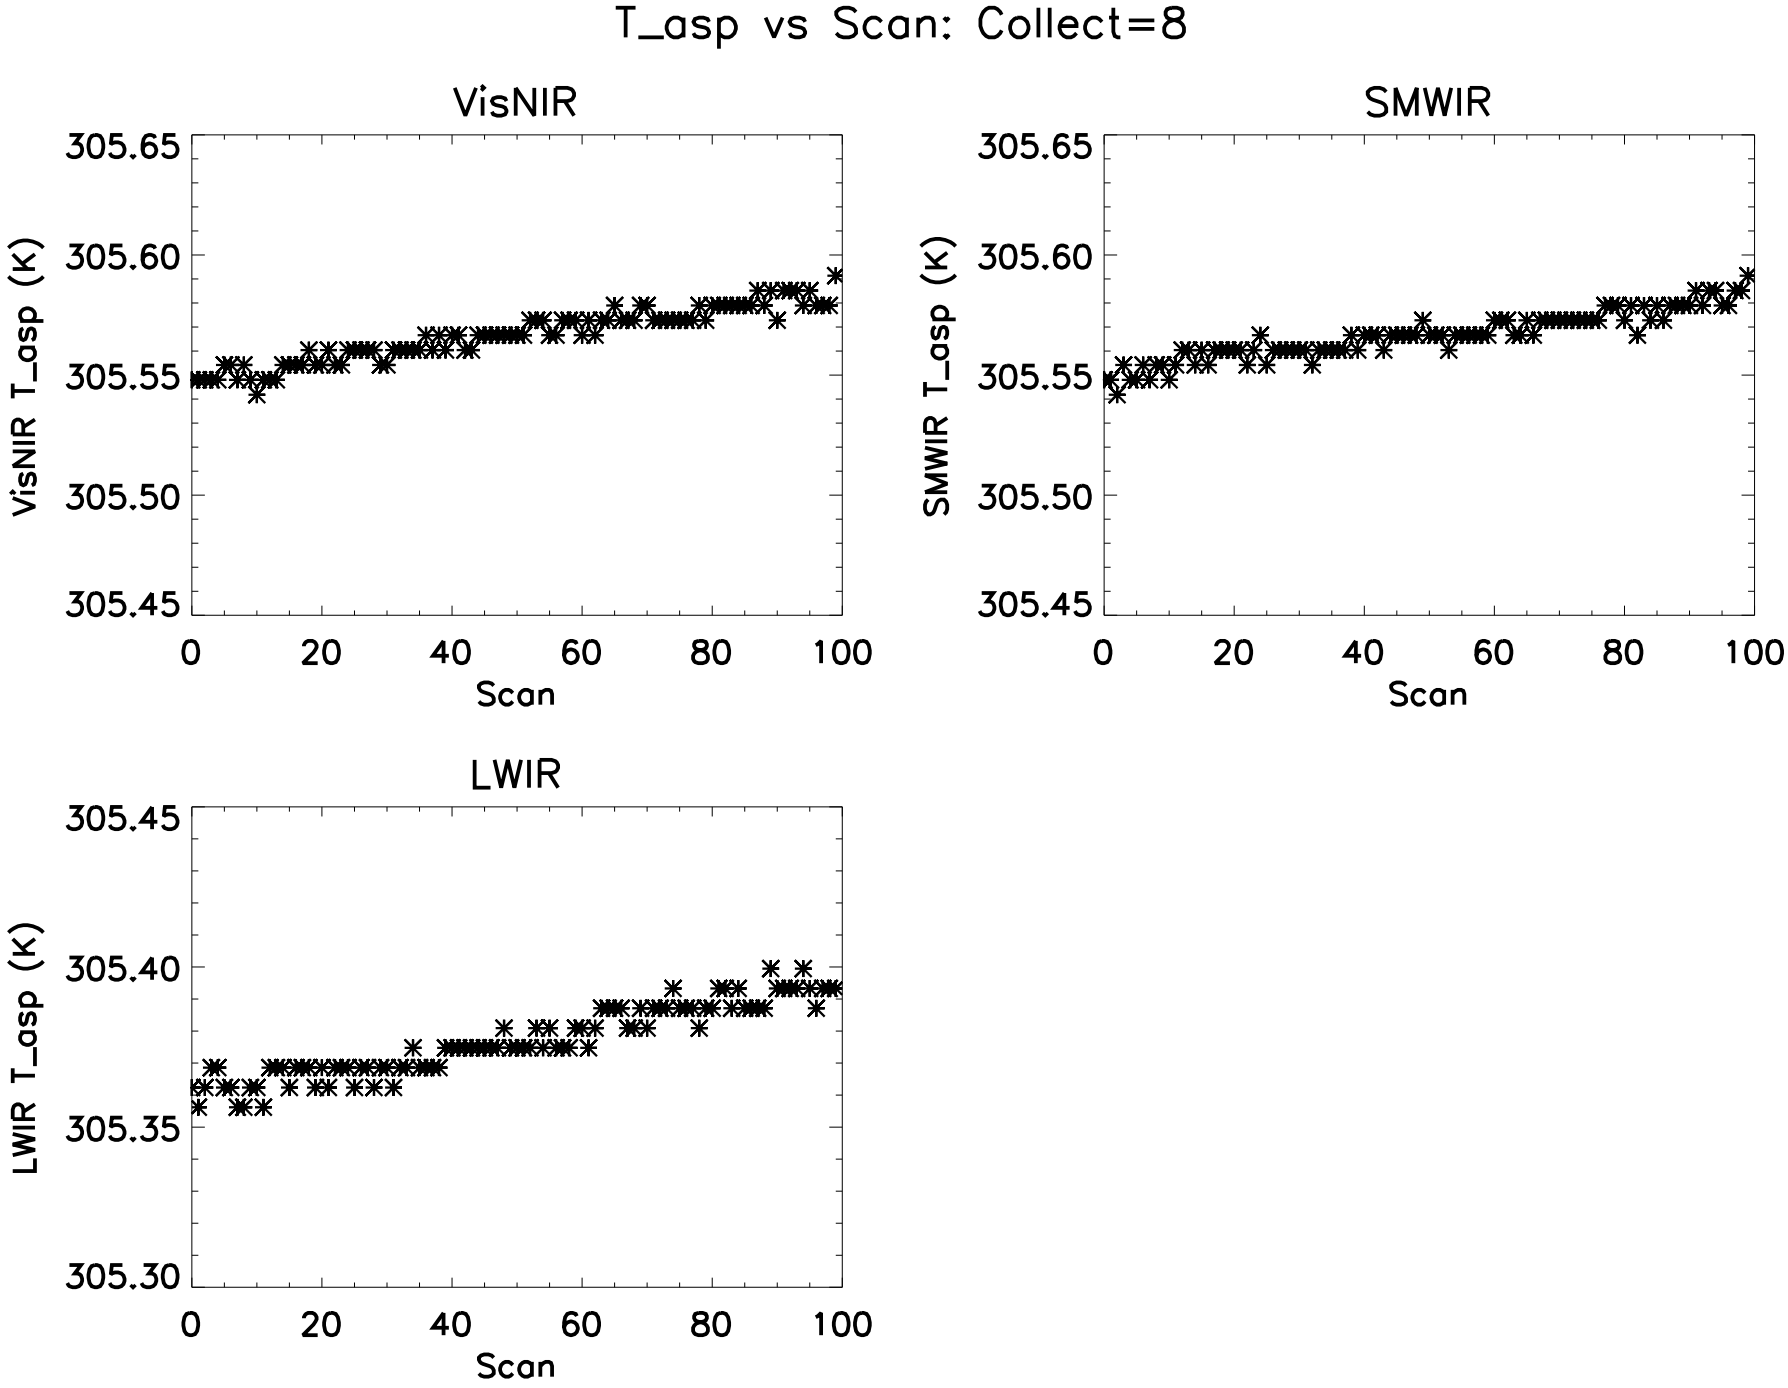
T_asp vs Scan: Collect=8
VisNIR
VisNIR T_asp (K)
305.65
305.60
305.55
305.50
305.45
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.65
305.60
305.55
305.50
305.45
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.45
305.40
305.35
305.30
0
20
40
60
80
100
Scan

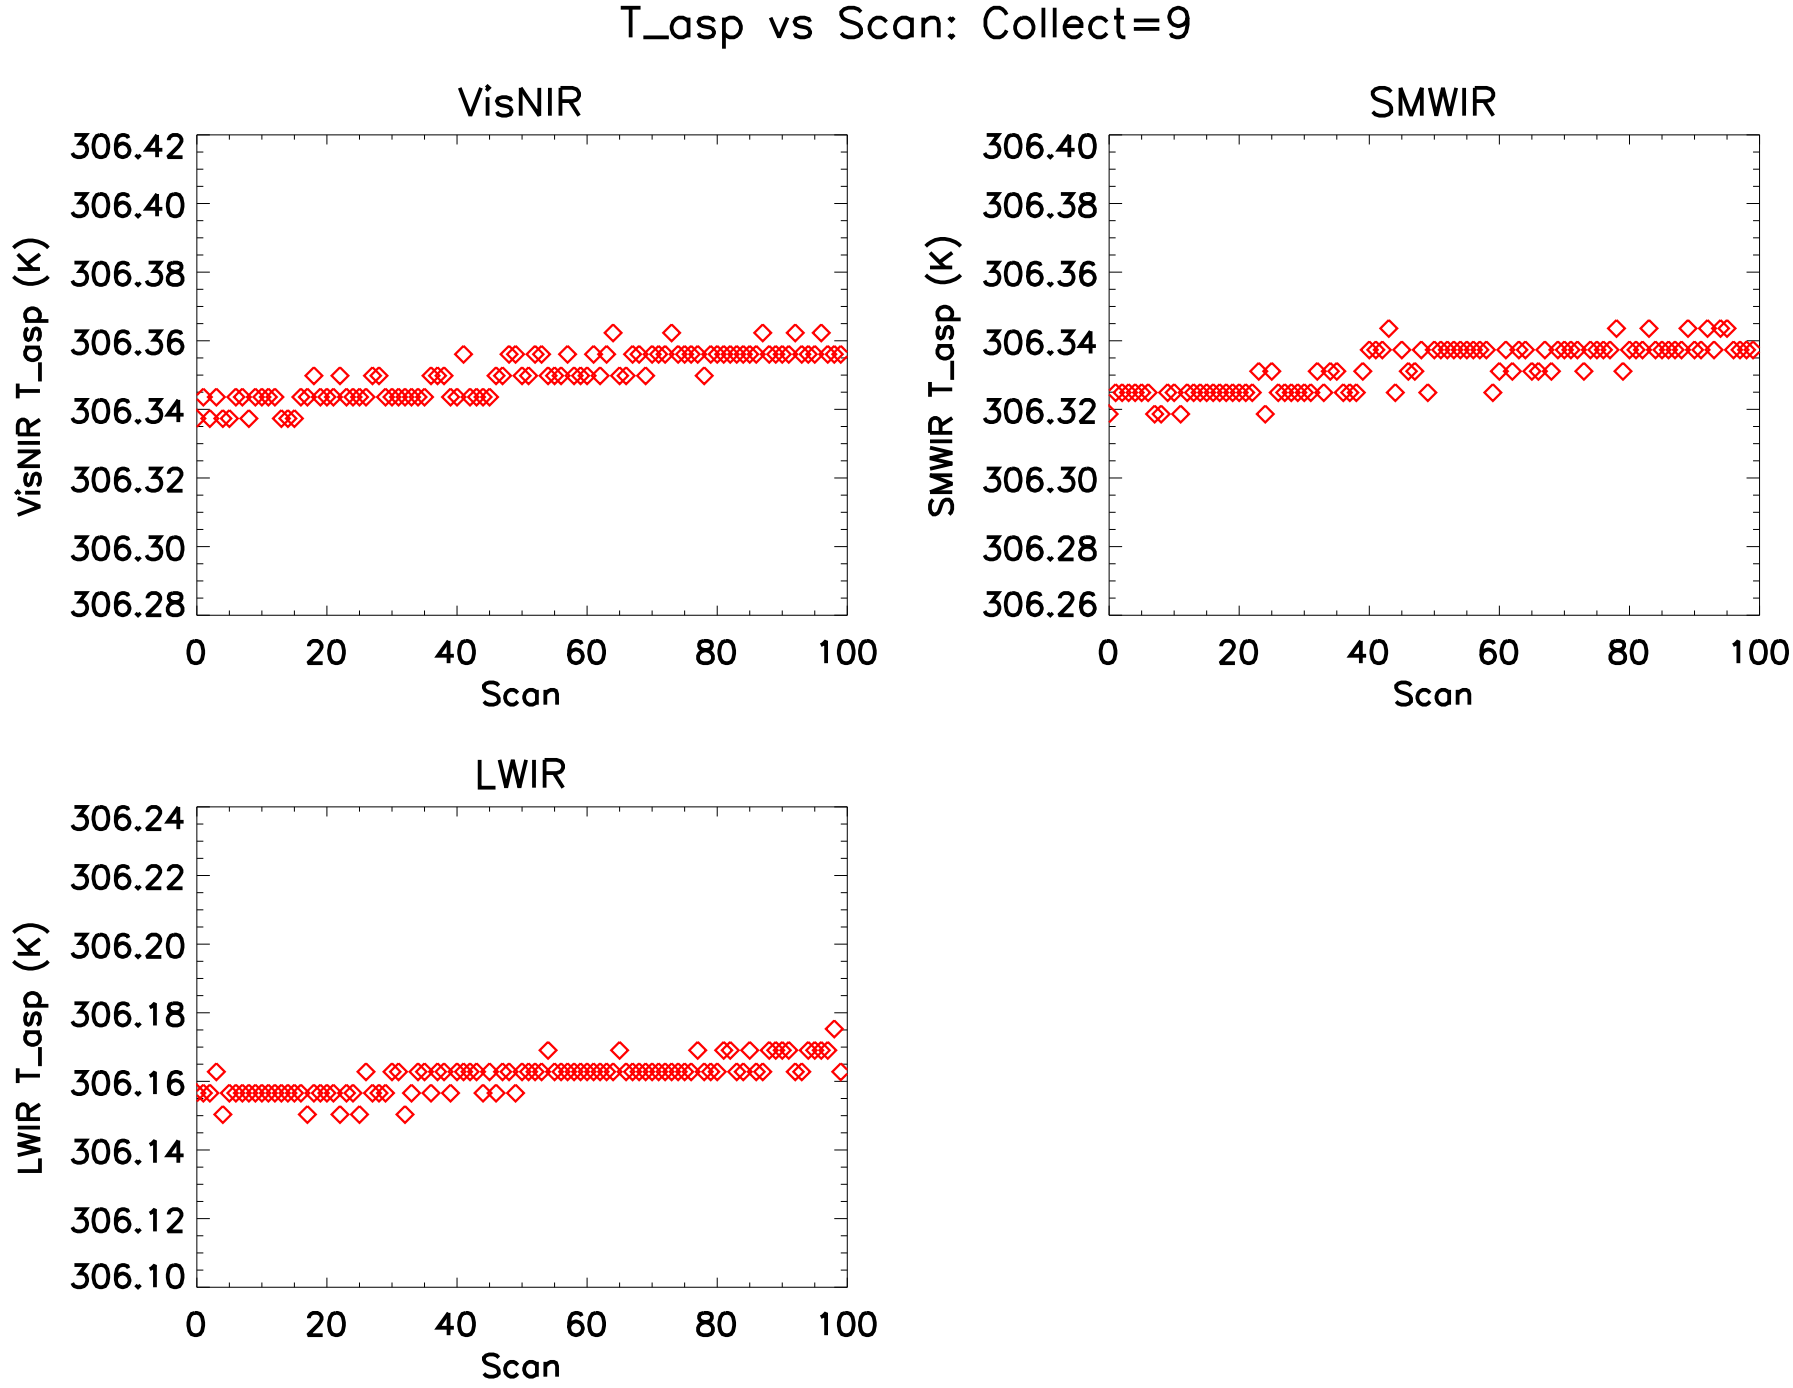
T_asp vs Scan: Collect=9
VisNIR
VisNIR T_asp (K)
306.42
306.40
306.38
306.36
306.34
306.32
306.30
306.28
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
306.40
306.38
306.36
306.34
306.32
306.30
306.28
306.26
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
306.24
306.22
306.20
306.18
306.16
306.14
306.12
306.10
0
20
40
60
80
100
Scan

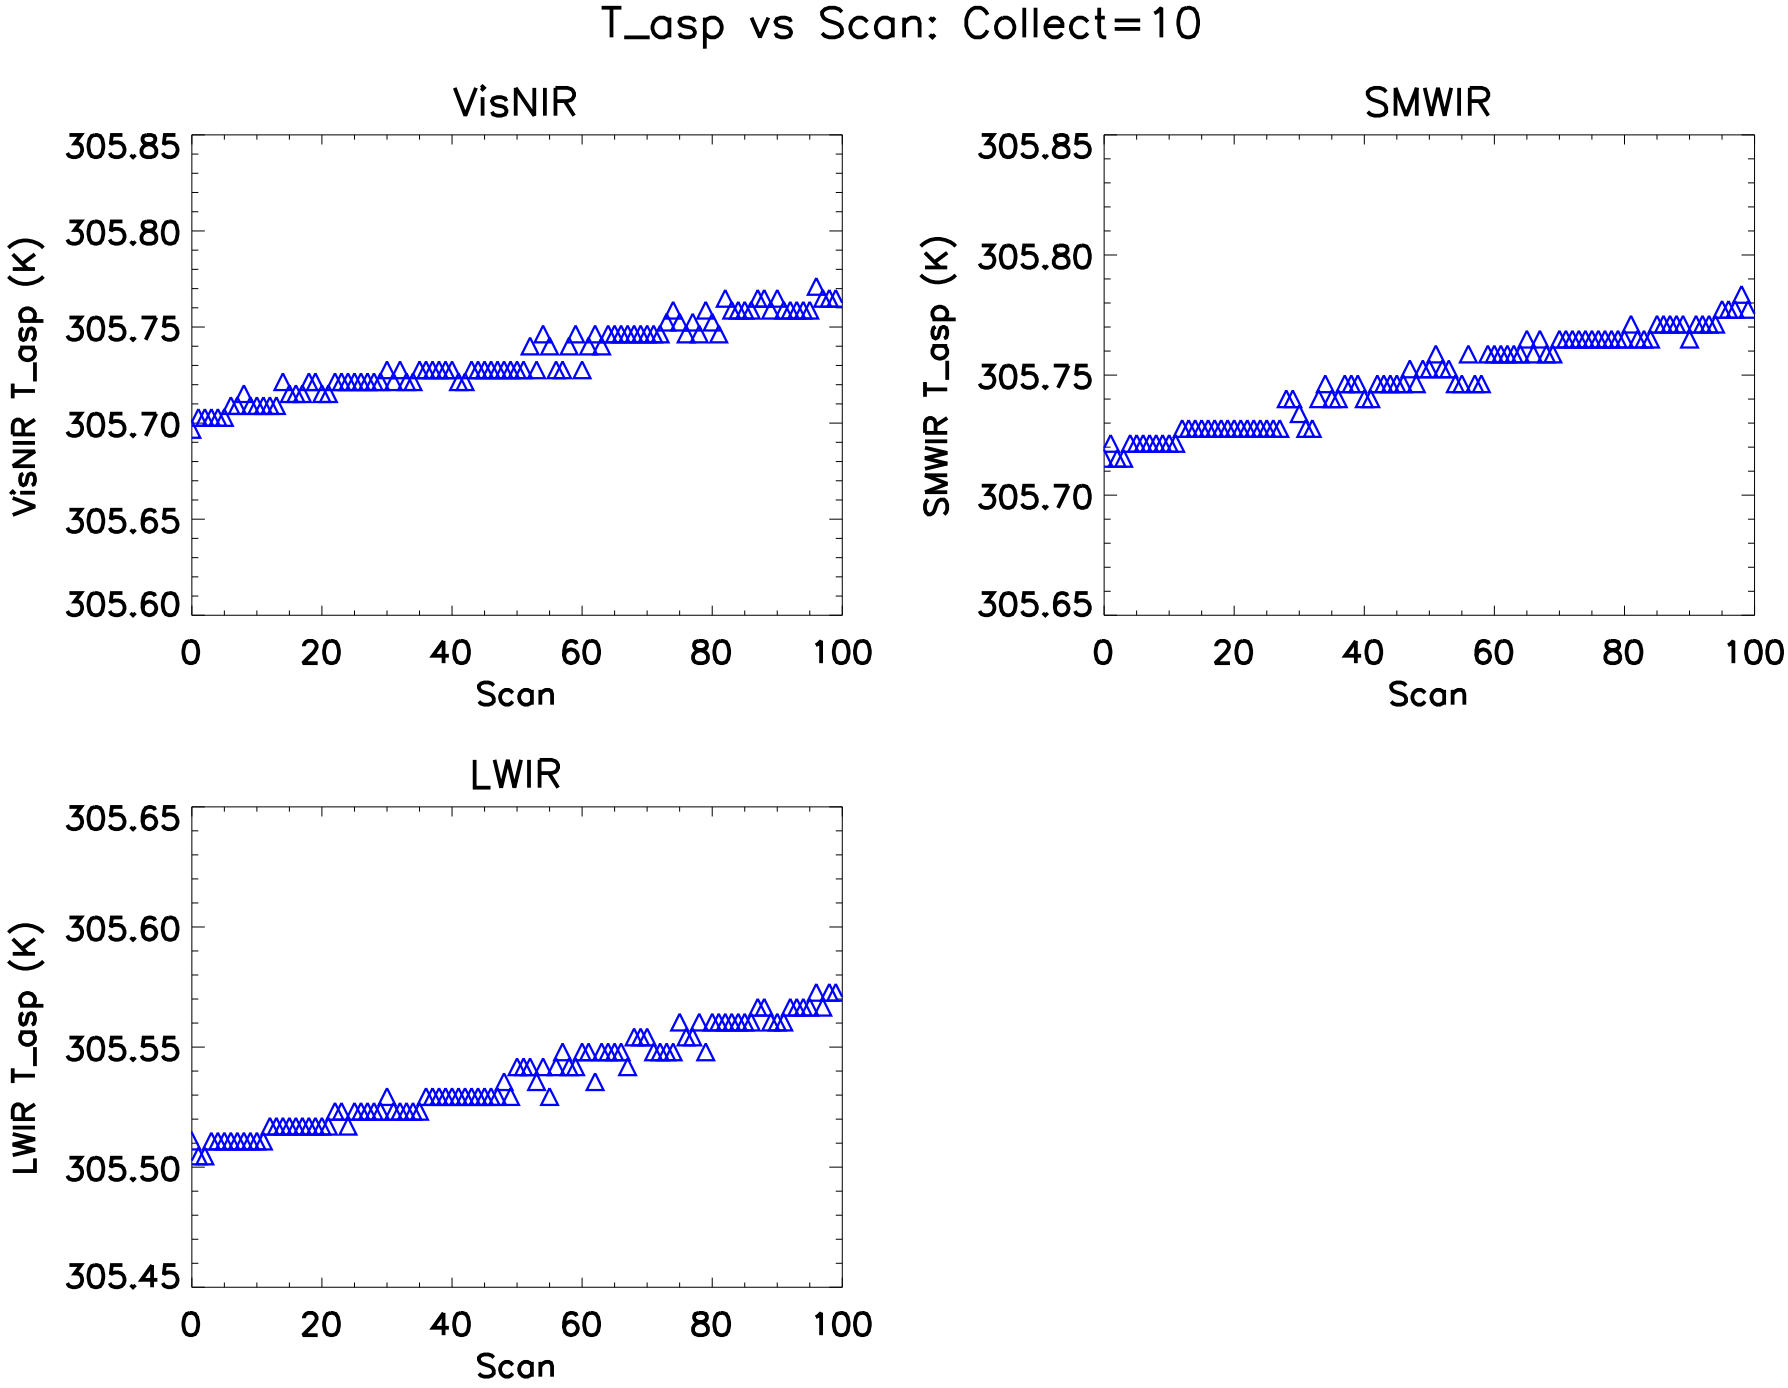
T_asp vs Scan: Collect=10
VisNIR
VisNIR T_asp (K)
305.85
305.80
305.75
305.70
305.65
305.60
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.85
305.80
305.75
305.70
305.65
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.65
305.60
305.55
305.50
305.45
0
20
40
60
80
100
Scan

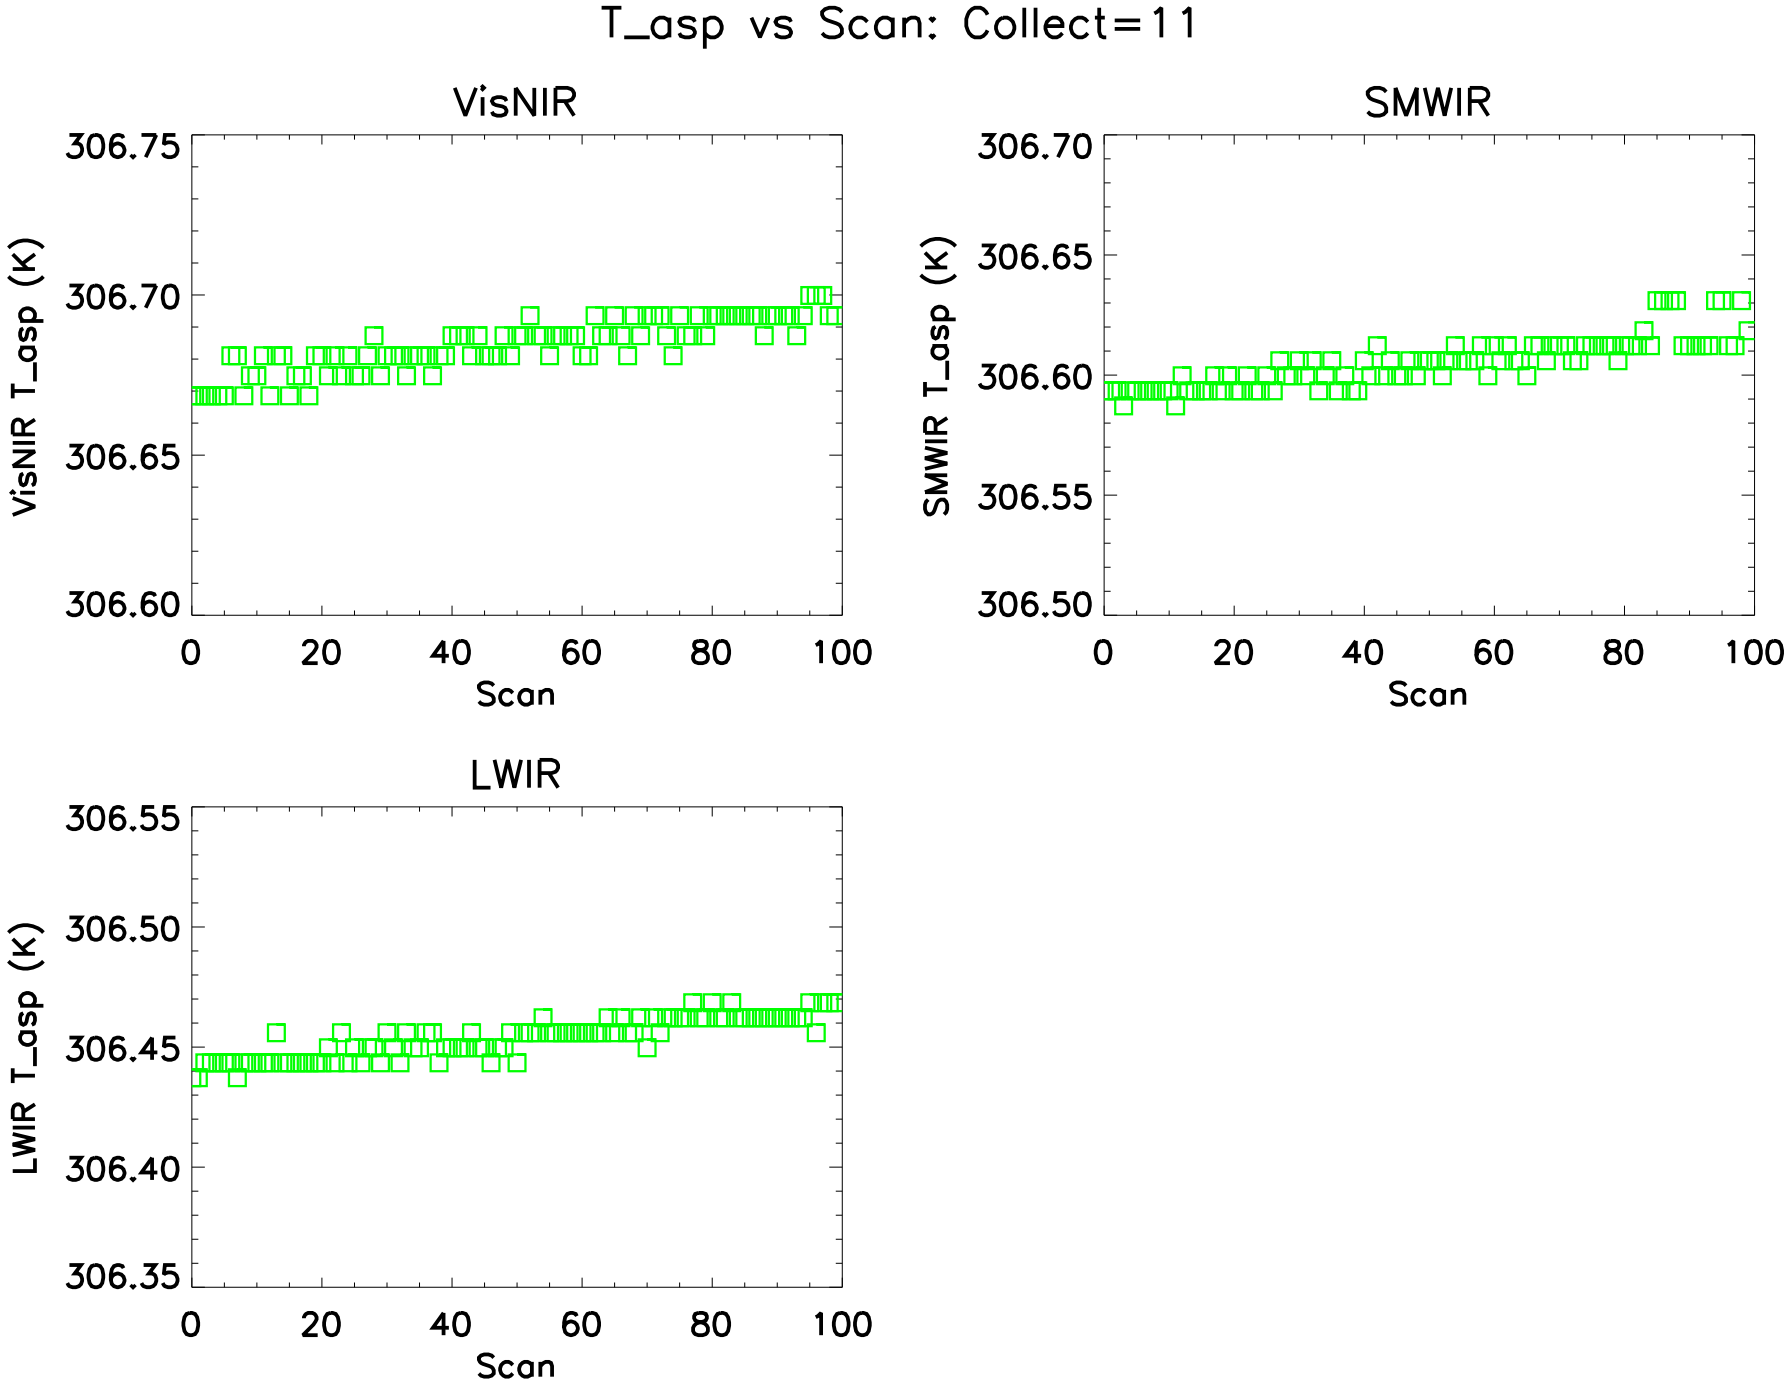
T_asp vs Scan: Collect=11
VisNIR
VisNIR T_asp (K)
306.75
306.70
306.65
306.60
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
306.70
306.65
306.60
306.55
306.50
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
306.55
306.50
306.45
306.40
306.35
0
20
40
60
80
100
Scan

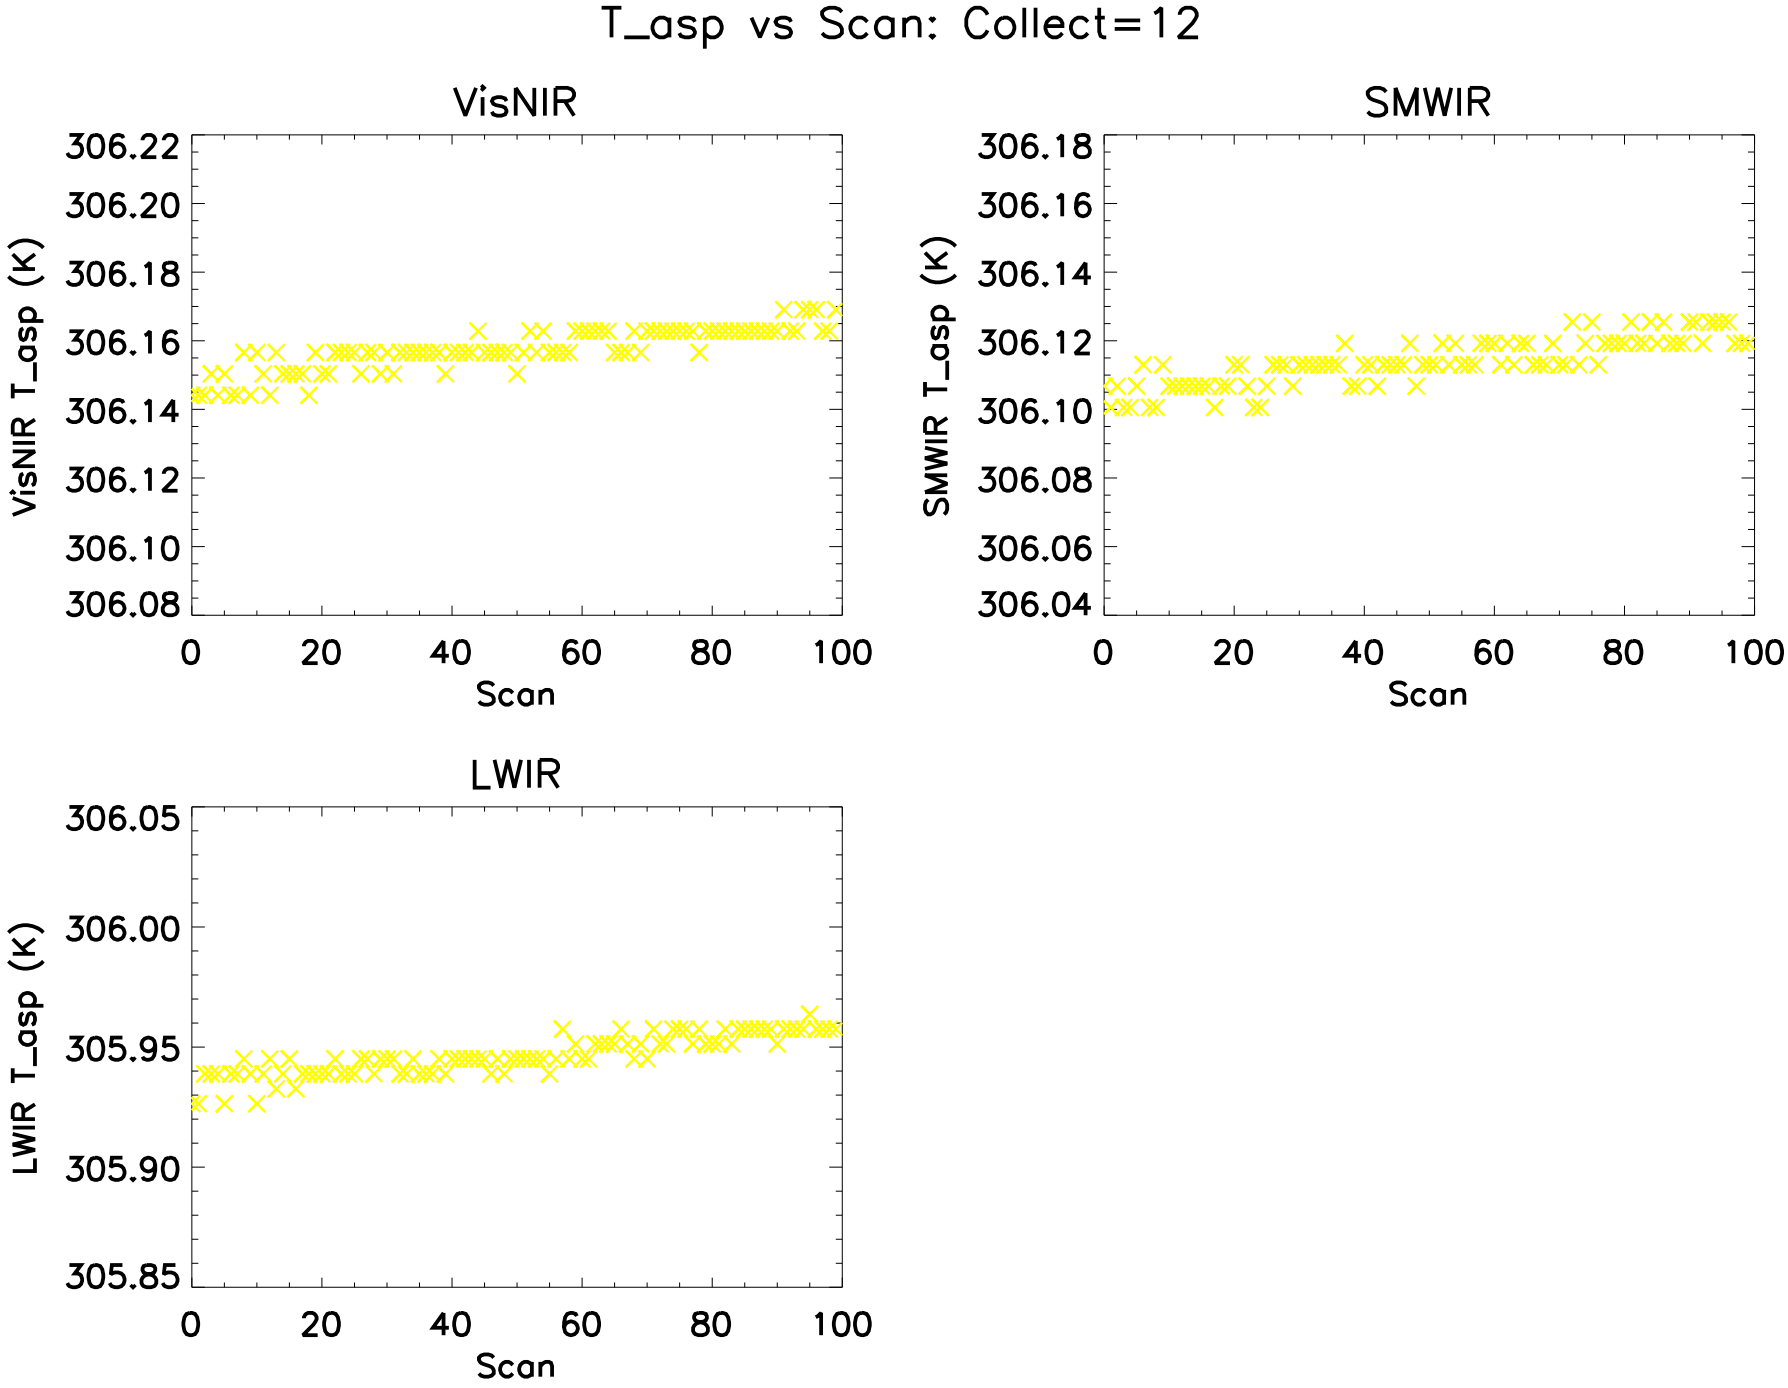
T_asp vs Scan: Collect=12
VisNIR
VisNIR T_asp (K)
306.22
306.20
306.18
306.16
306.14
306.12
306.10
306.08
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
306.18
306.16
306.14
306.12
306.10
306.08
306.06
306.04
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
306.05
306.00
305.95
305.90
305.85
0
20
40
60
80
100
Scan

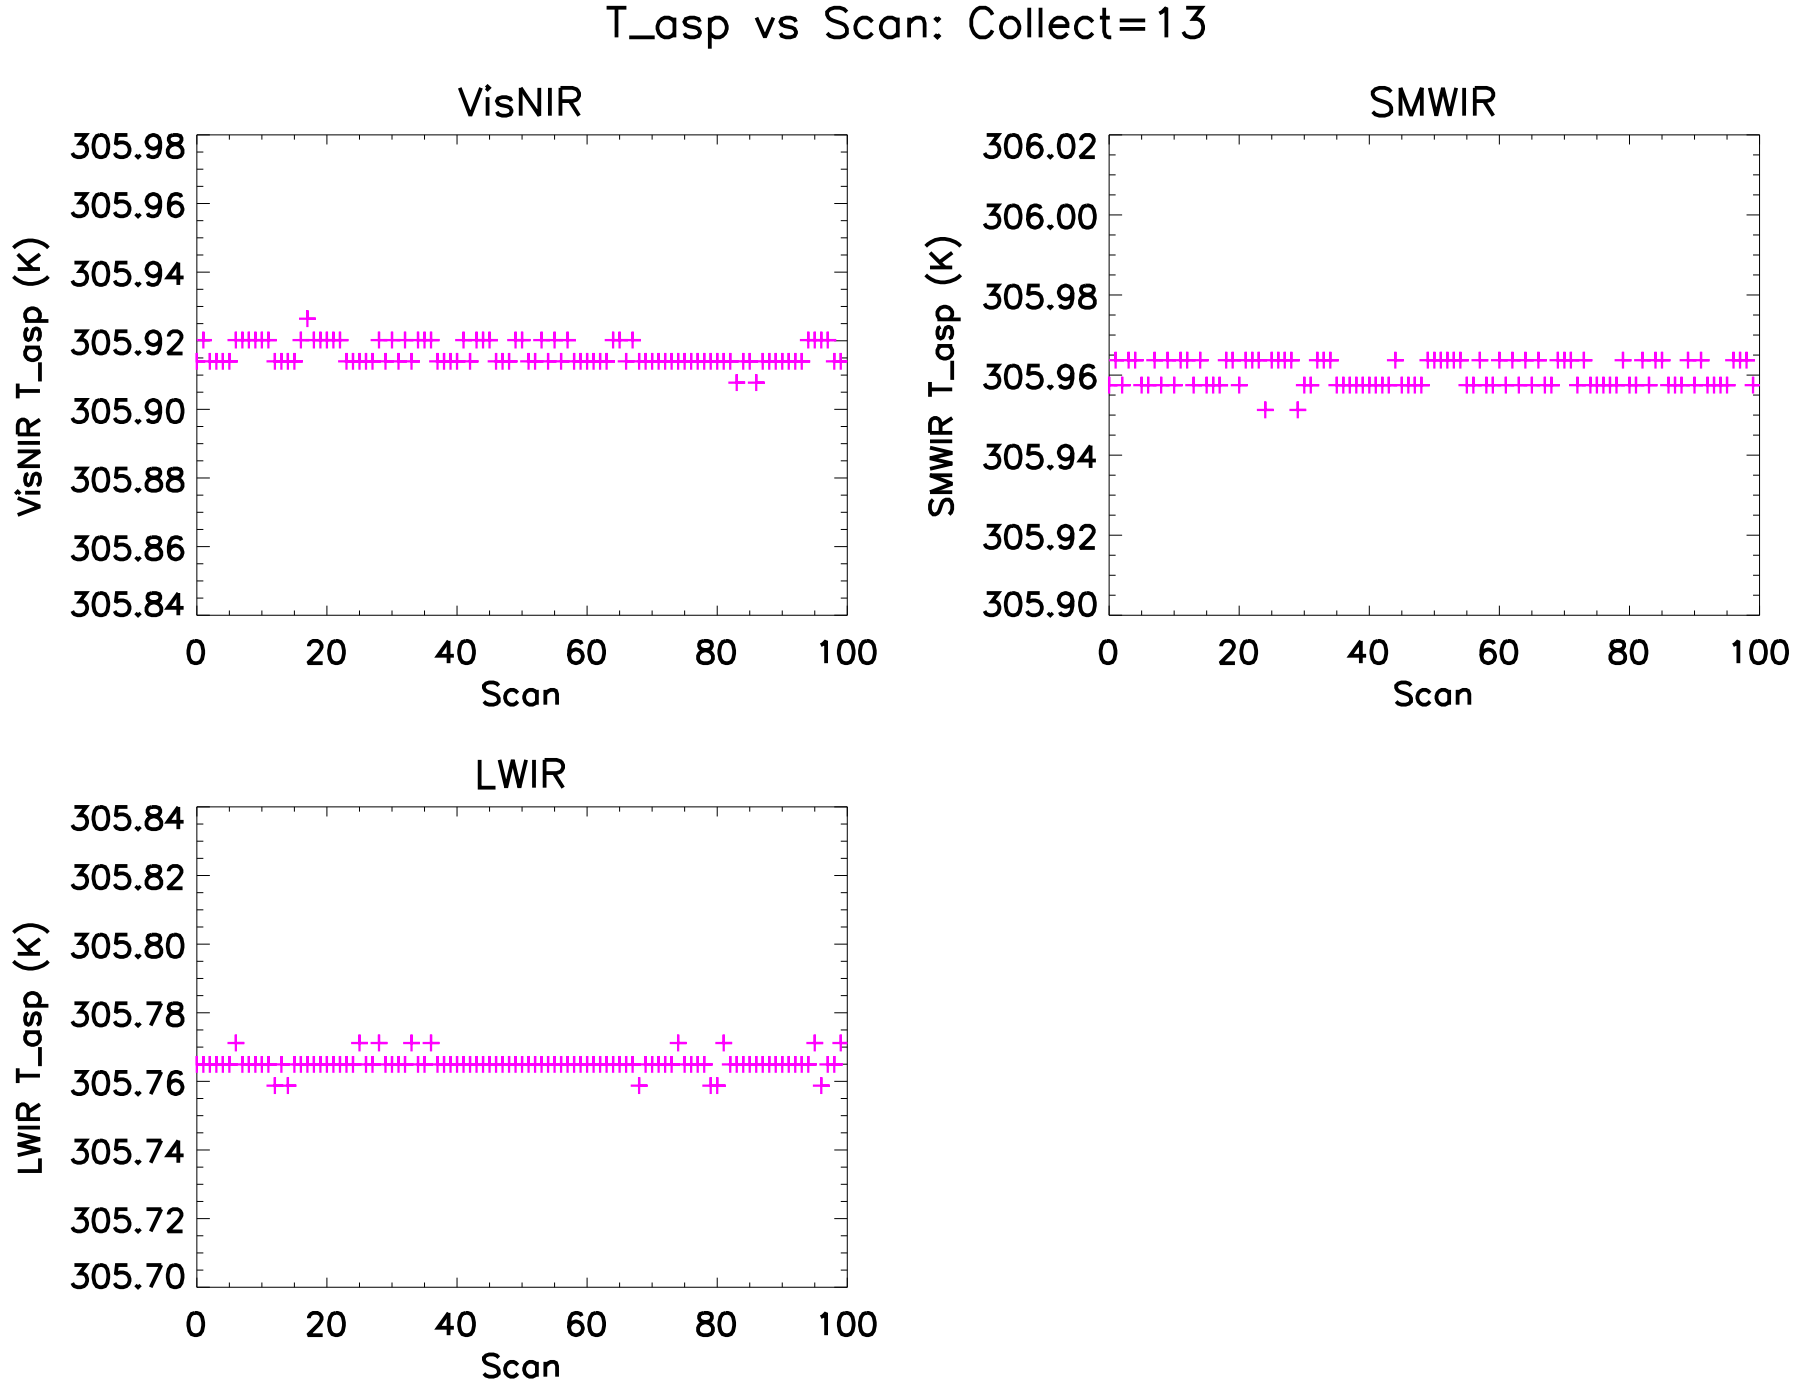
T_asp vs Scan: Collect=13
VisNIR
VisNIR T_asp (K)
305.98
305.96
305.94
305.92
305.90
305.88
305.86
305.84
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
306.02
306.00
305.98
305.96
305.94
305.92
305.90
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.84
305.82
305.80
305.78
305.76
305.74
305.72
305.70
0
20
40
60
80
100
Scan

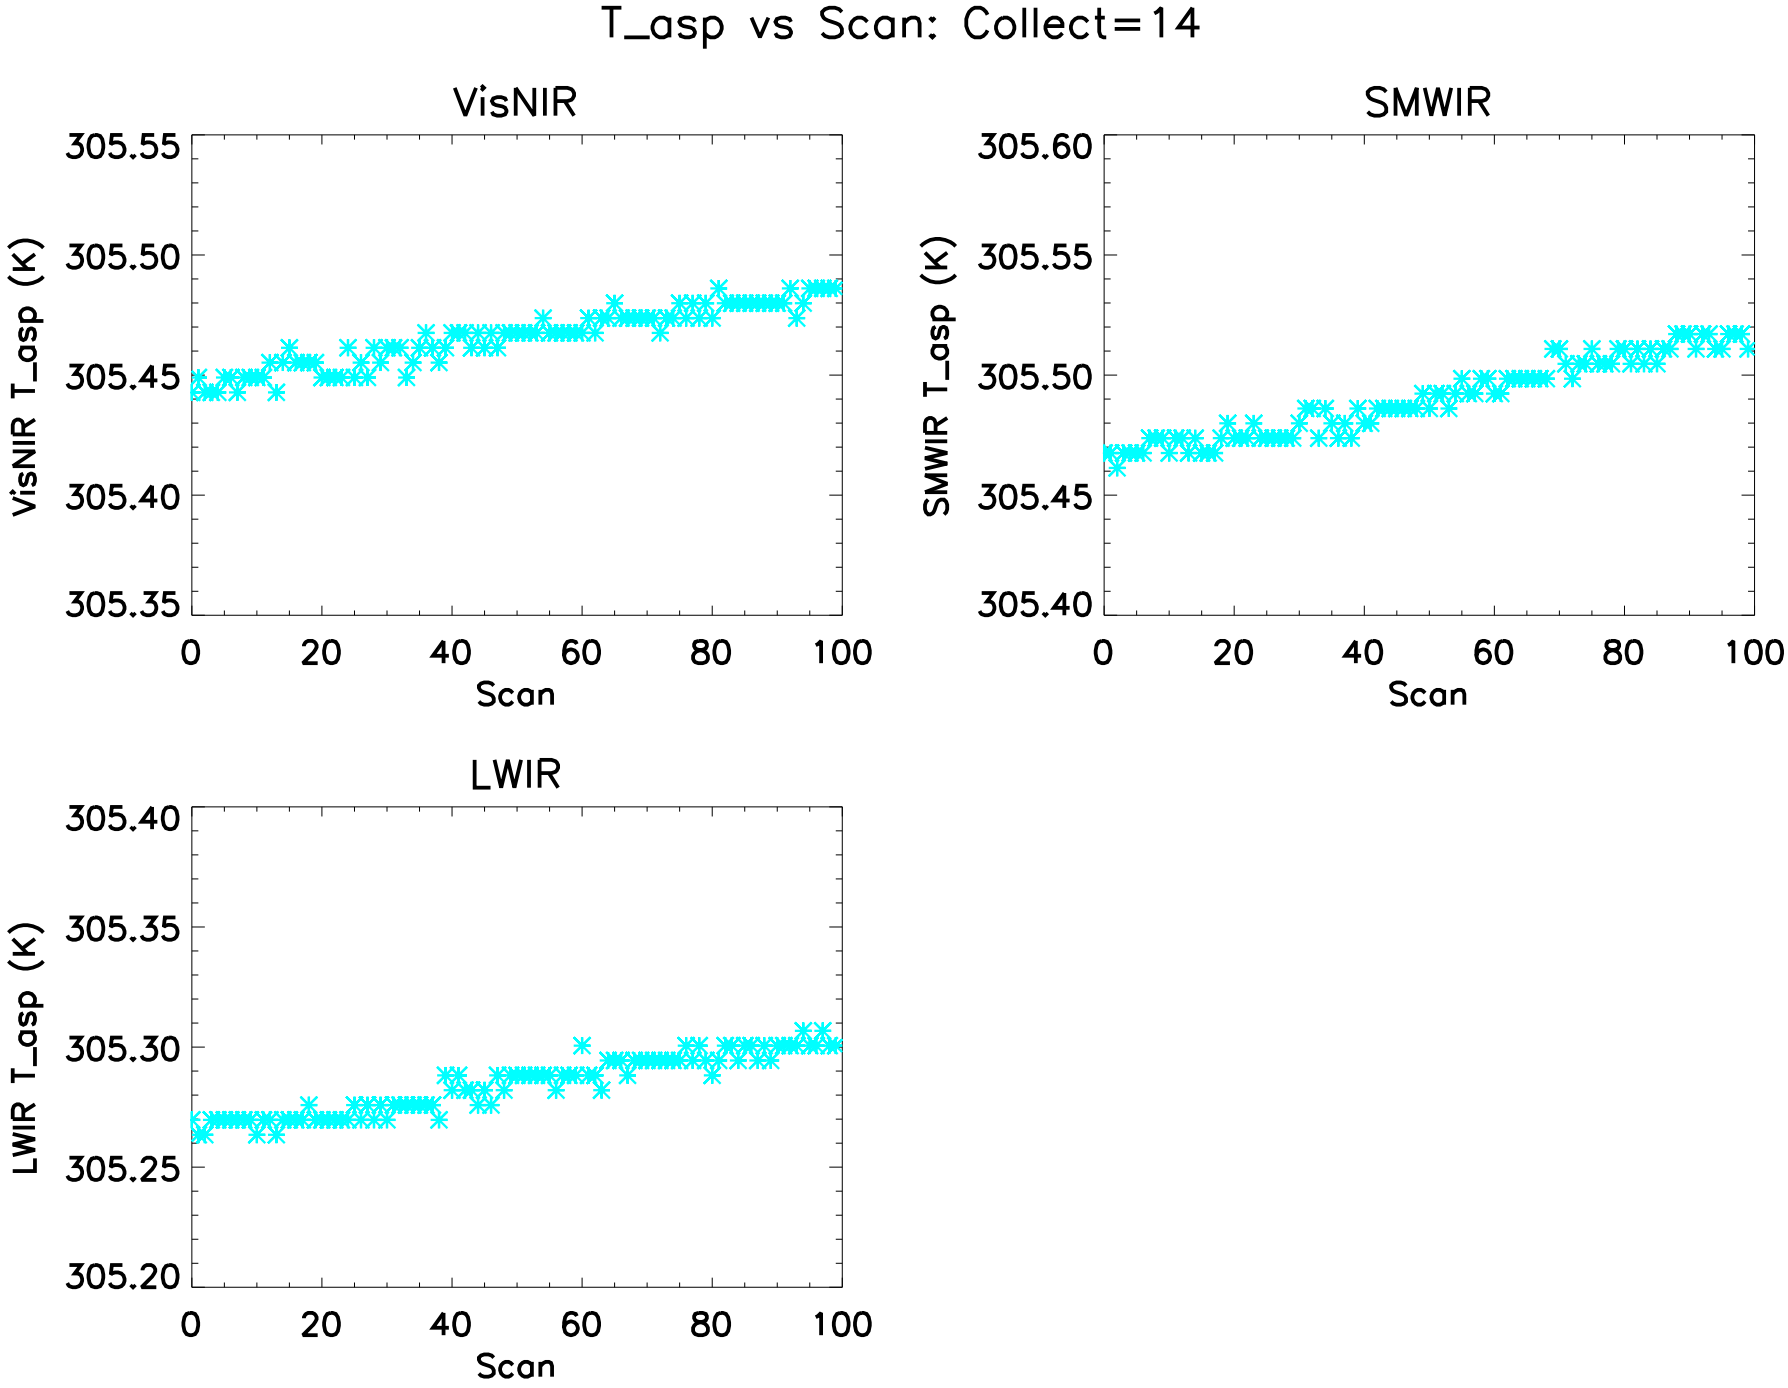
T_asp vs Scan: Collect=14
VisNIR
VisNIR T_asp (K)
305.55
305.50
305.45
305.40
305.35
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.60
305.55
305.50
305.45
305.40
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.40
305.35
305.30
305.25
305.20
0
20
40
60
80
100
Scan

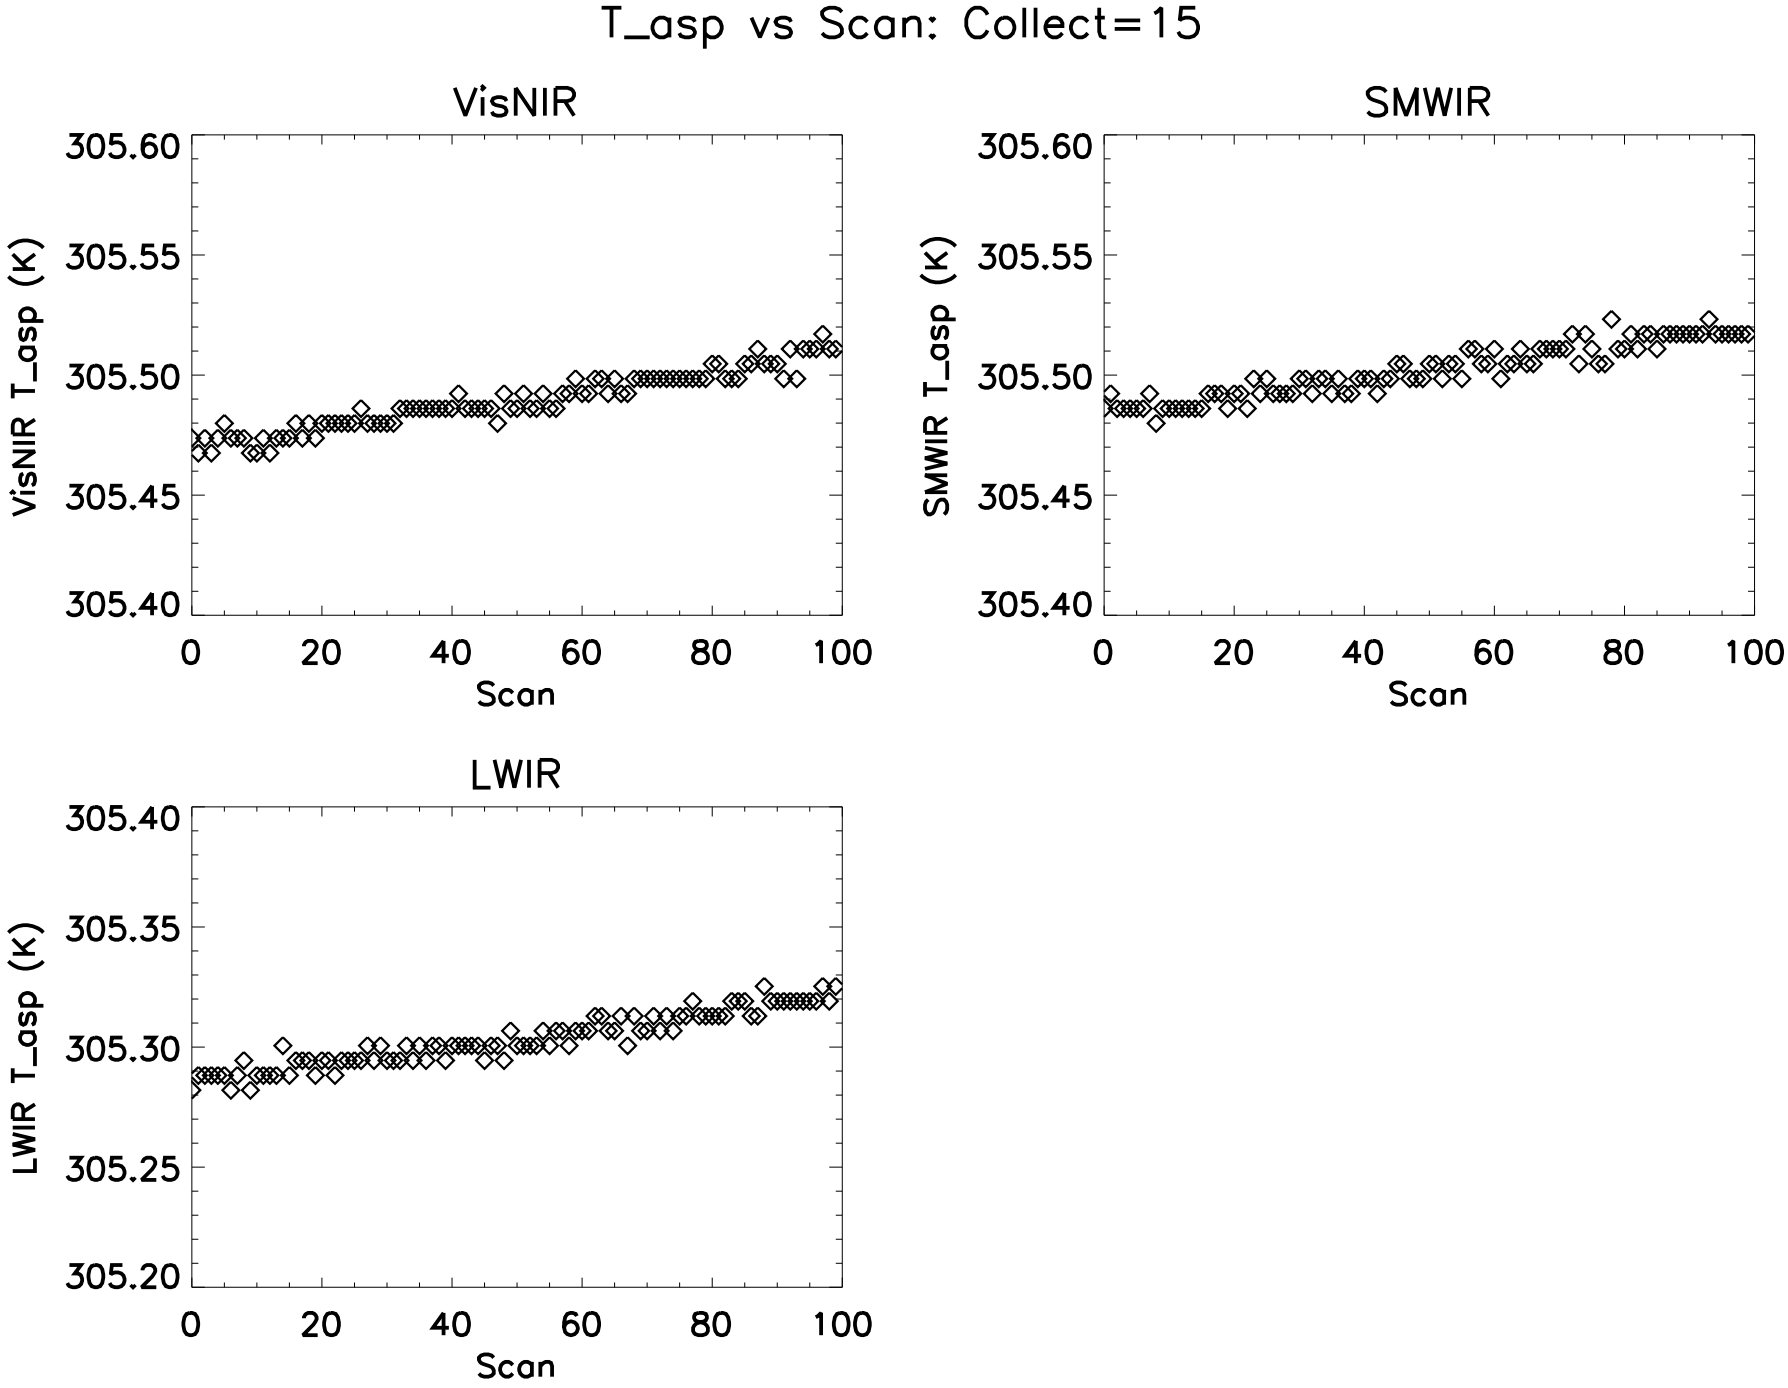
T_asp vs Scan: Collect=15
VisNIR
VisNIR T_asp (K)
305.60
305.55
305.50
305.45
305.40
0
20
40
60
80
100
Scan
SMWIR
SMWIR T_asp (K)
305.60
305.55
305.50
305.45
305.40
0
20
40
60
80
100
Scan
LWIR
LWIR T_asp (K)
305.40
305.35
305.30
305.25
305.20
0
20
40
60
80
100
Scan

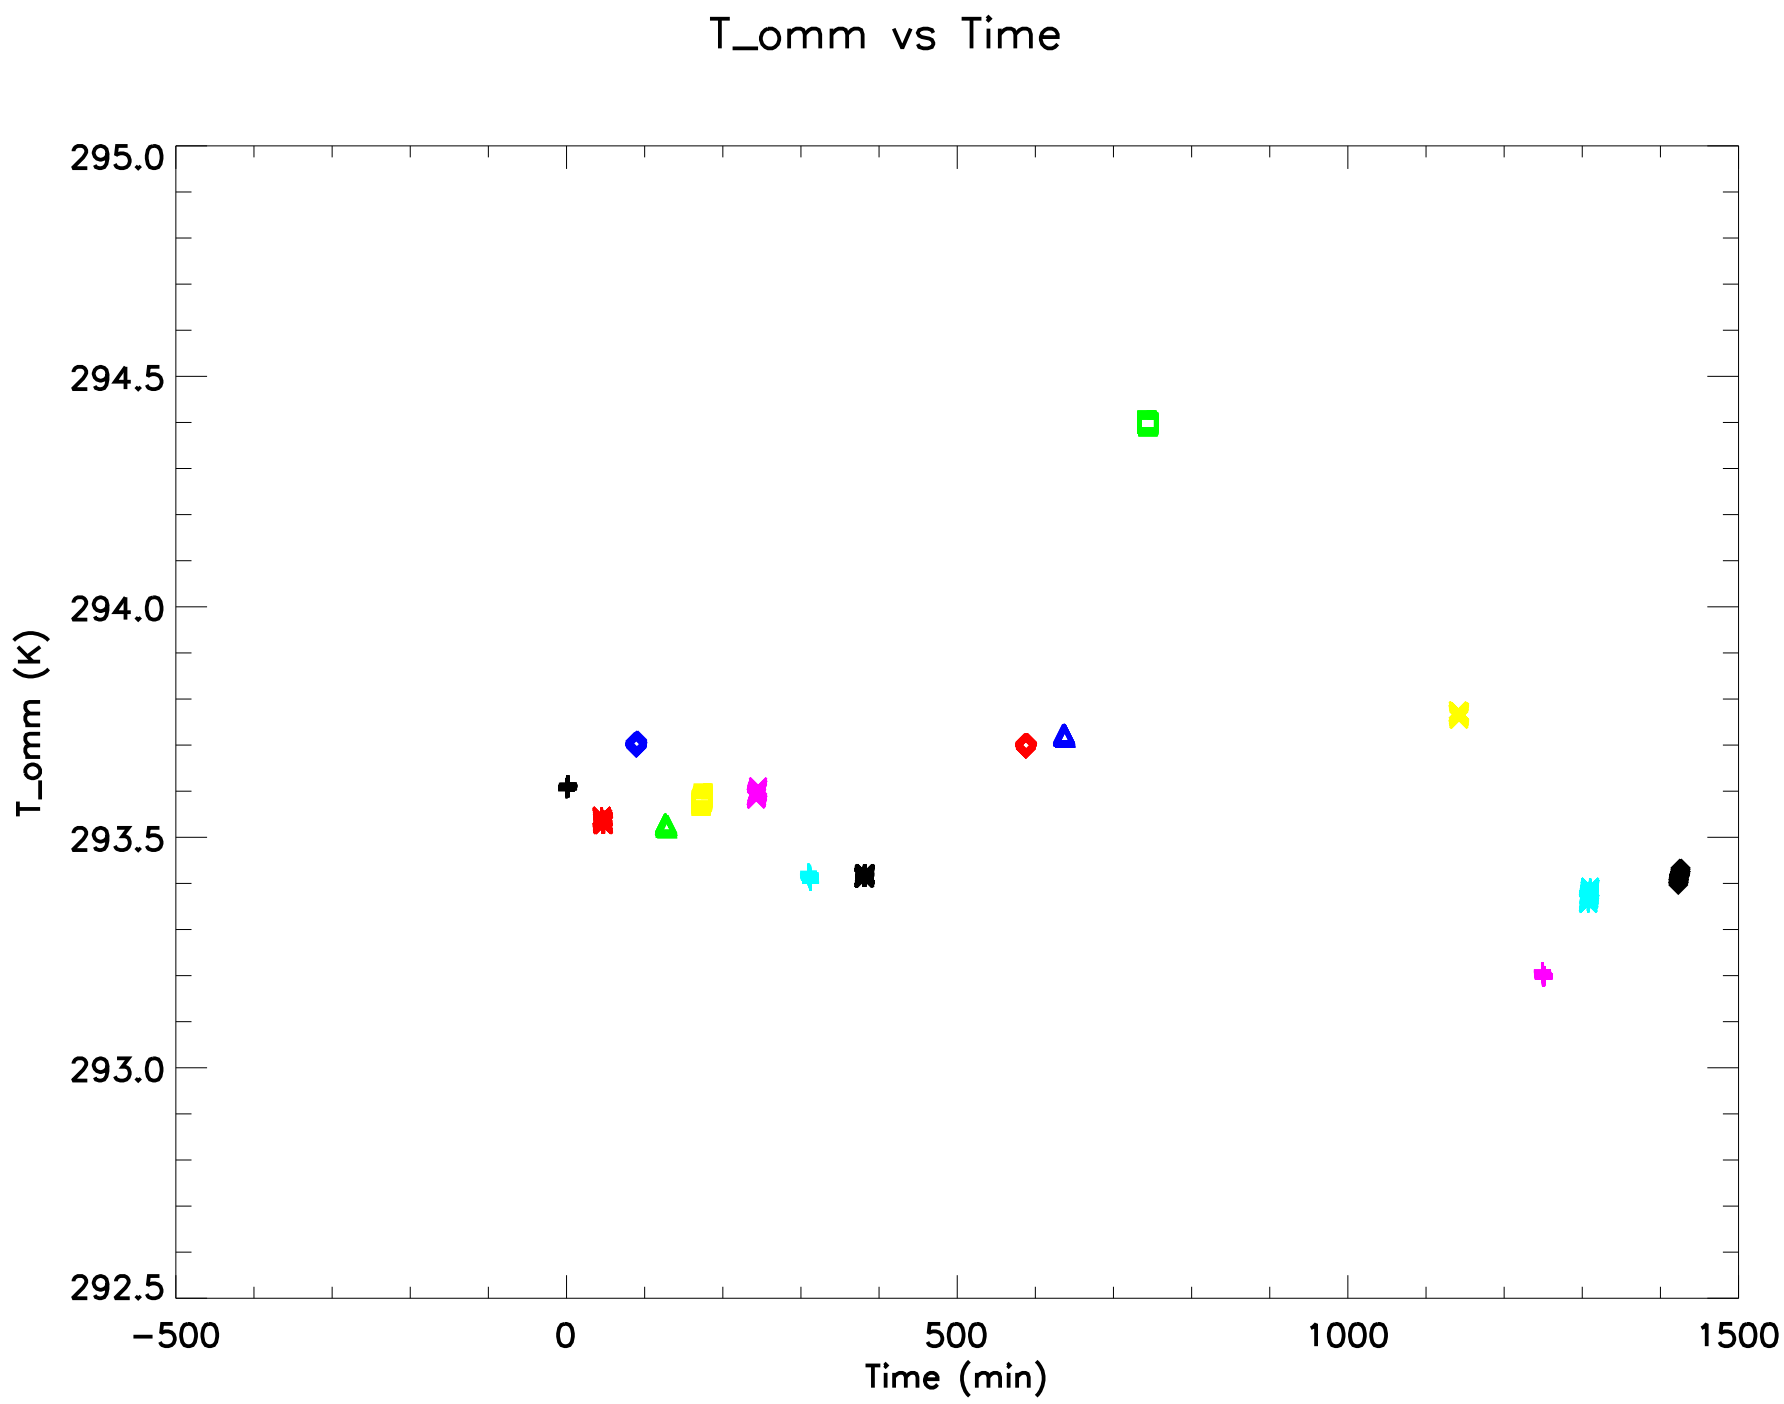
T_omm vs Time
295.0
294.5
294.0
293.5
293.0
292.5
T_omm (K)
−500
0
500
1000
1500
Time (min)

T_omm vs Scan

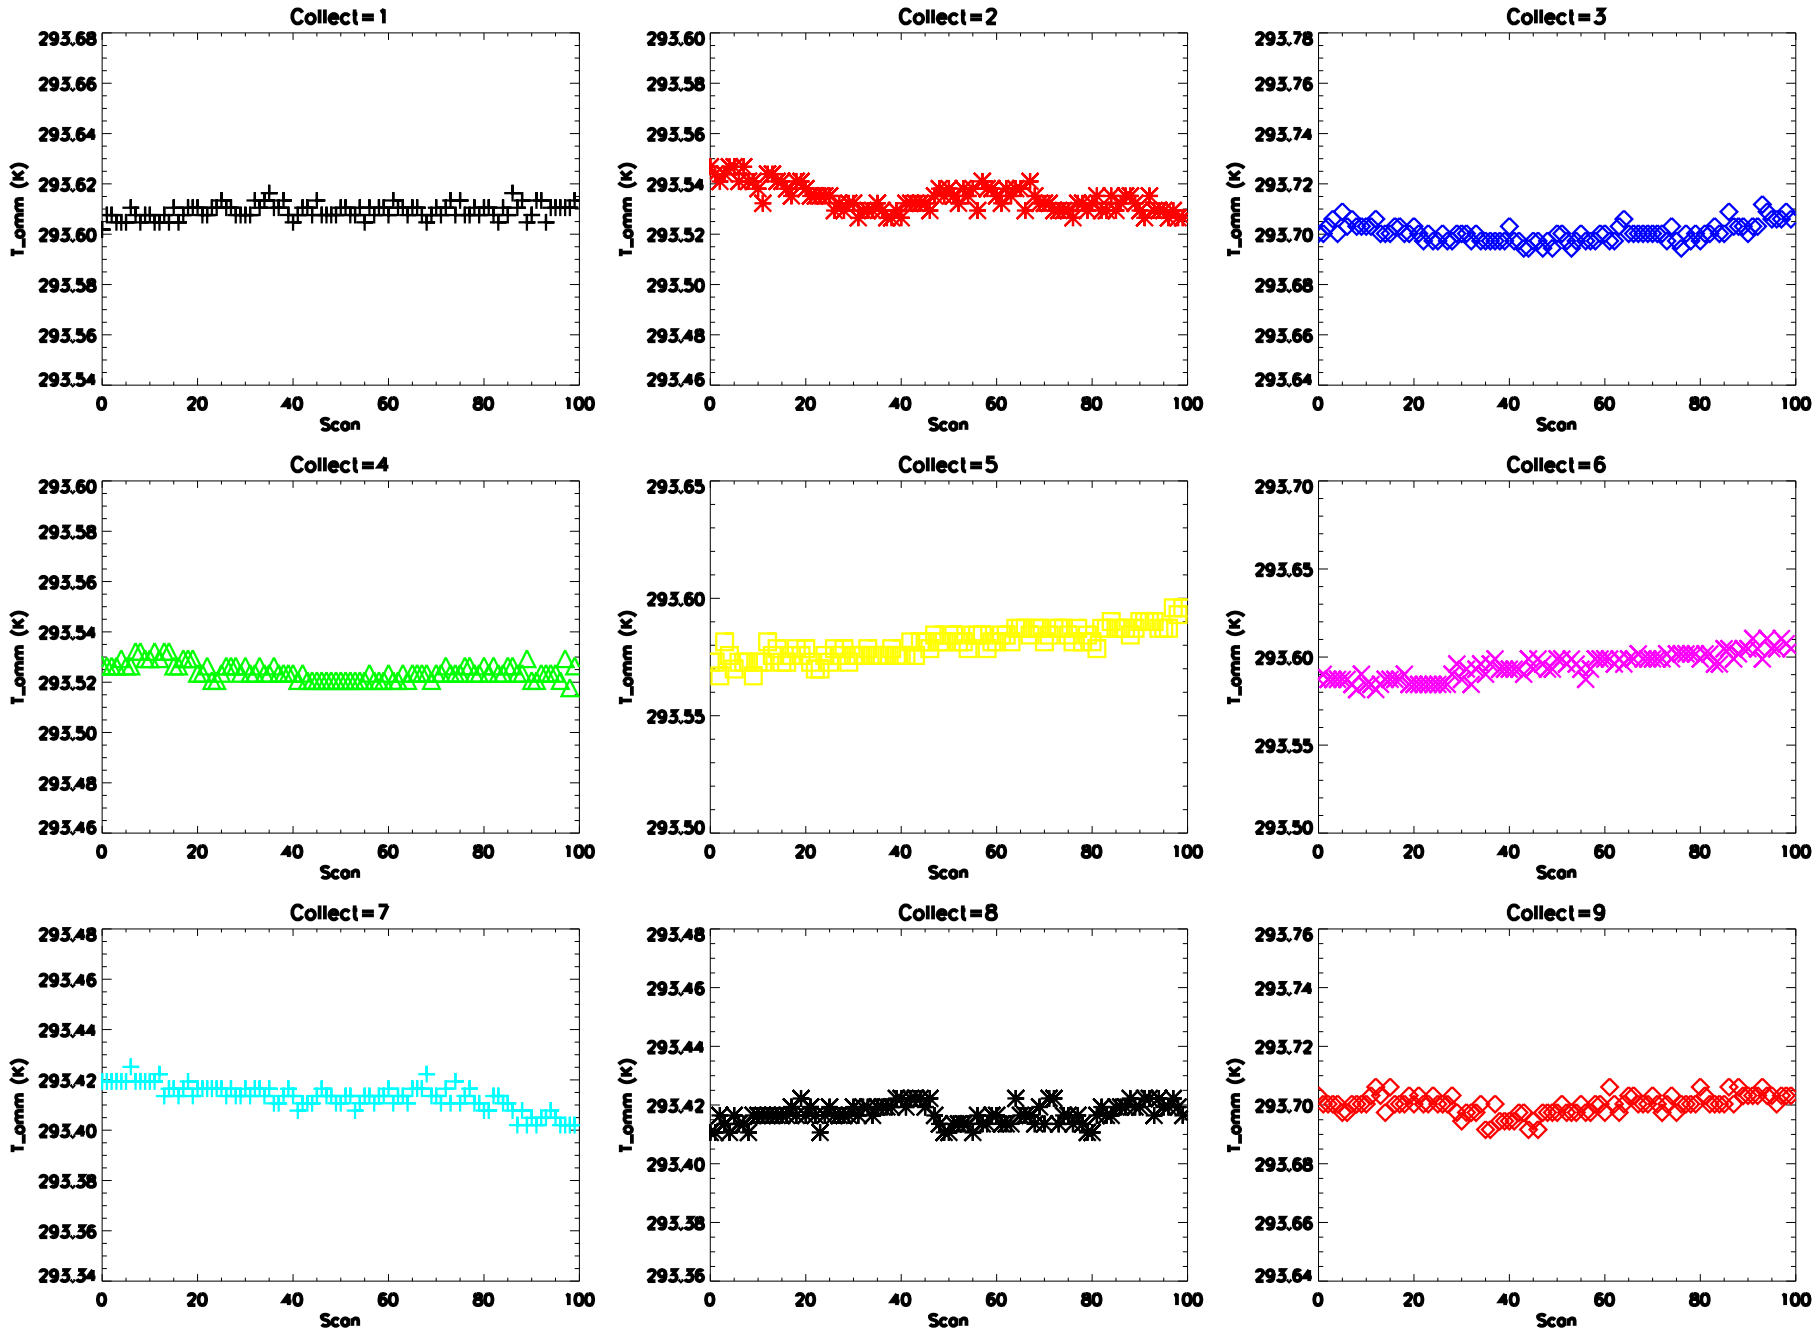
Collect=1
Collect=2
Collect=3
Collect=4
Collect=5
Collect=6
Collect=7
Collect=8
Collect=9
T_omm (K)
Scan

T_omm vs Scan

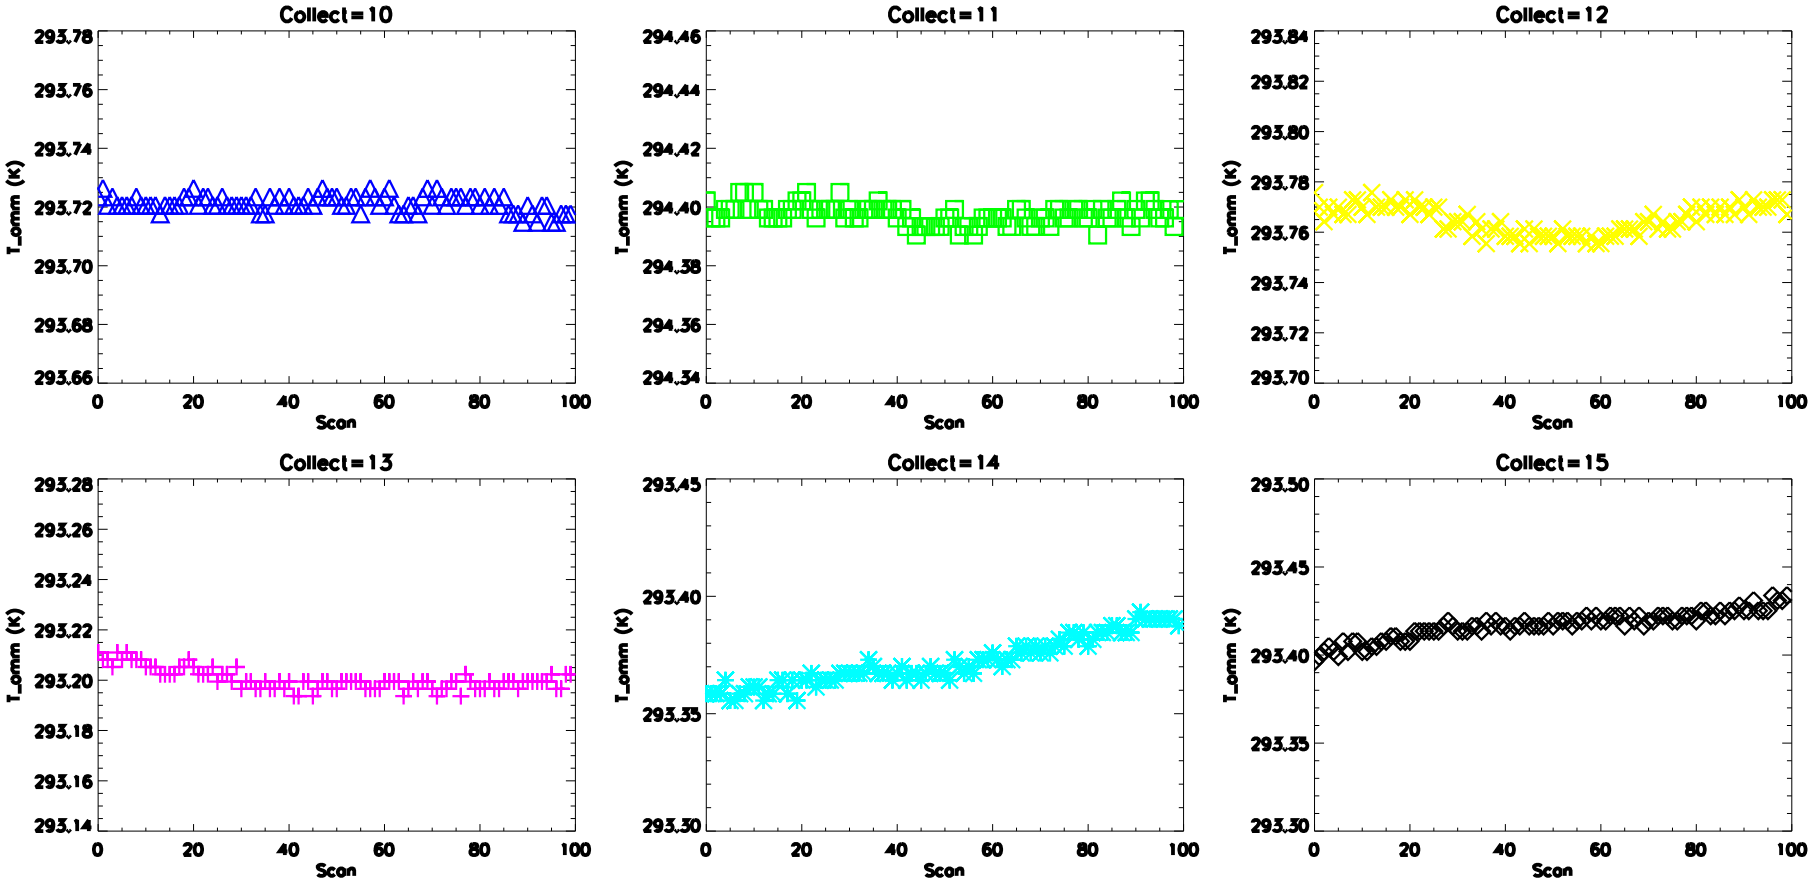
Collect = 10
T_omm (K)
293.78
293.76
293.74
293.72
293.70
293.68
293.66
0
20
40
60
80
100
Scan
Collect = 11
T_omm (K)
294.46
294.44
294.42
294.40
294.38
294.36
294.34
0
20
40
60
80
100
Scan
Collect = 12
T_omm (K)
293.84
293.82
293.80
293.78
293.76
293.74
293.72
293.70
0
20
40
60
80
100
Scan
Collect = 13
T_omm (K)
293.28
293.26
293.24
293.22
293.20
293.18
293.16
293.14
0
20
40
60
80
100
Scan
Collect = 14
T_omm (K)
293.45
293.40
293.35
293.30
0
20
40
60
80
100
Scan
Collect = 15
T_omm (K)
293.50
293.45
293.40
293.35
293.30
0
20
40
60
80
100
Scan